




Appendix 14-PD-6: Parts 2, 3 & 4 Potential Areas of Contamination

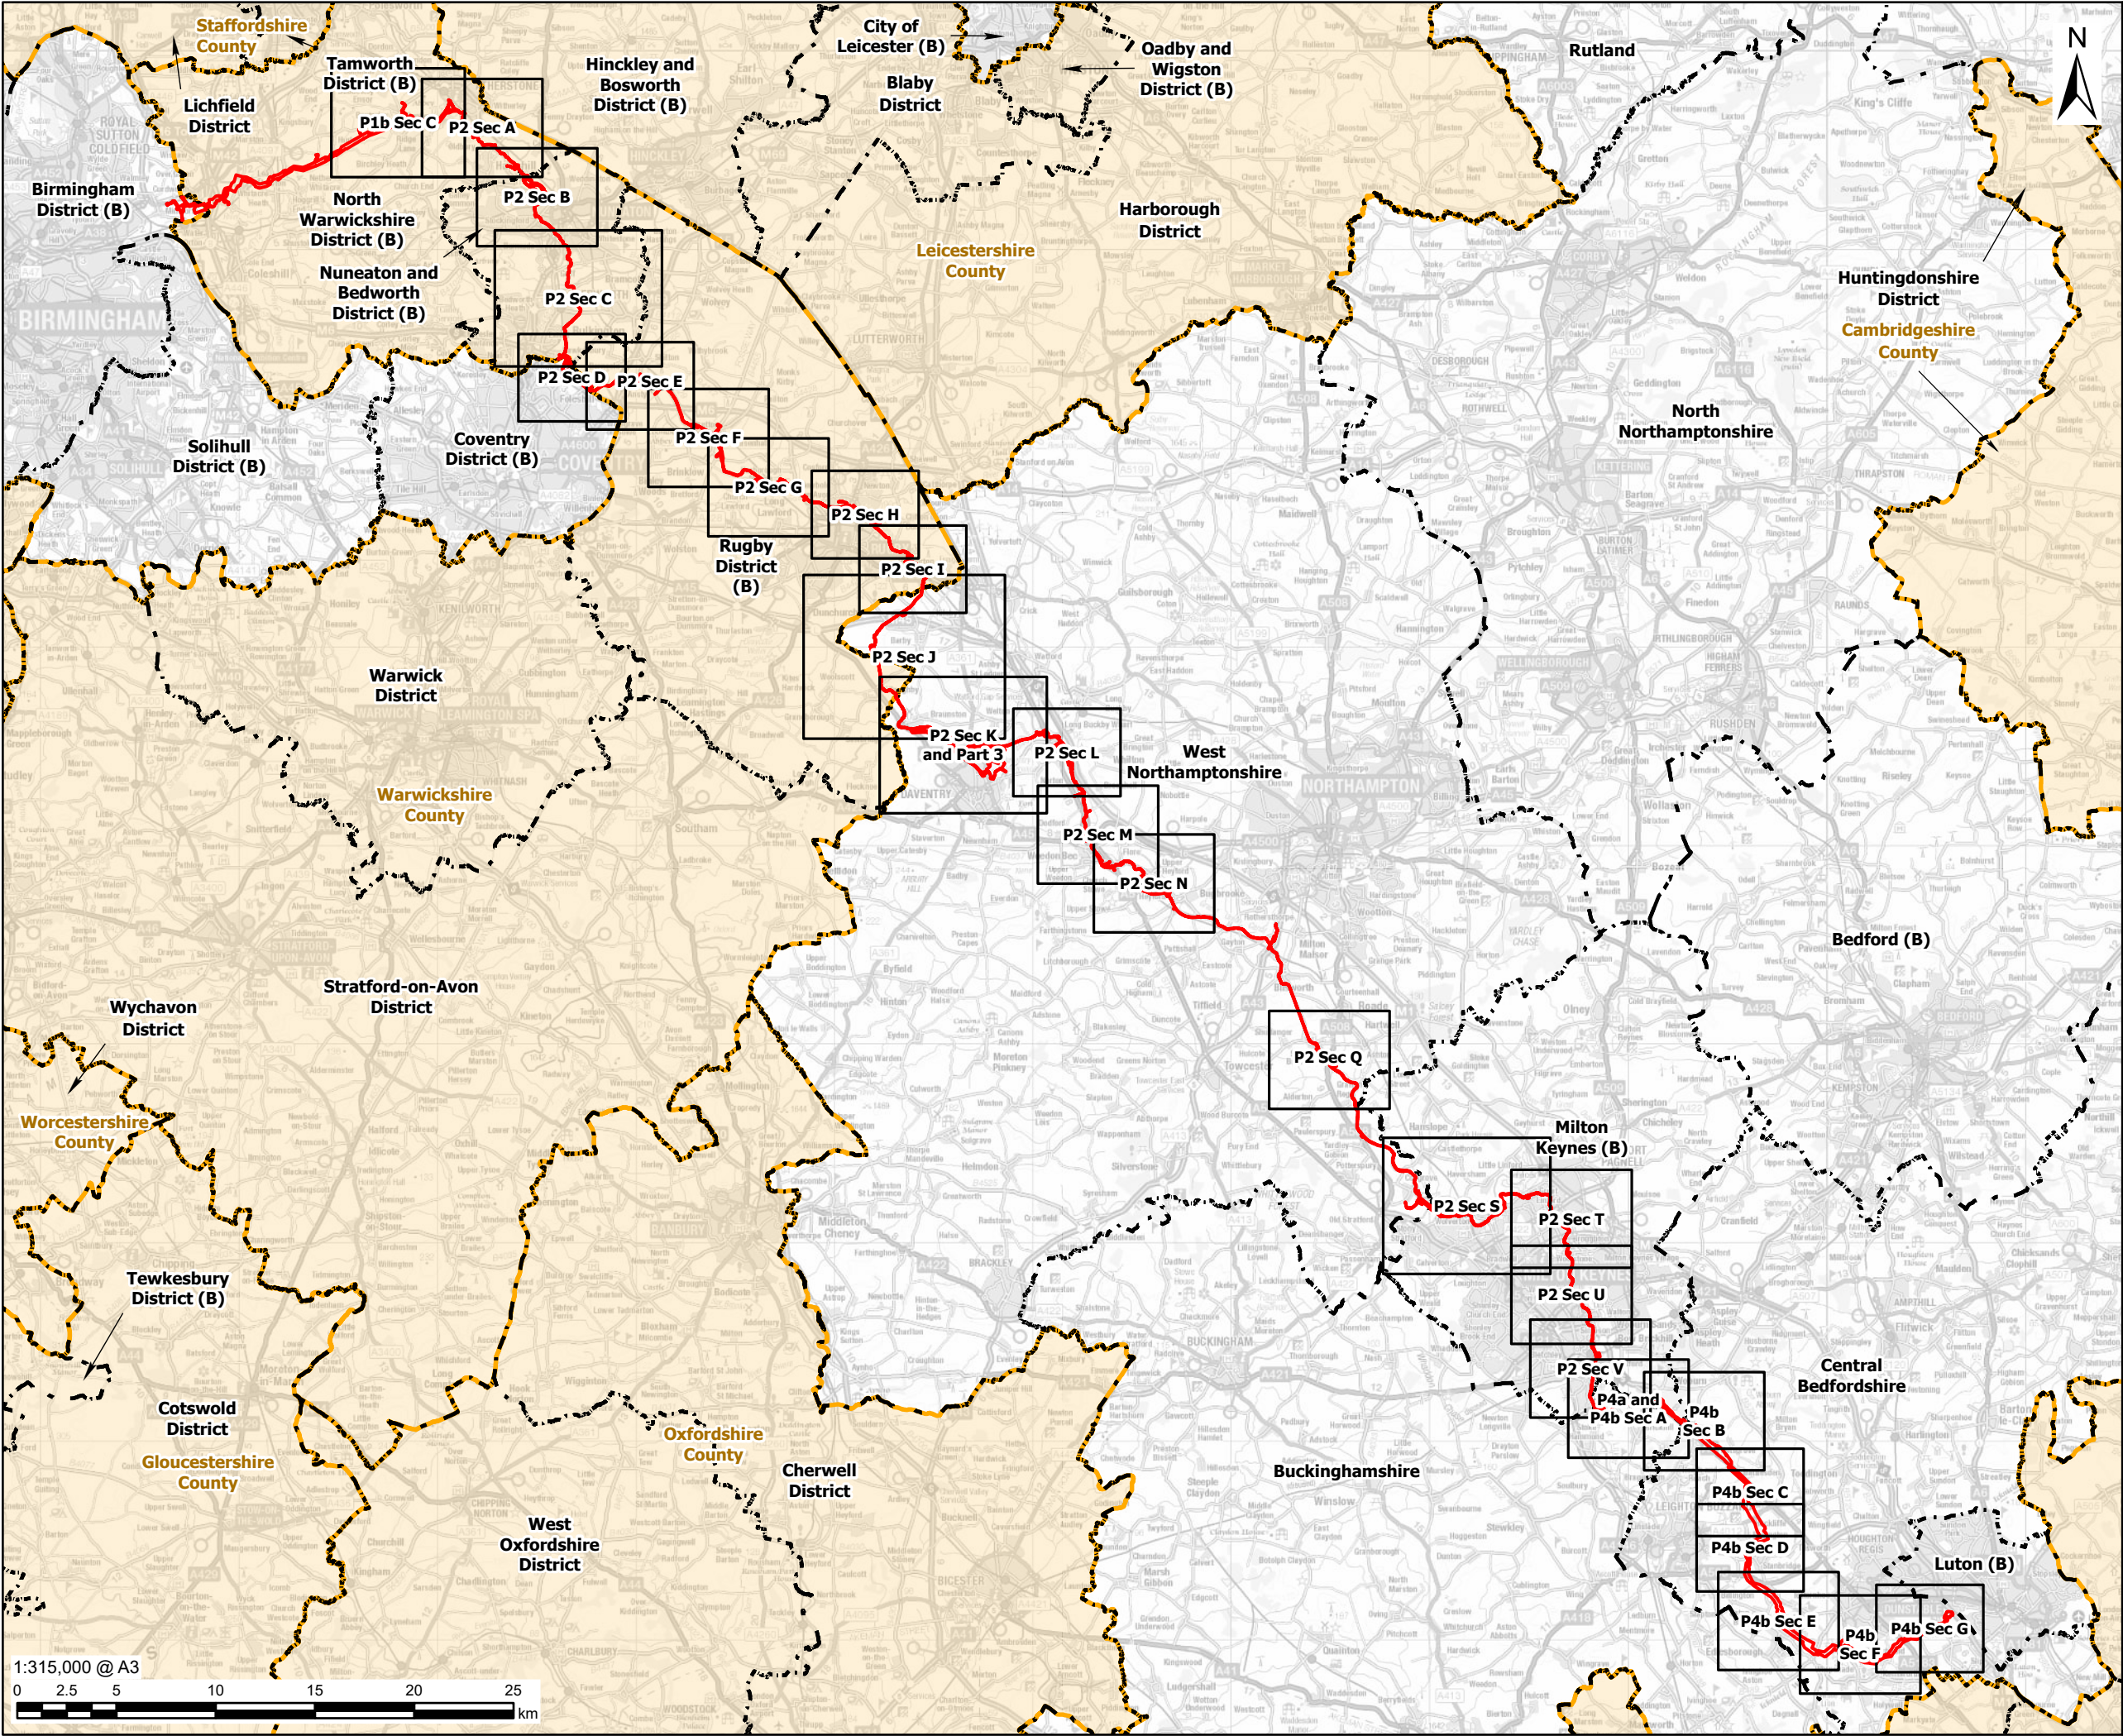

AECOM

PROJECT

Grand Union Canal Transfer

CLIENT

Affinity Water, Severn Trent Water and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Preliminary Order Limits
- District Boundary
- County Boundary
- Sheet Extent

NOTES

- Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
- Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination Overview

FIGURE NUMBER

Figure 14-PD-6

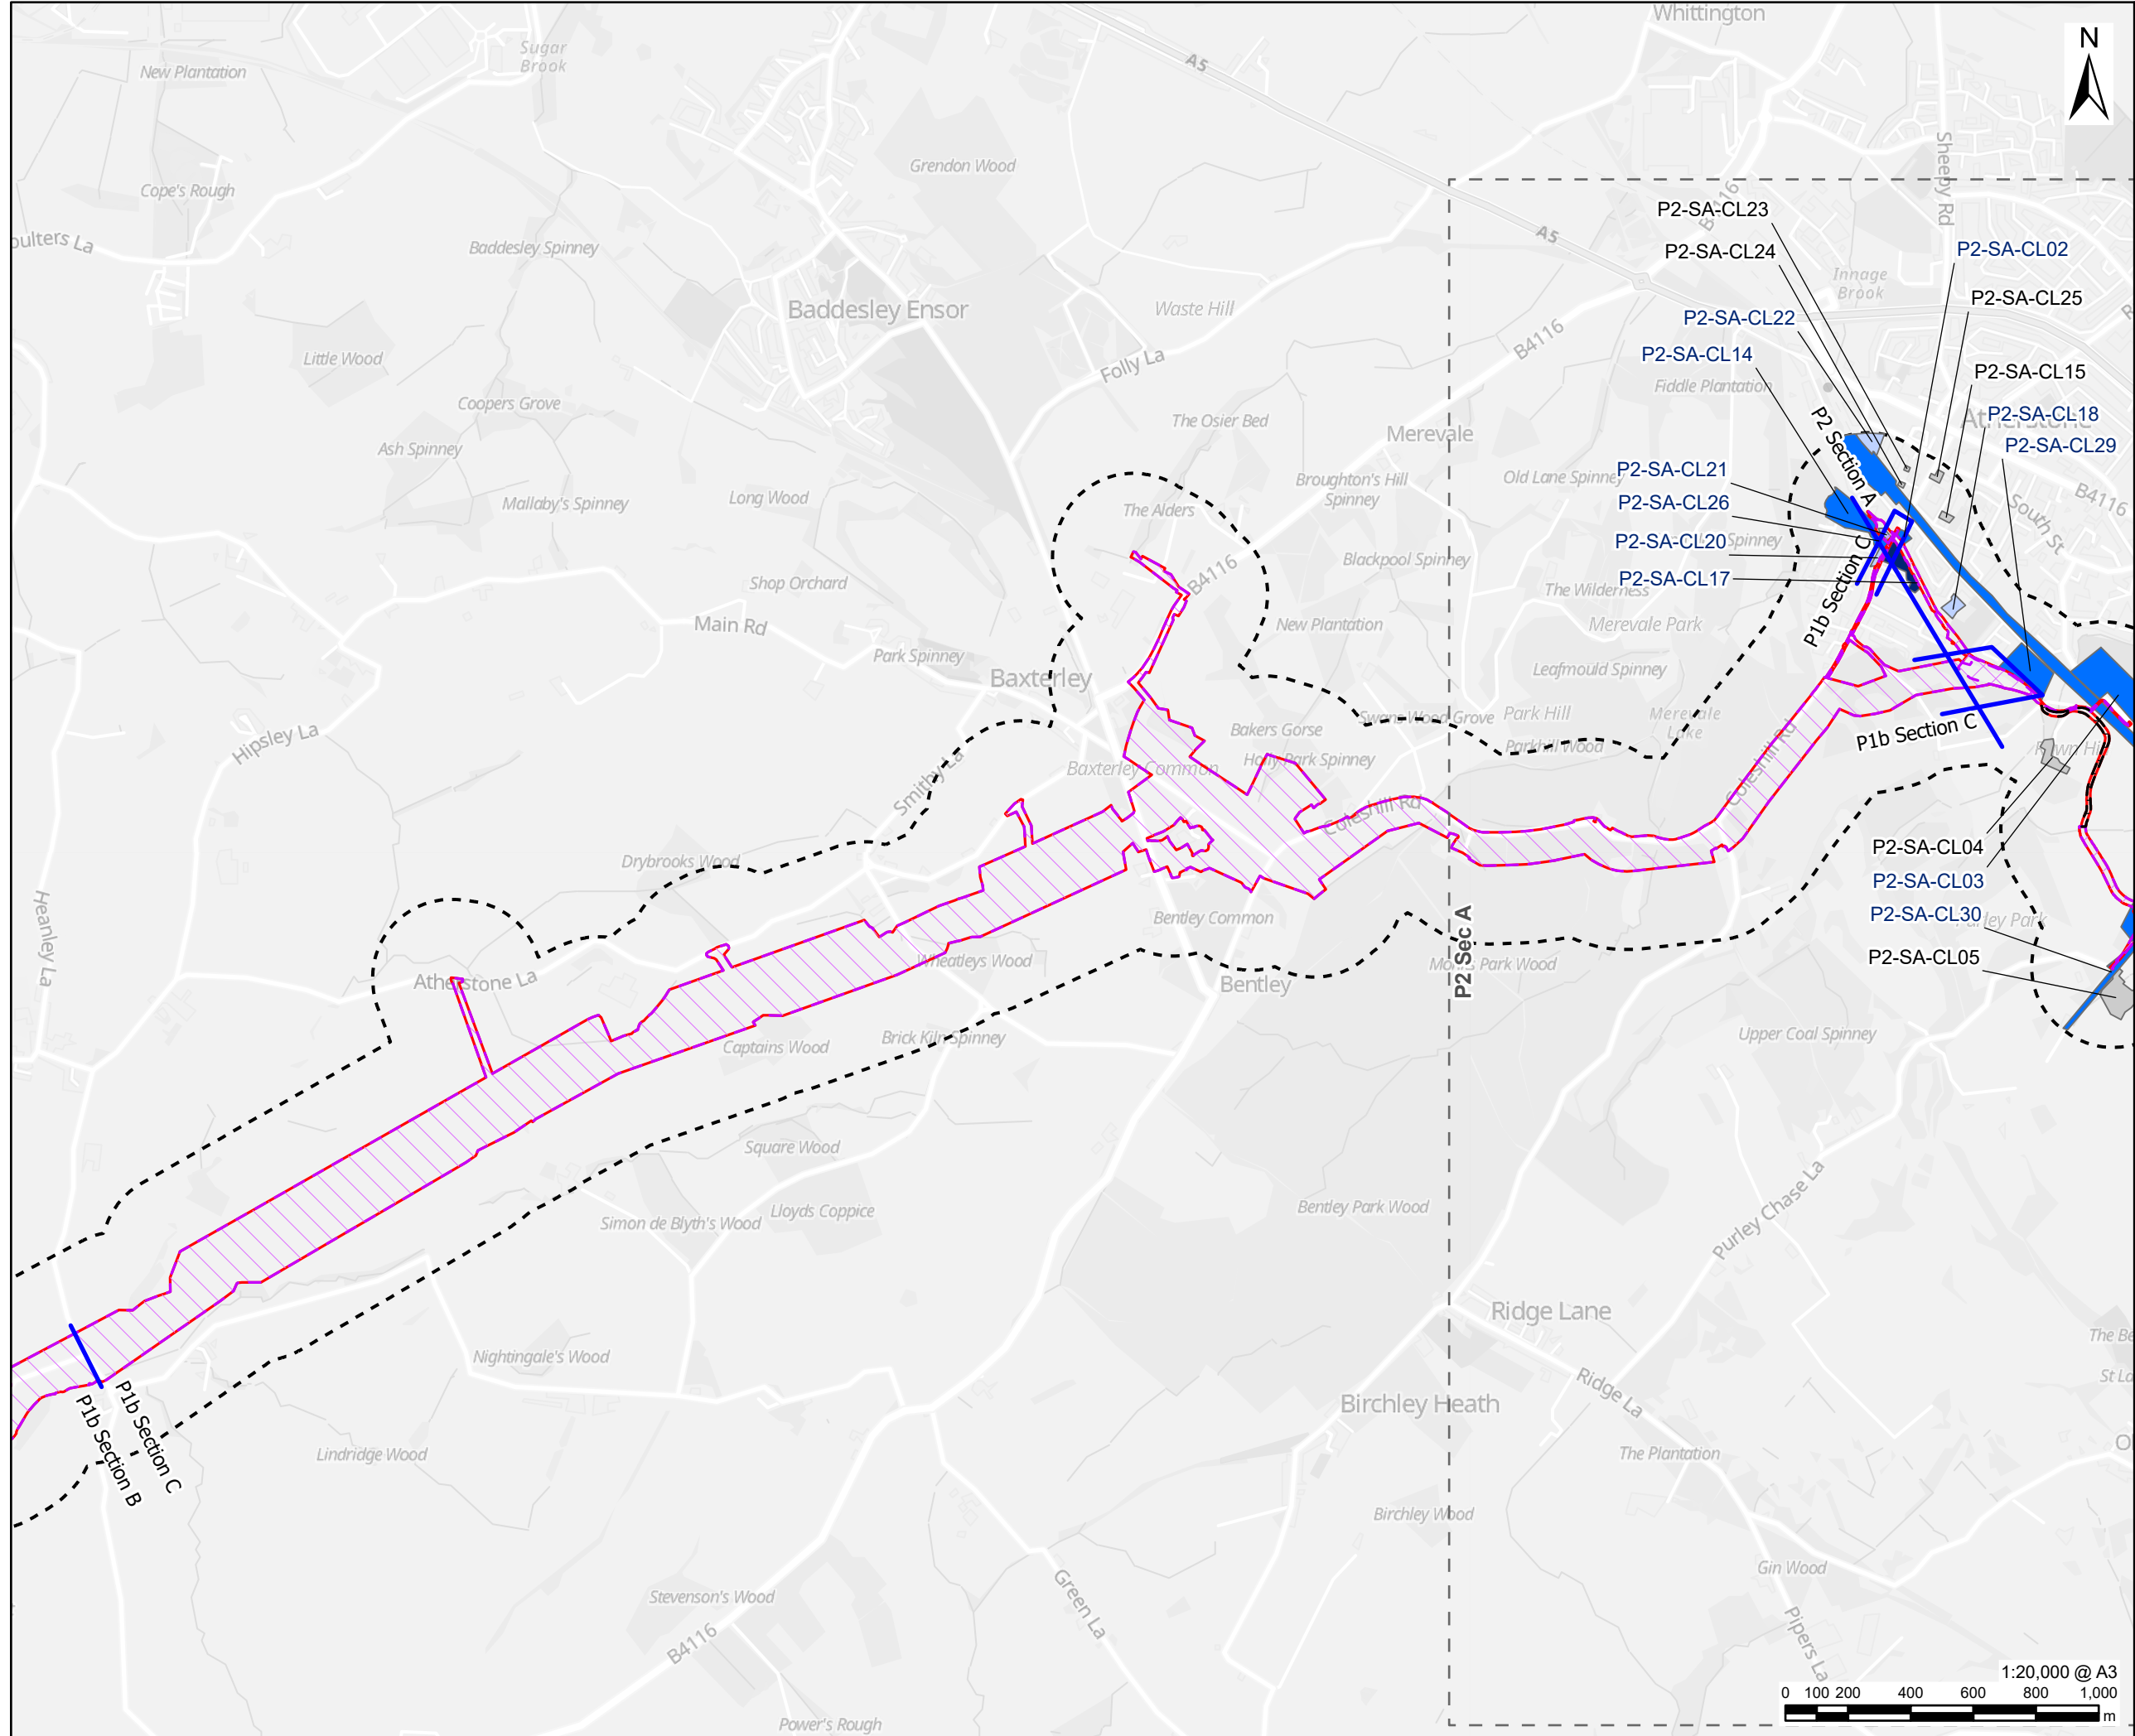

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

	Part 1b
	Part 2 - Indicative Work Area
	Part 2 - Indicative Non-Work Area
	250m Study Area for Geology, Land Contamination and Hydrogeology
	Preliminary Order Limits
	Sheet Extent
	Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025


Contains data from OS Zoomstack

3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.


ISSUE PURPOSE
FINAL
PROJECT NUMBER
60720432
FIGURE TITLE
Parts 2, 3 & 4 Potential Areas of Contamination Sheet P1b Sec C

FIGURE NUMBER

Figure 14-PD-6

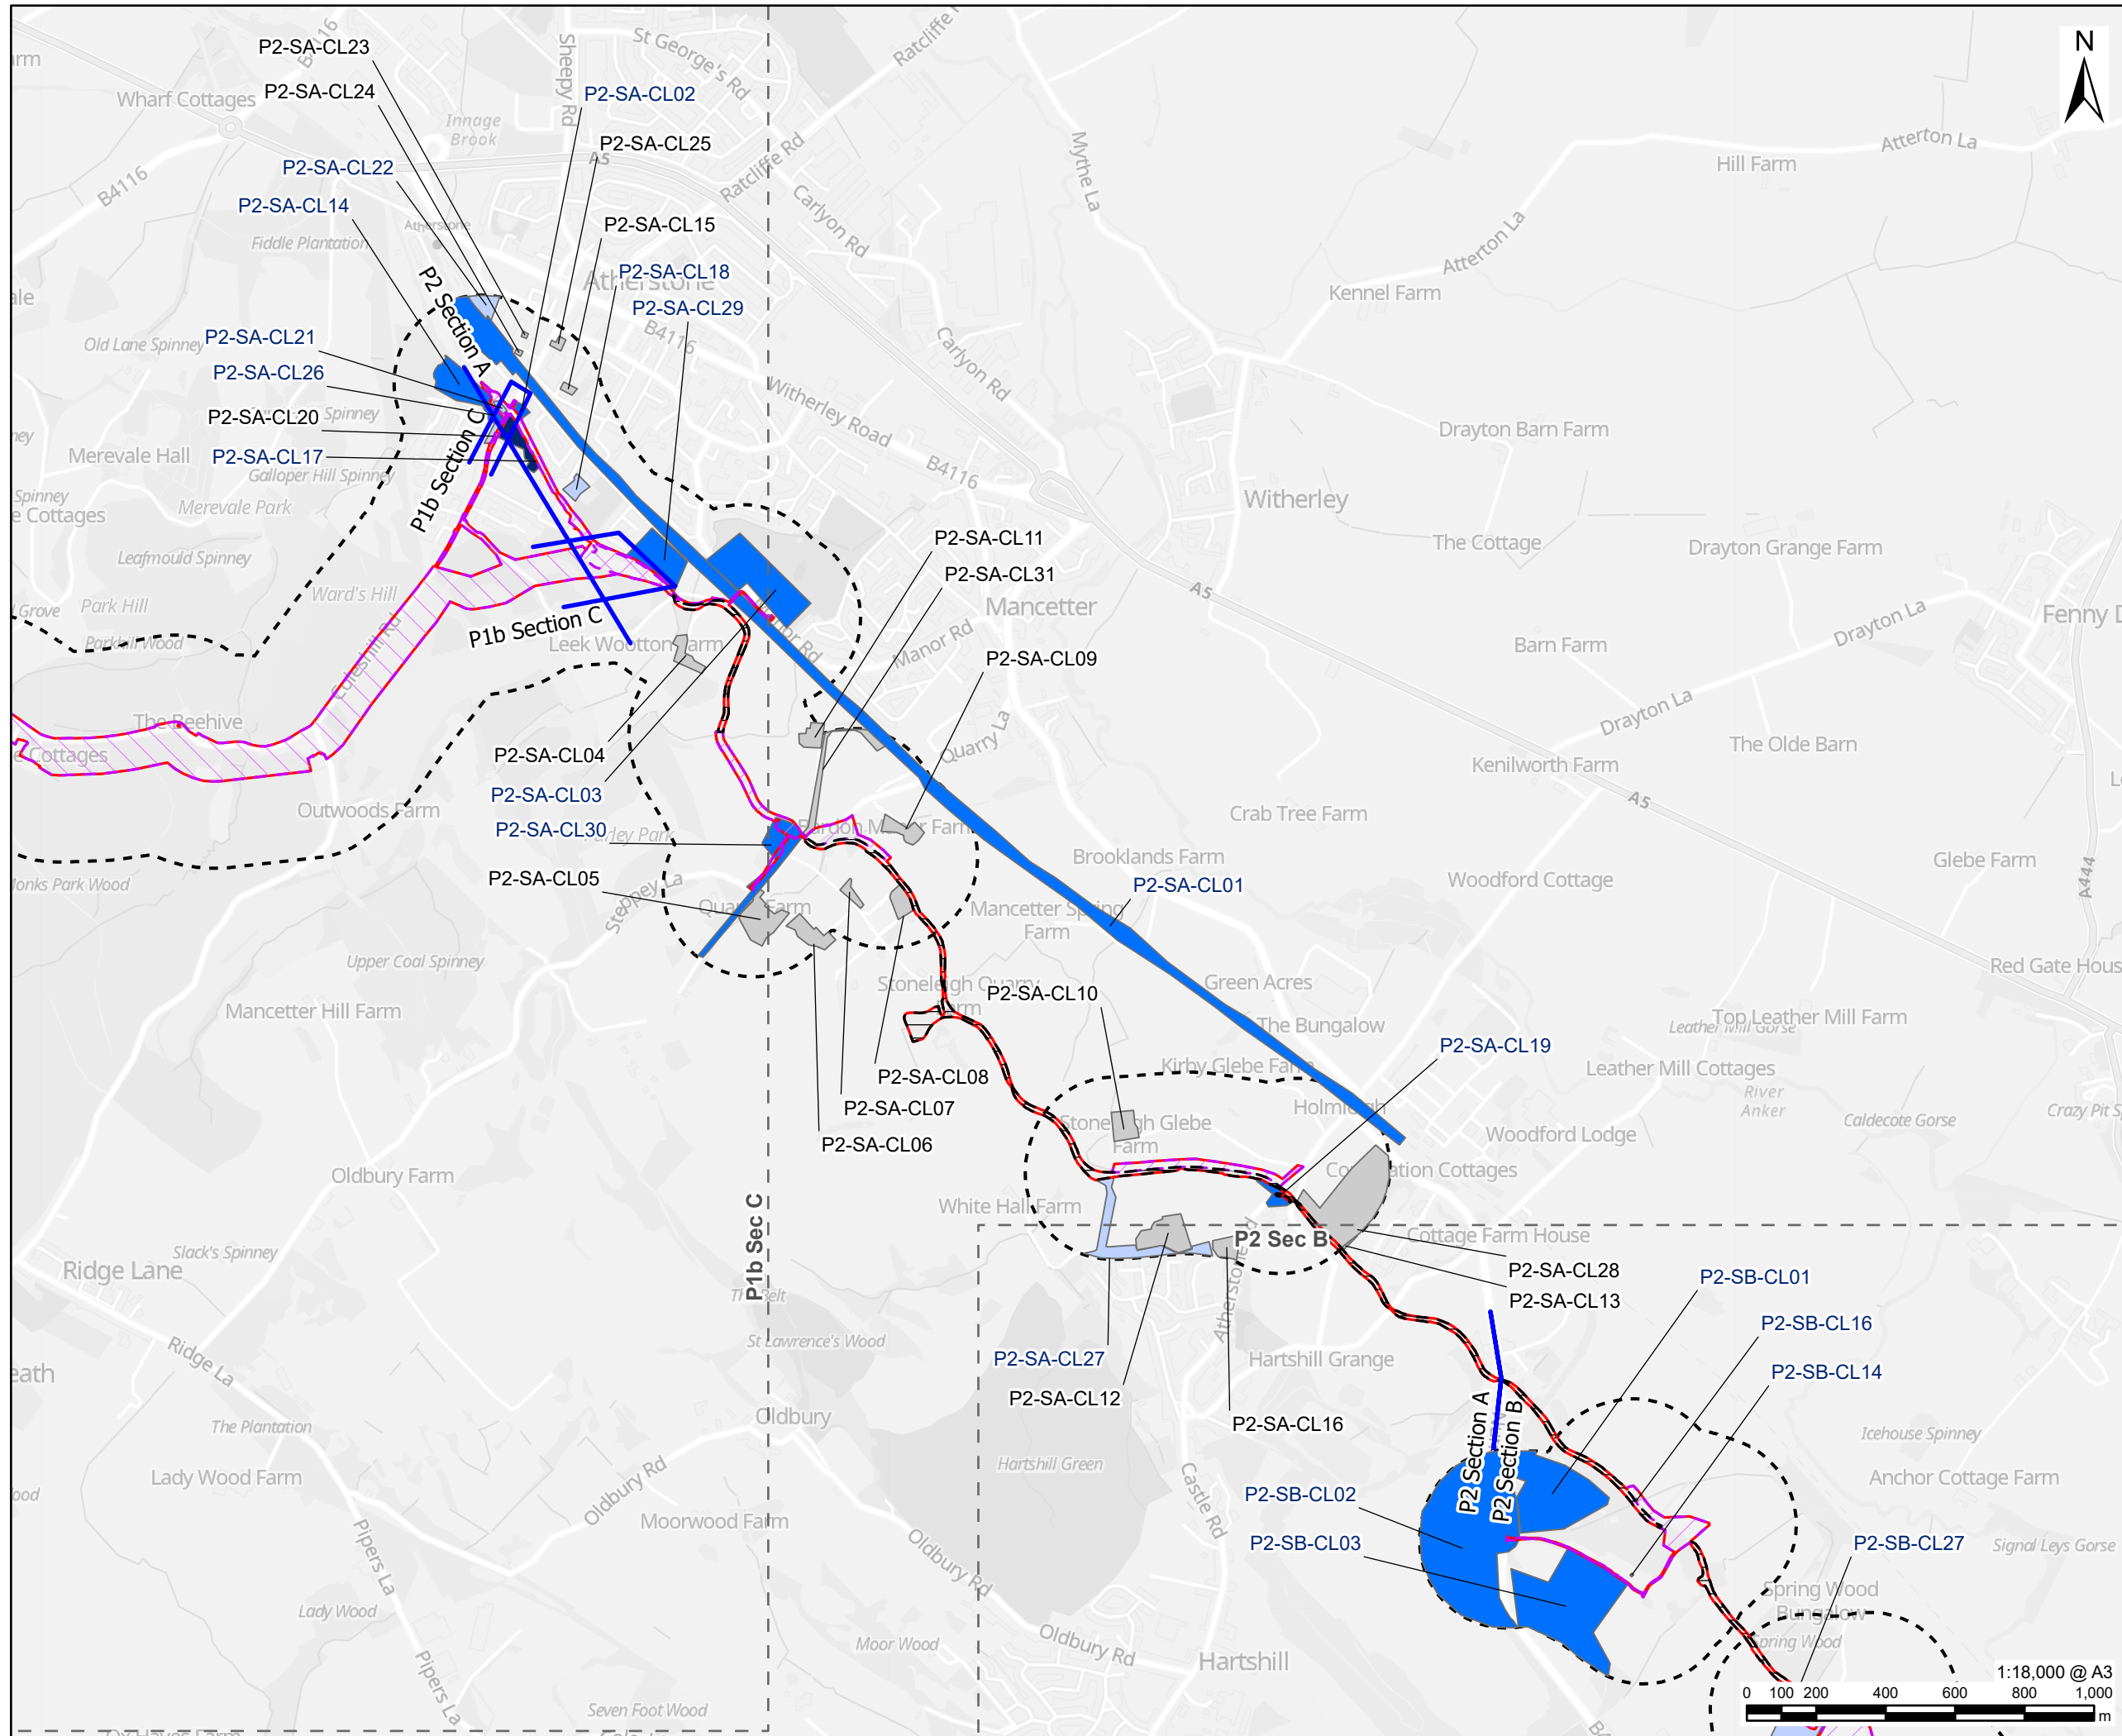

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the staked dimensions. This drawing is not to scale.

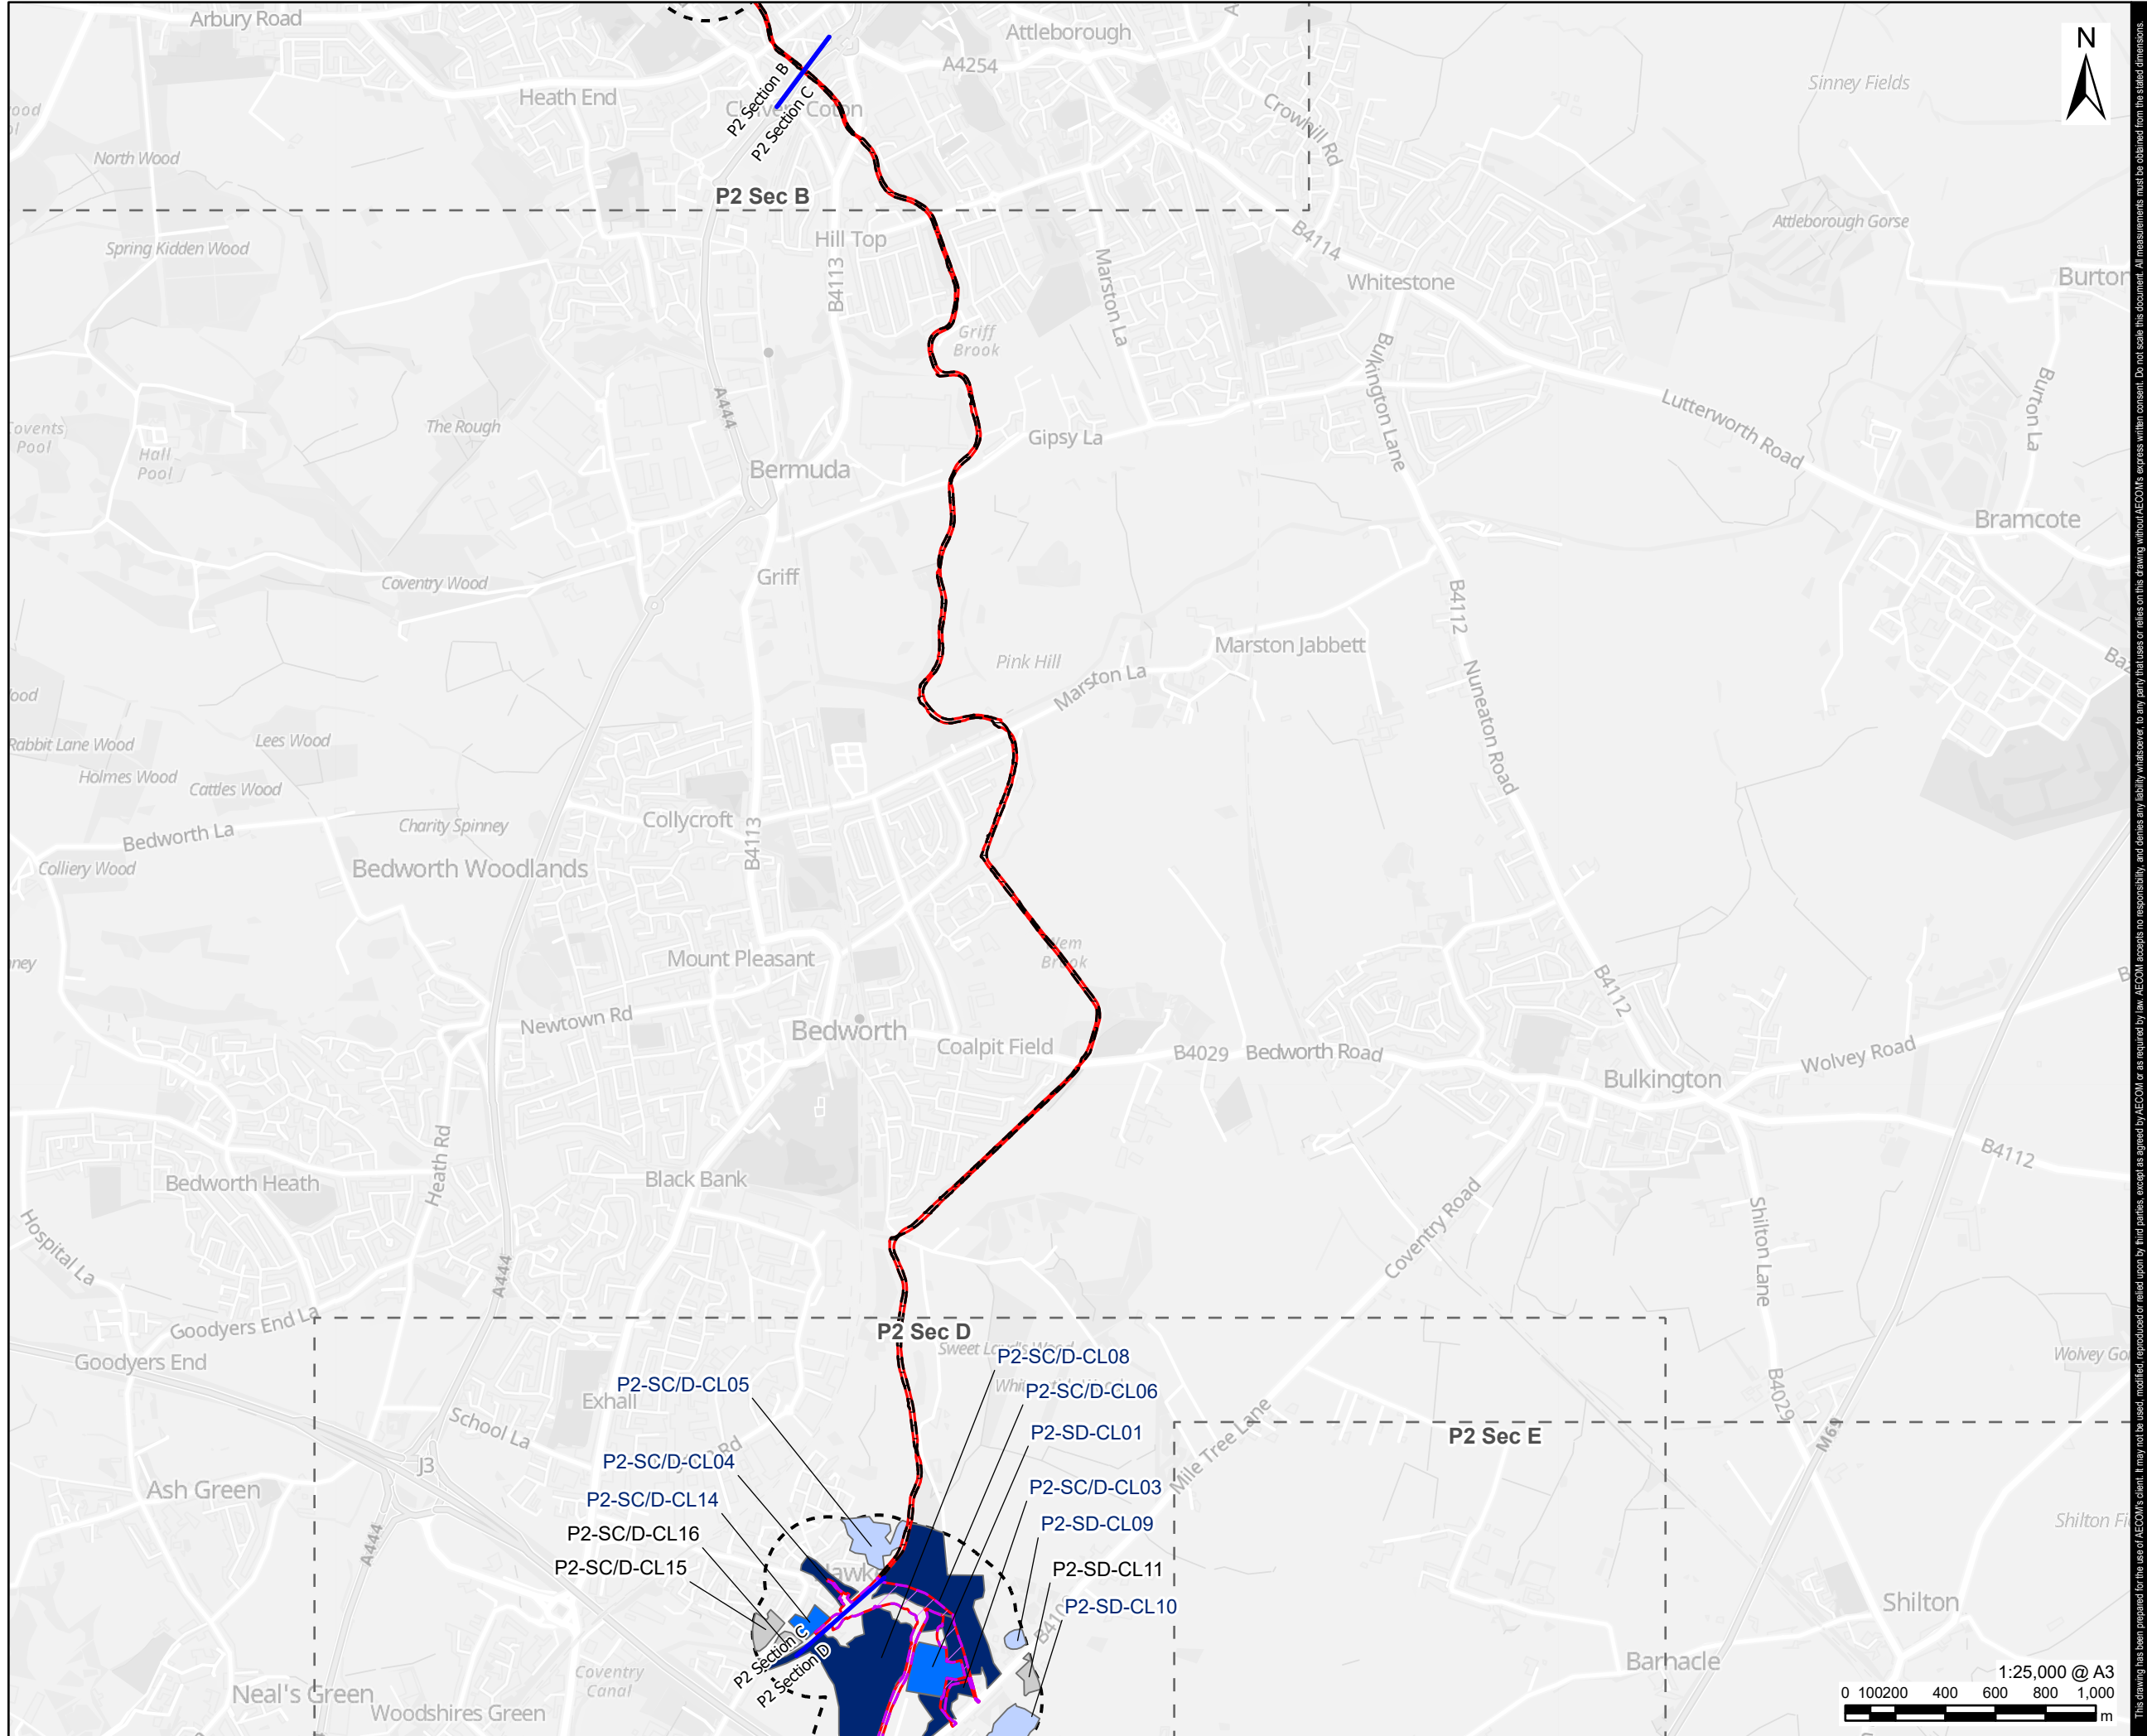

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

AECOM

PROJECT



Grand Union Canal Transfer

CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

-  Part 2 - Indicative Work Area
 Part 2 - Indicative Non-Work Area
 250m Study Area for Geology, Land Contamination and Hydrogeology
 Preliminary Order Limits
 Sheet Extent
 Section Break

Contaminated Land Risk Rating

- 1 to 2 Potential Areas of Contamination not considered to pose an unacceptable risk
- 3 Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
- 4
- 5

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec C

FIGURE NUMBER

Figure 14-PD-6

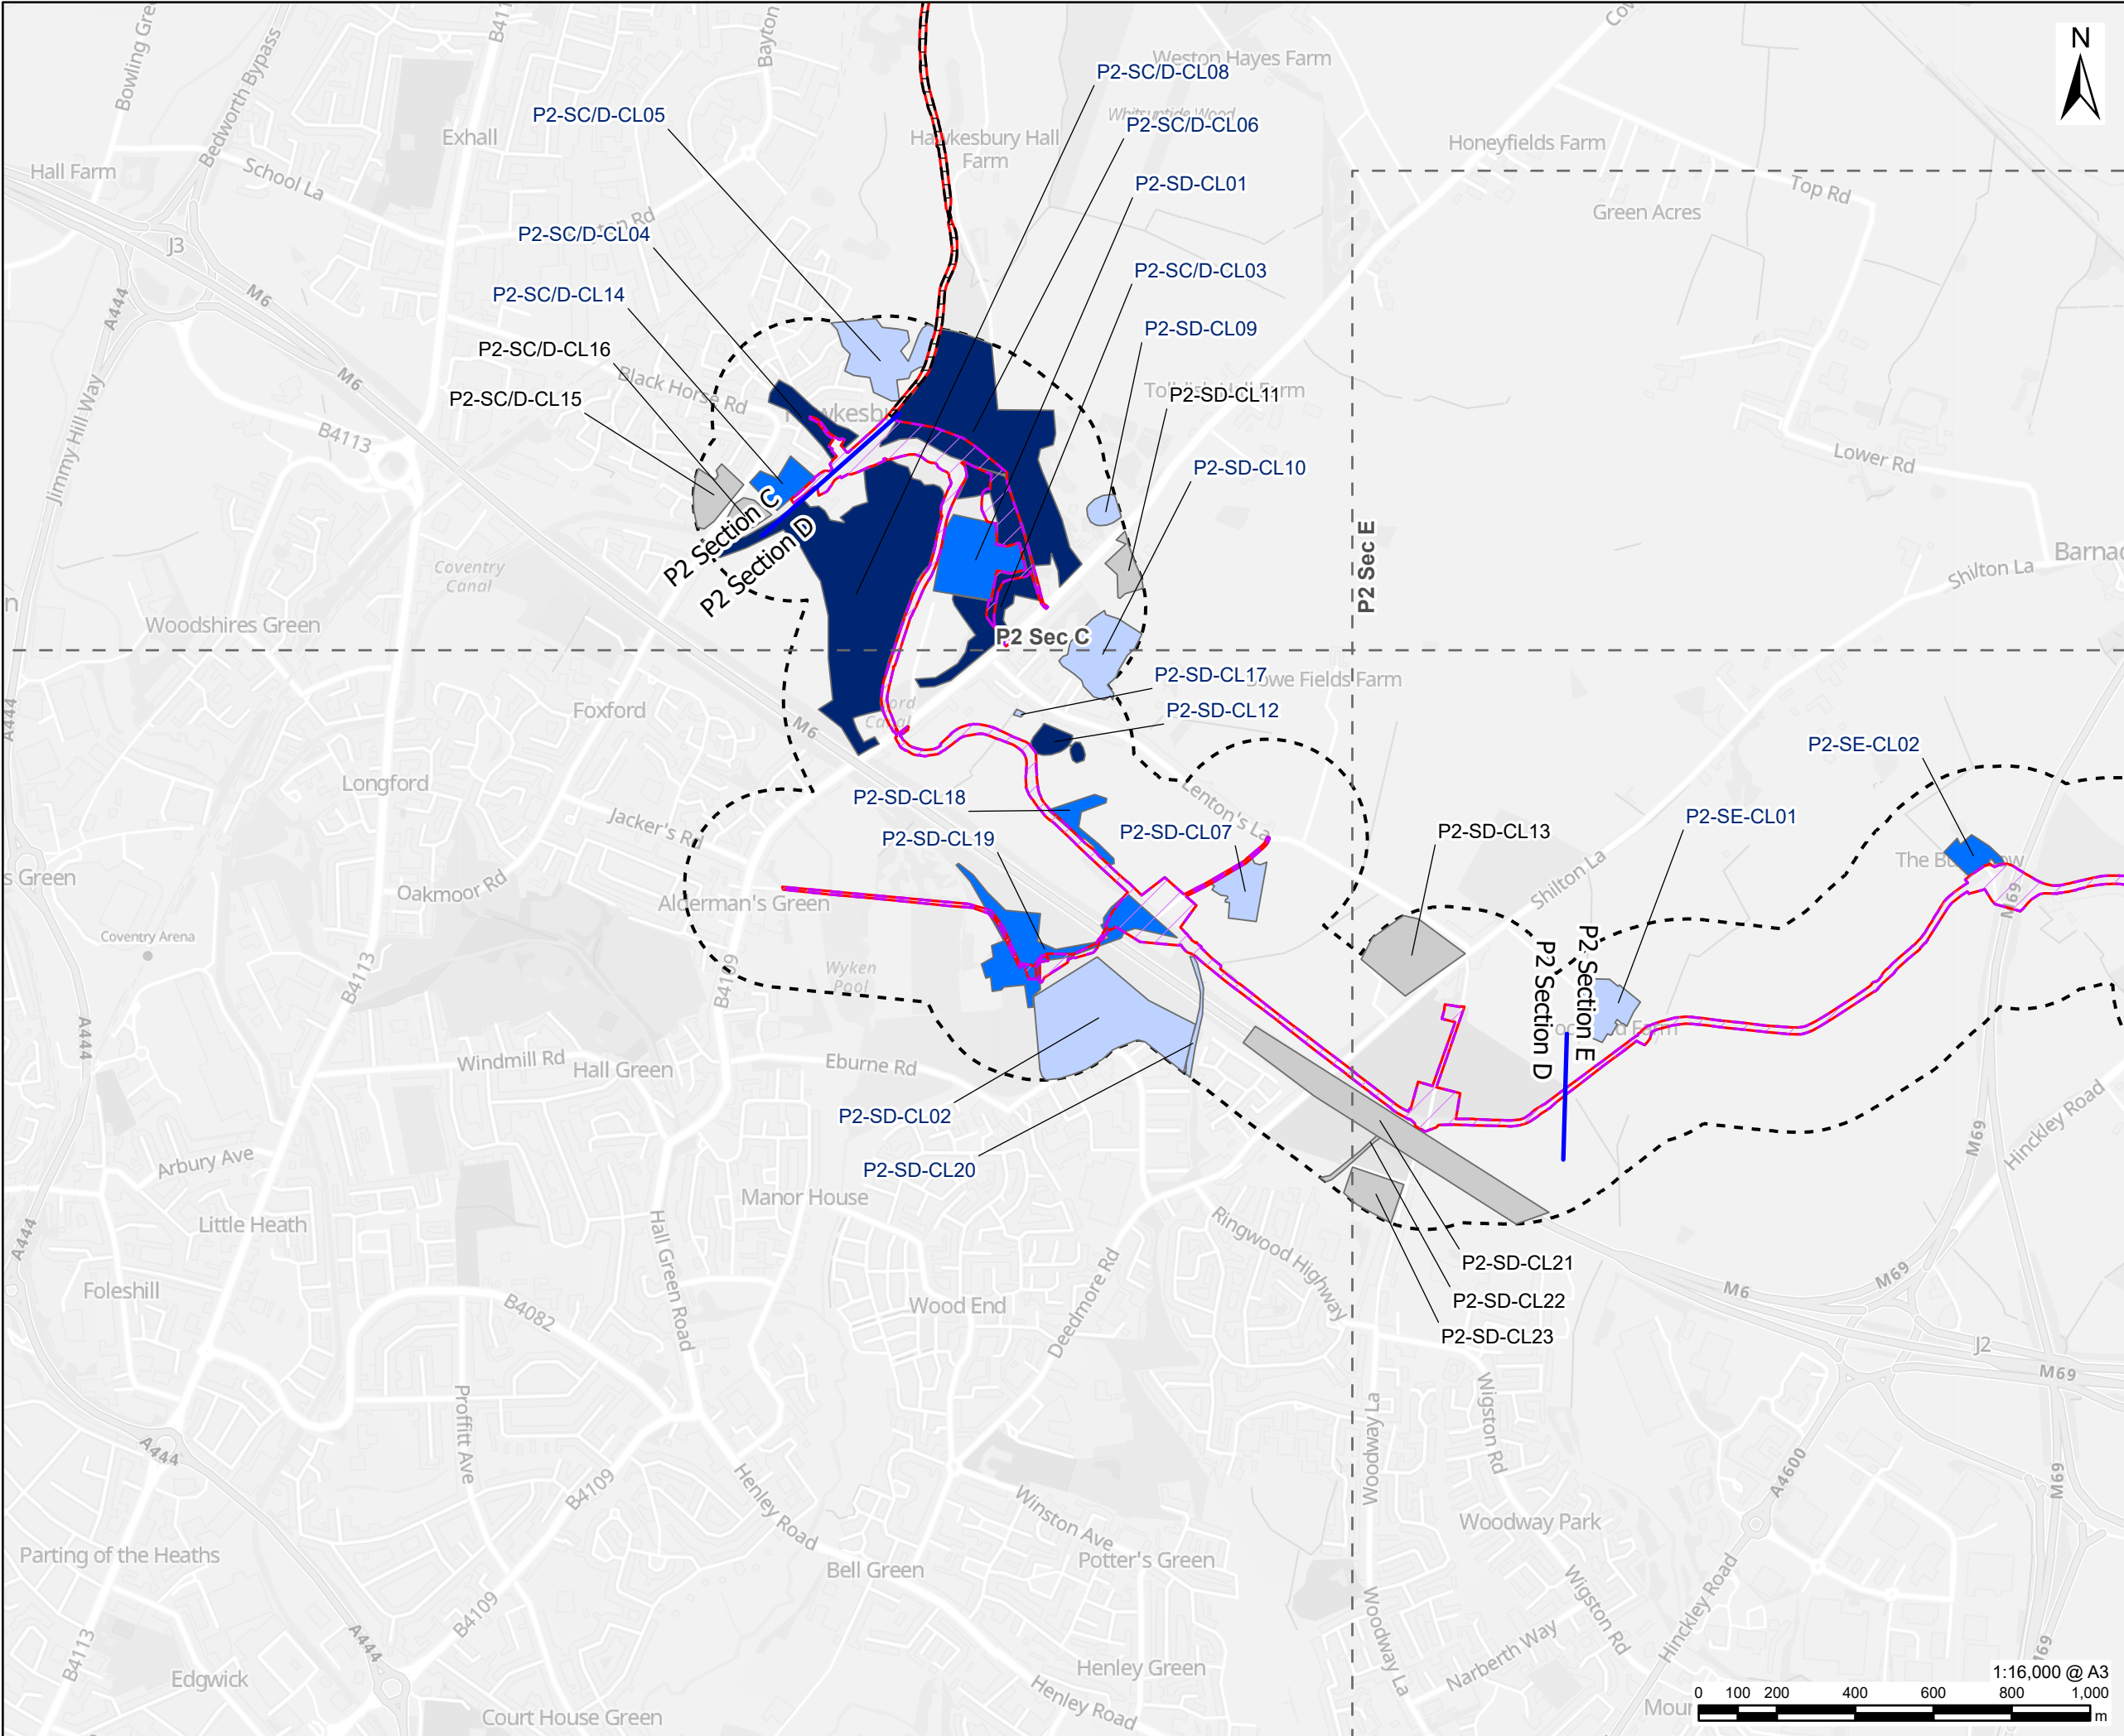

PROJECT

CLIENT

Affinity Water, Severn Trent Water and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Part 2 - Indicative Work Area
- Part 2 - Indicative Non-Work Area
- 250m Study Area for Geology, Land Contamination and Hydrogeology
- Preliminary Order Limits
- Sheet Extent
- Section Break

Contaminated Land Risk Rating

- 1 to 2 Potential Areas of Contamination not considered to pose an unacceptable risk
- 3 Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
- 4
- 5

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
3. Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE


Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec D

FIGURE NUMBER


Figure 14-PD-6

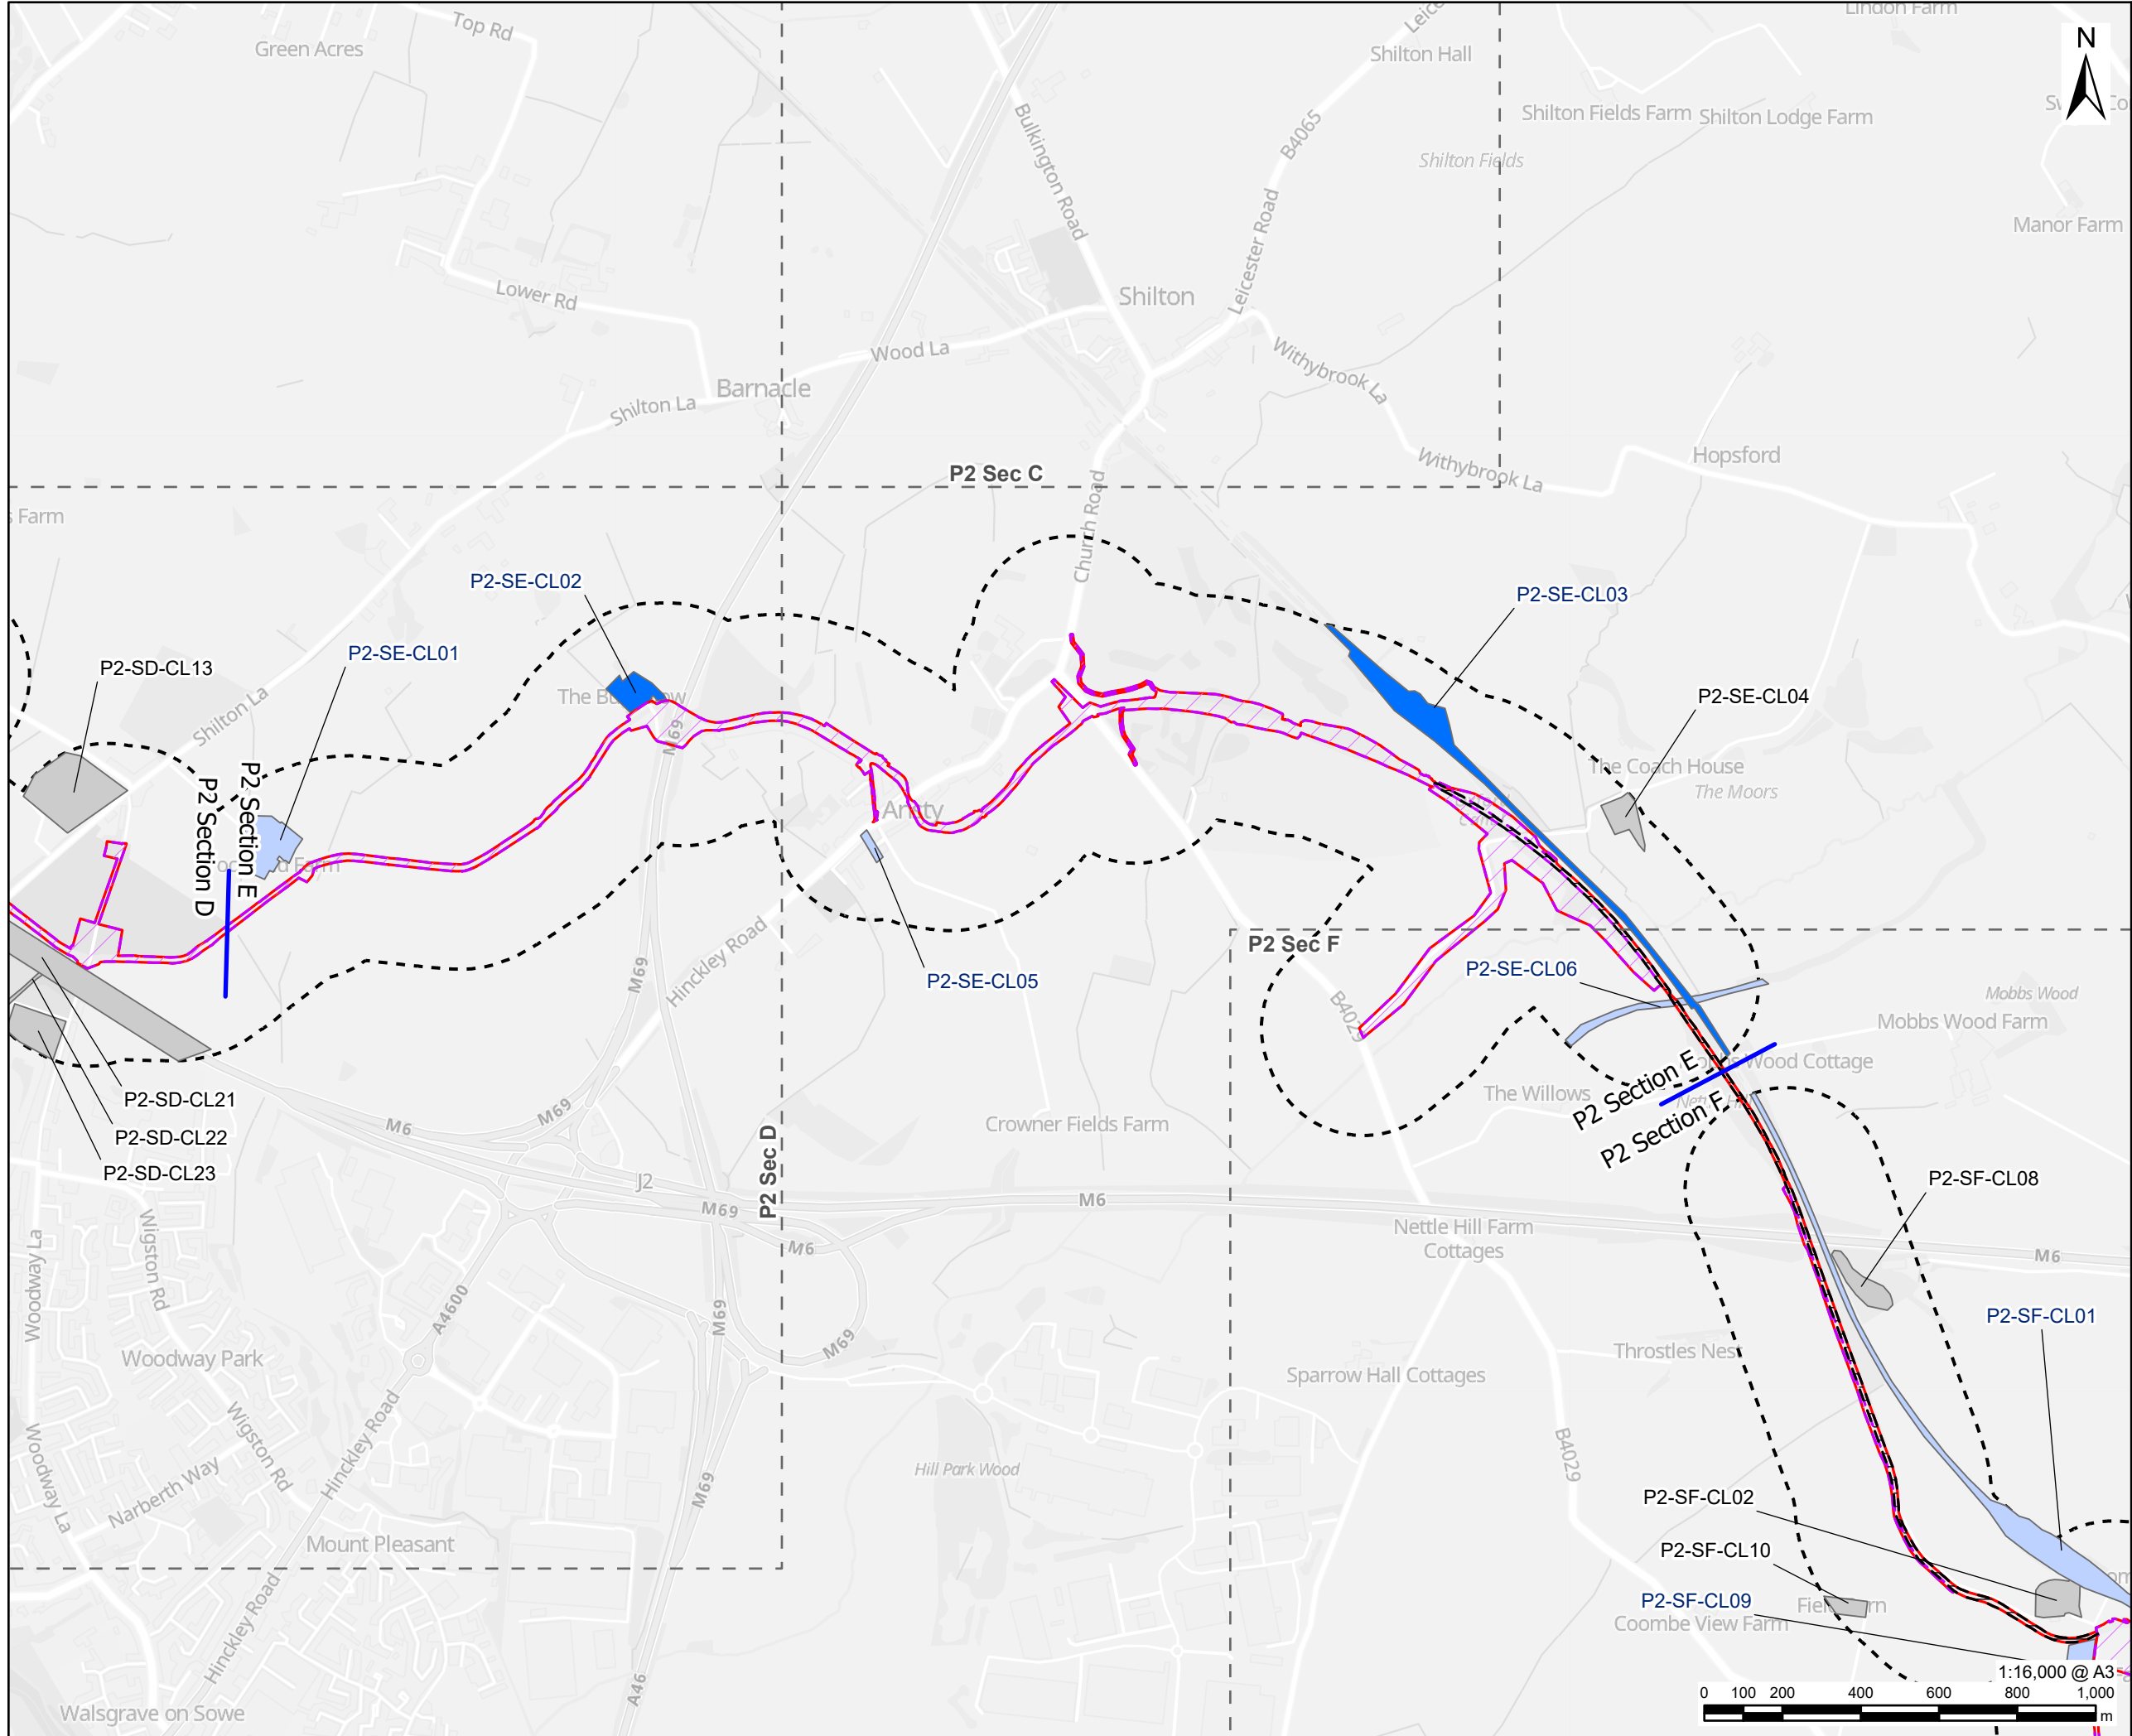

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

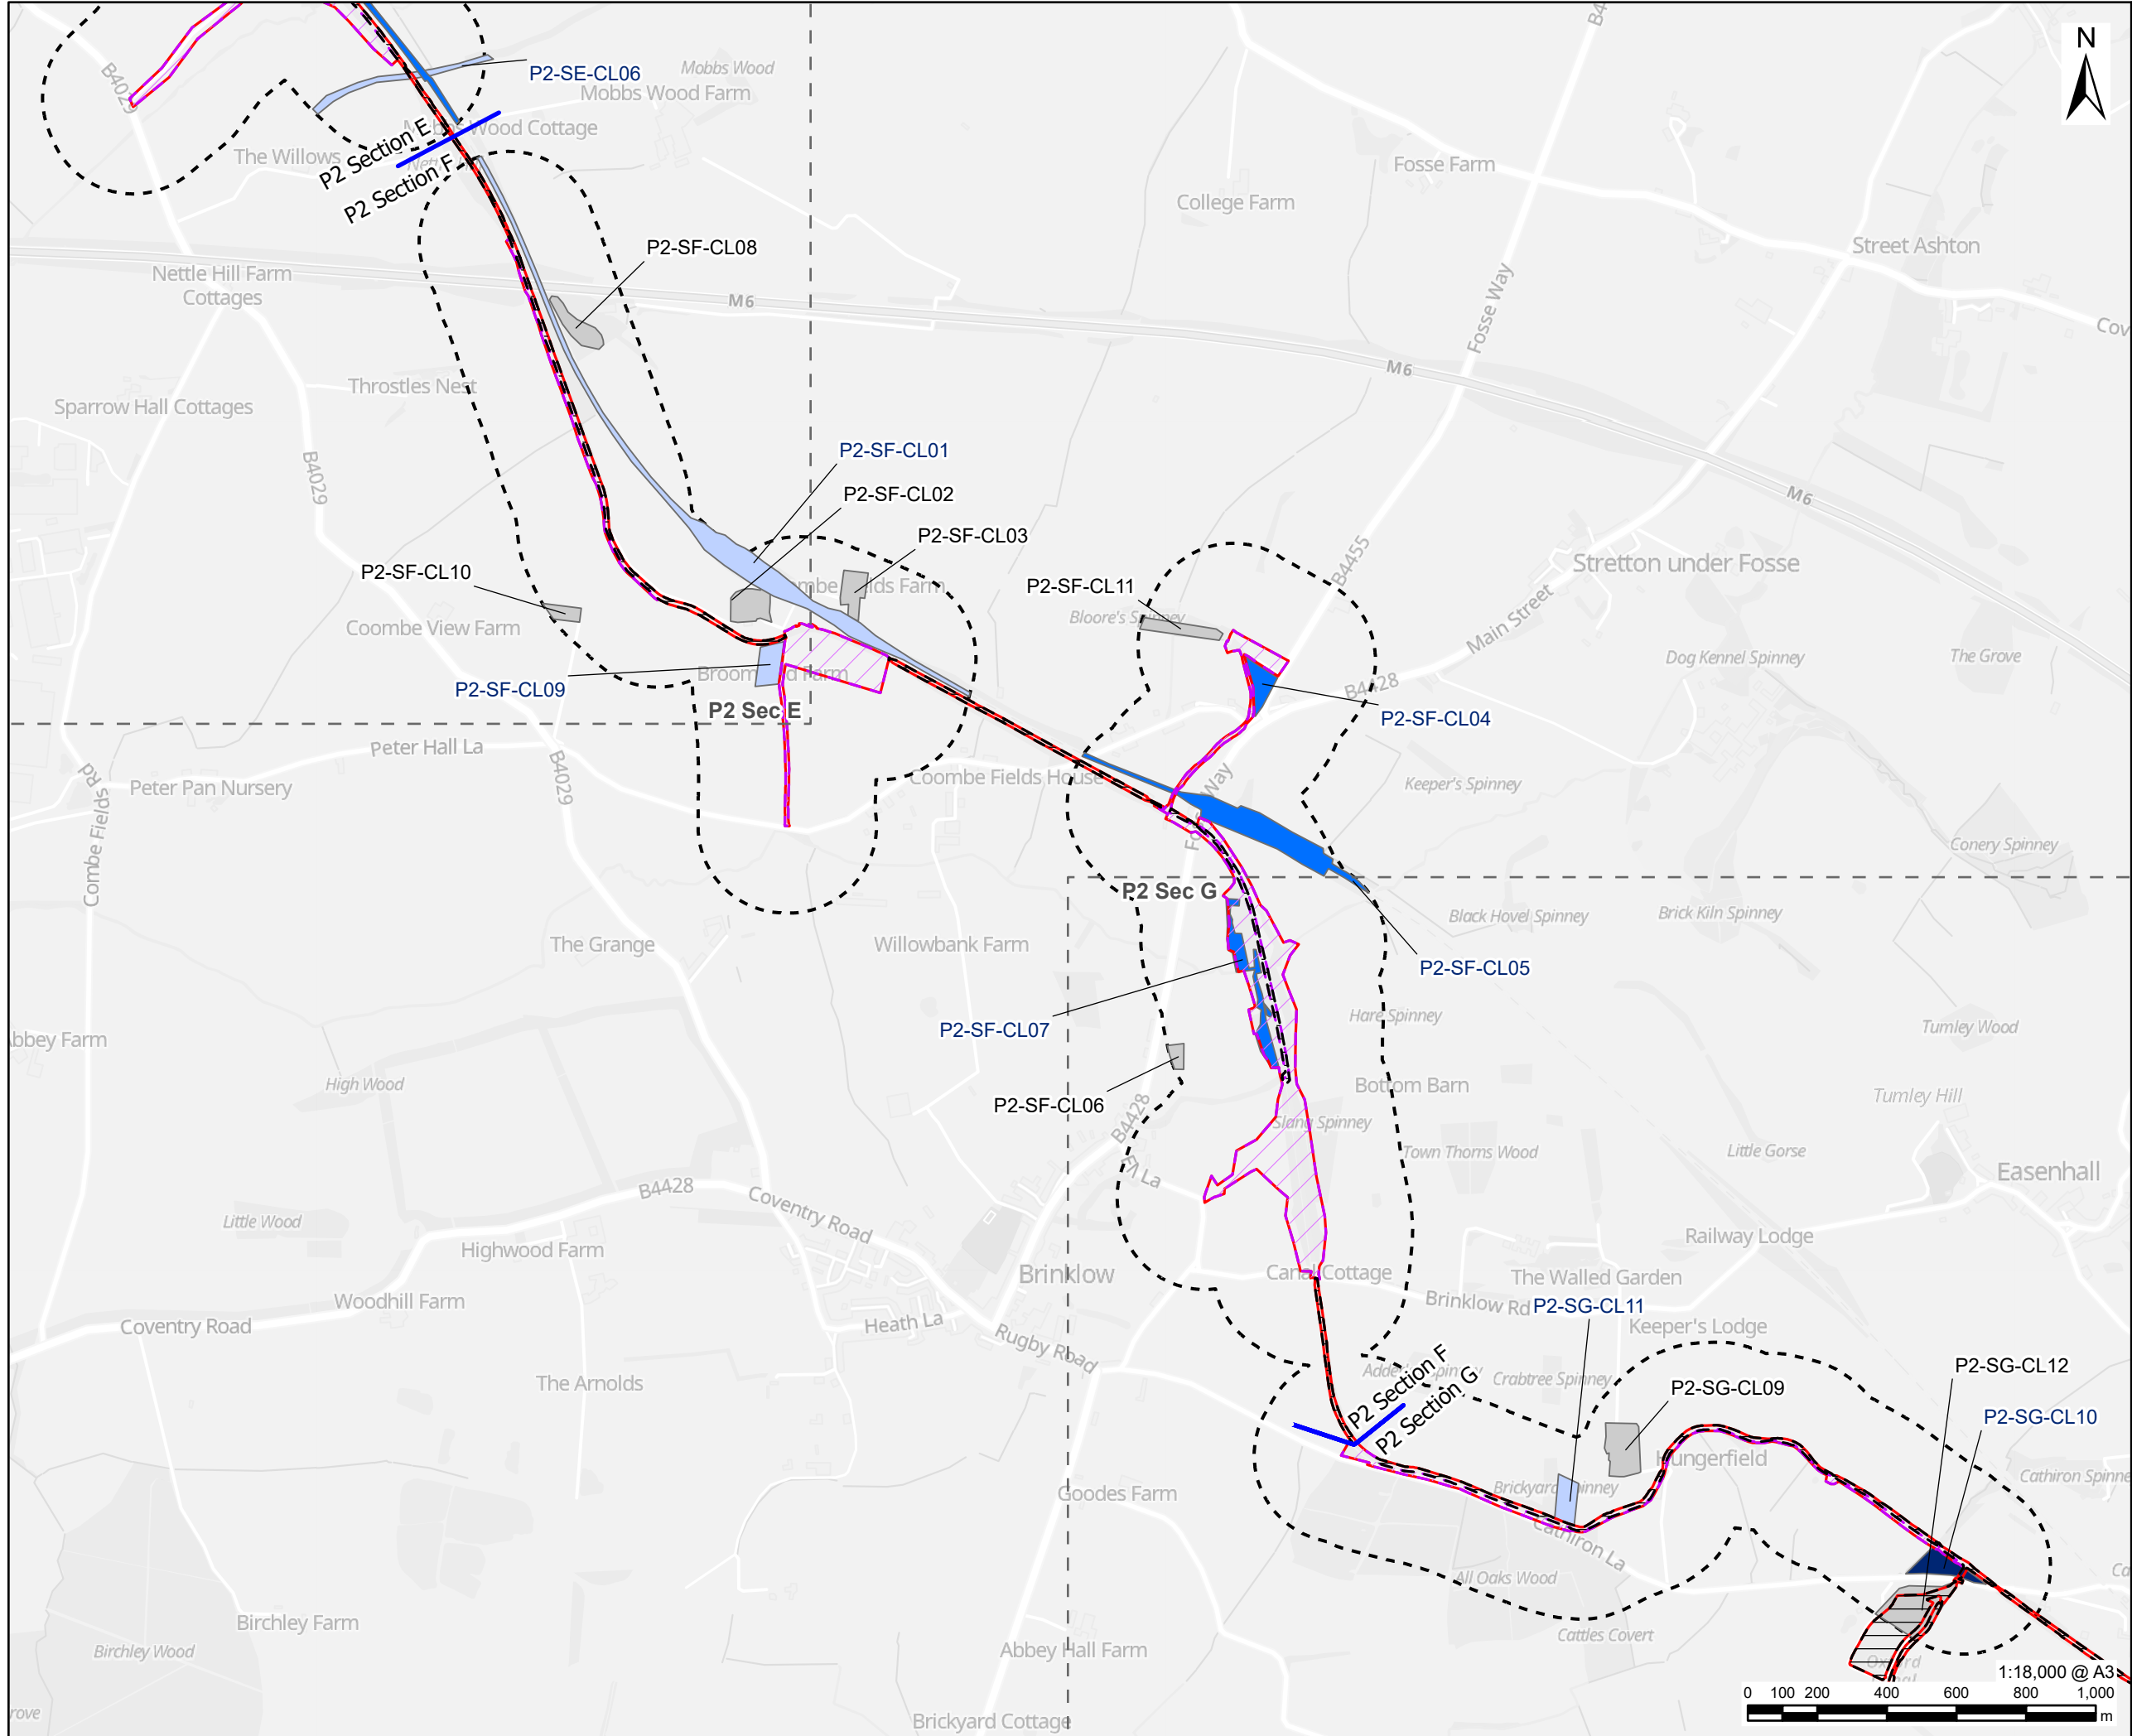

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

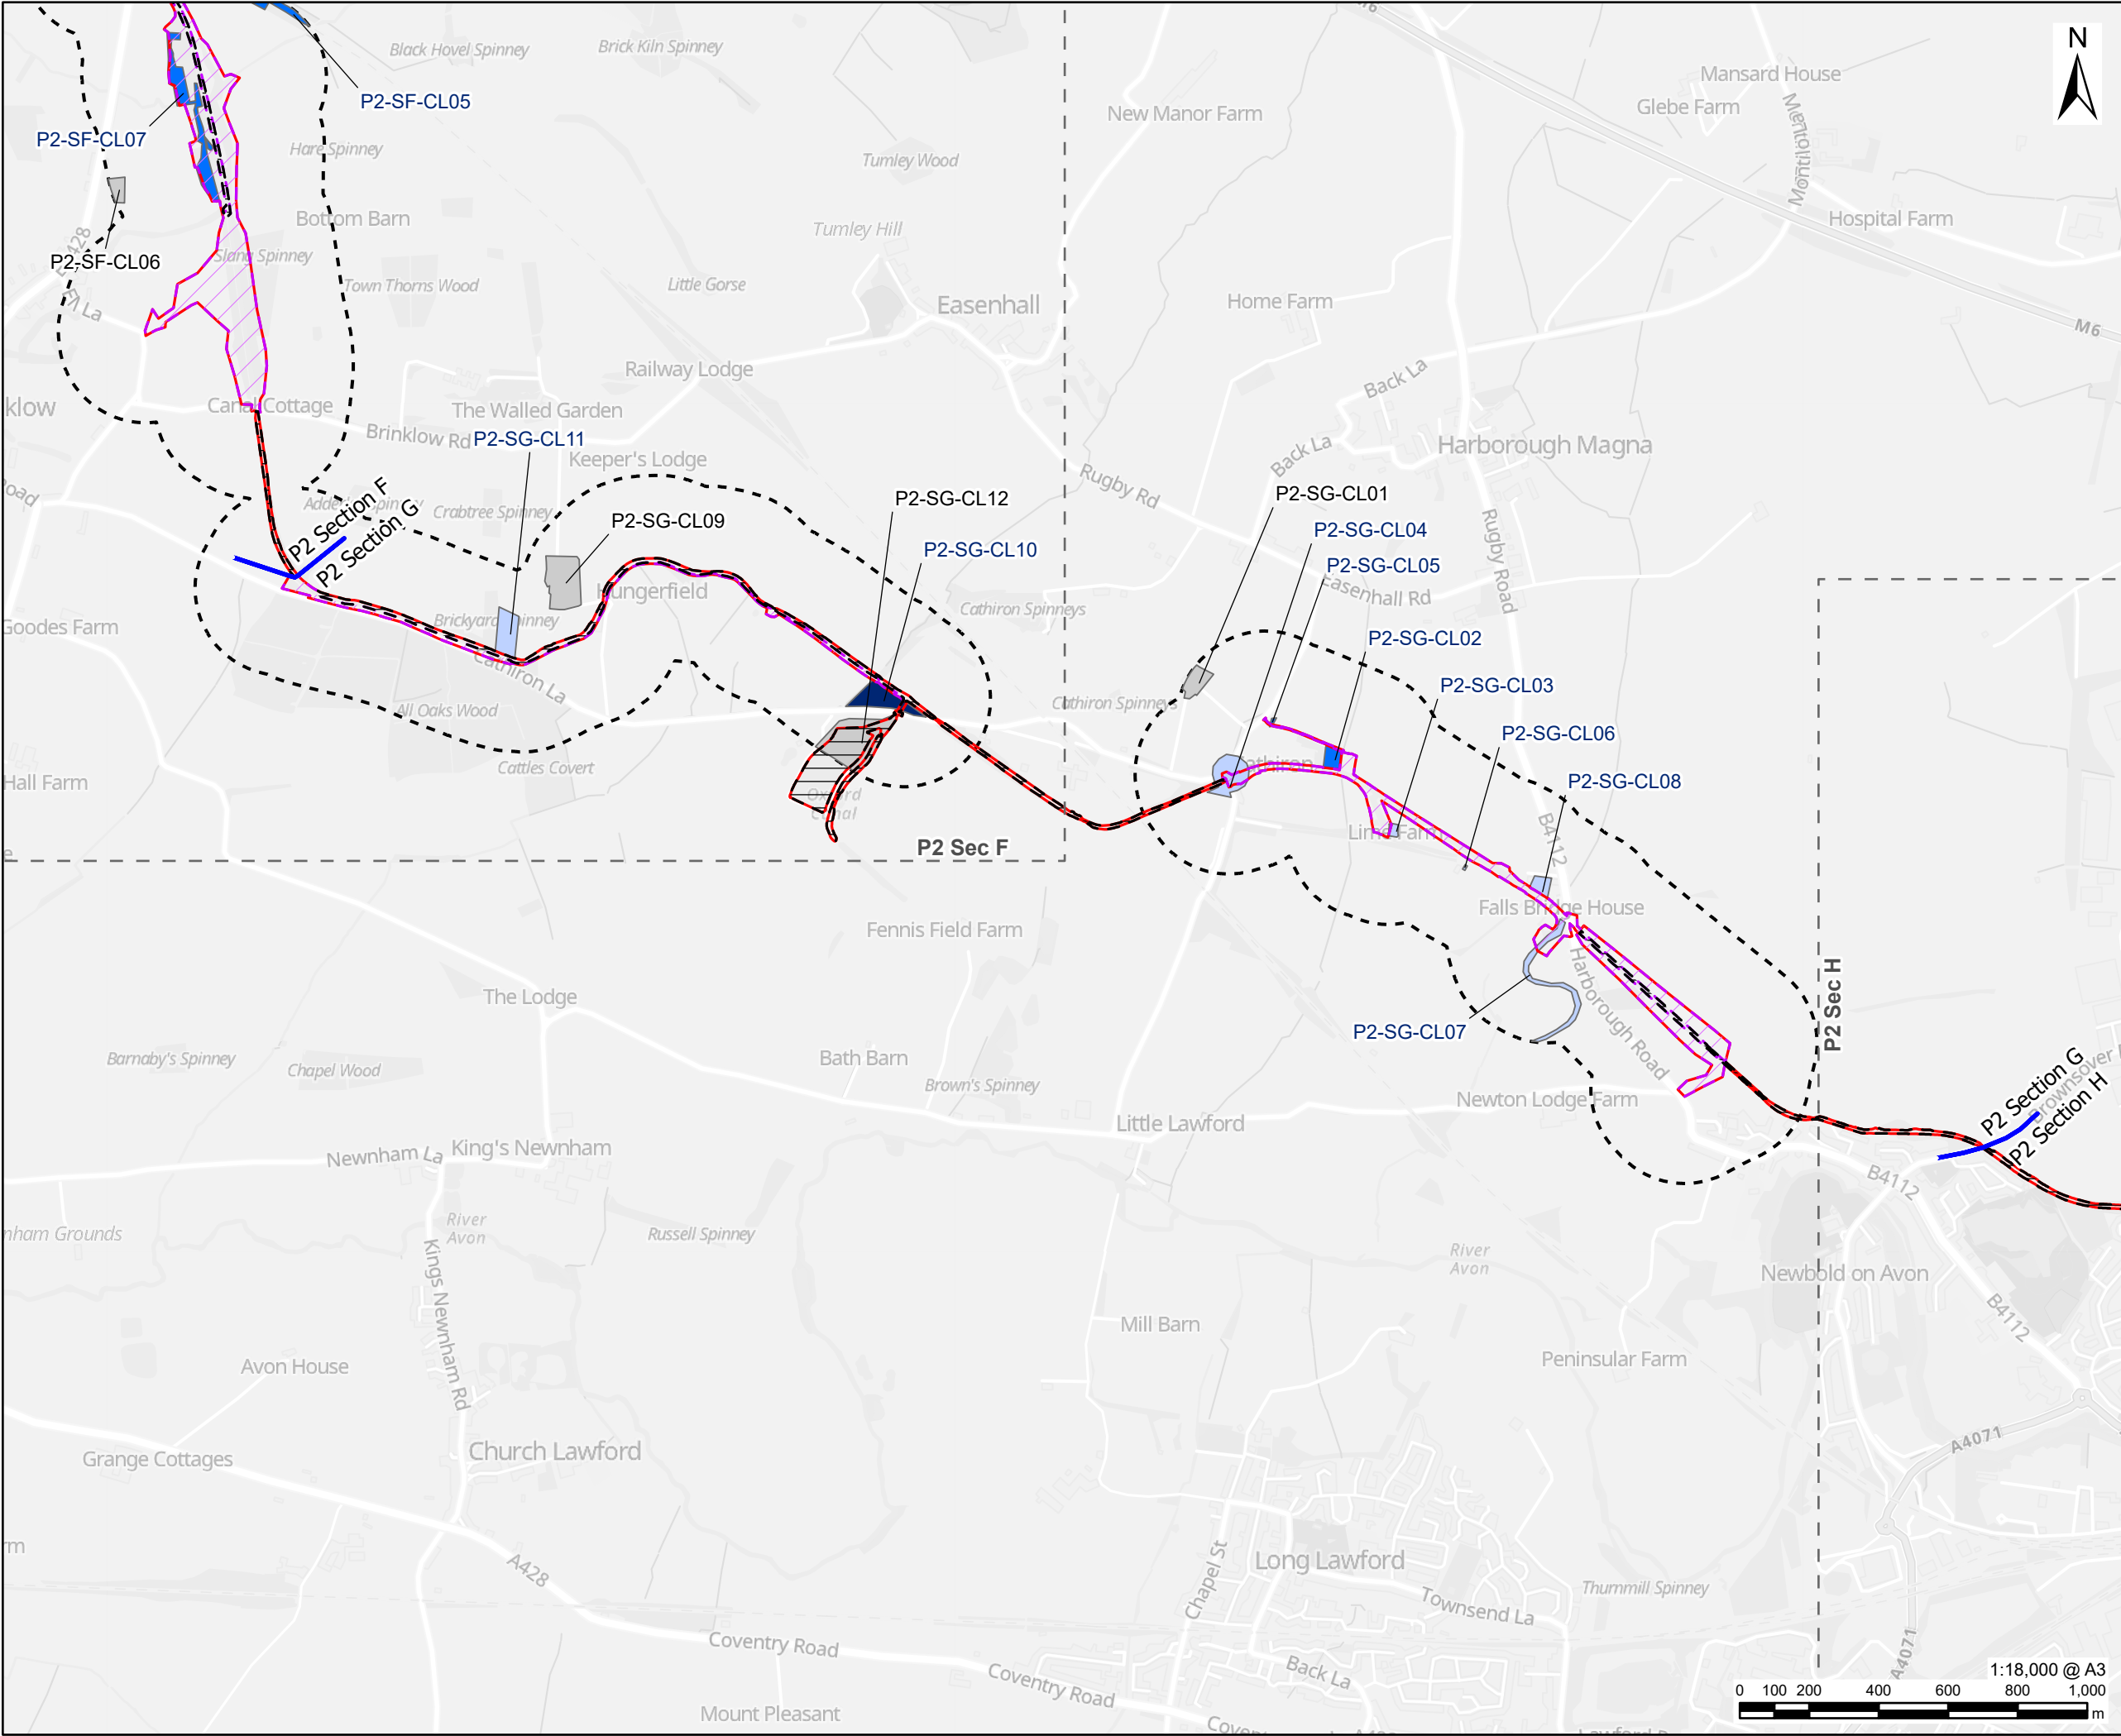

PROJECT

CLIENT

Affinity Water, Severn Trent Water and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Part 2 - Indicative Work Area
- Part 2 - Indicative Non-Work Area
- 250m Study Area for Geology, Land Contamination and Hydrogeology
- Preliminary Order Limits
- Sheet Extent
- Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
3. Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec G

FIGURE NUMBER

Figure 14-PD-6

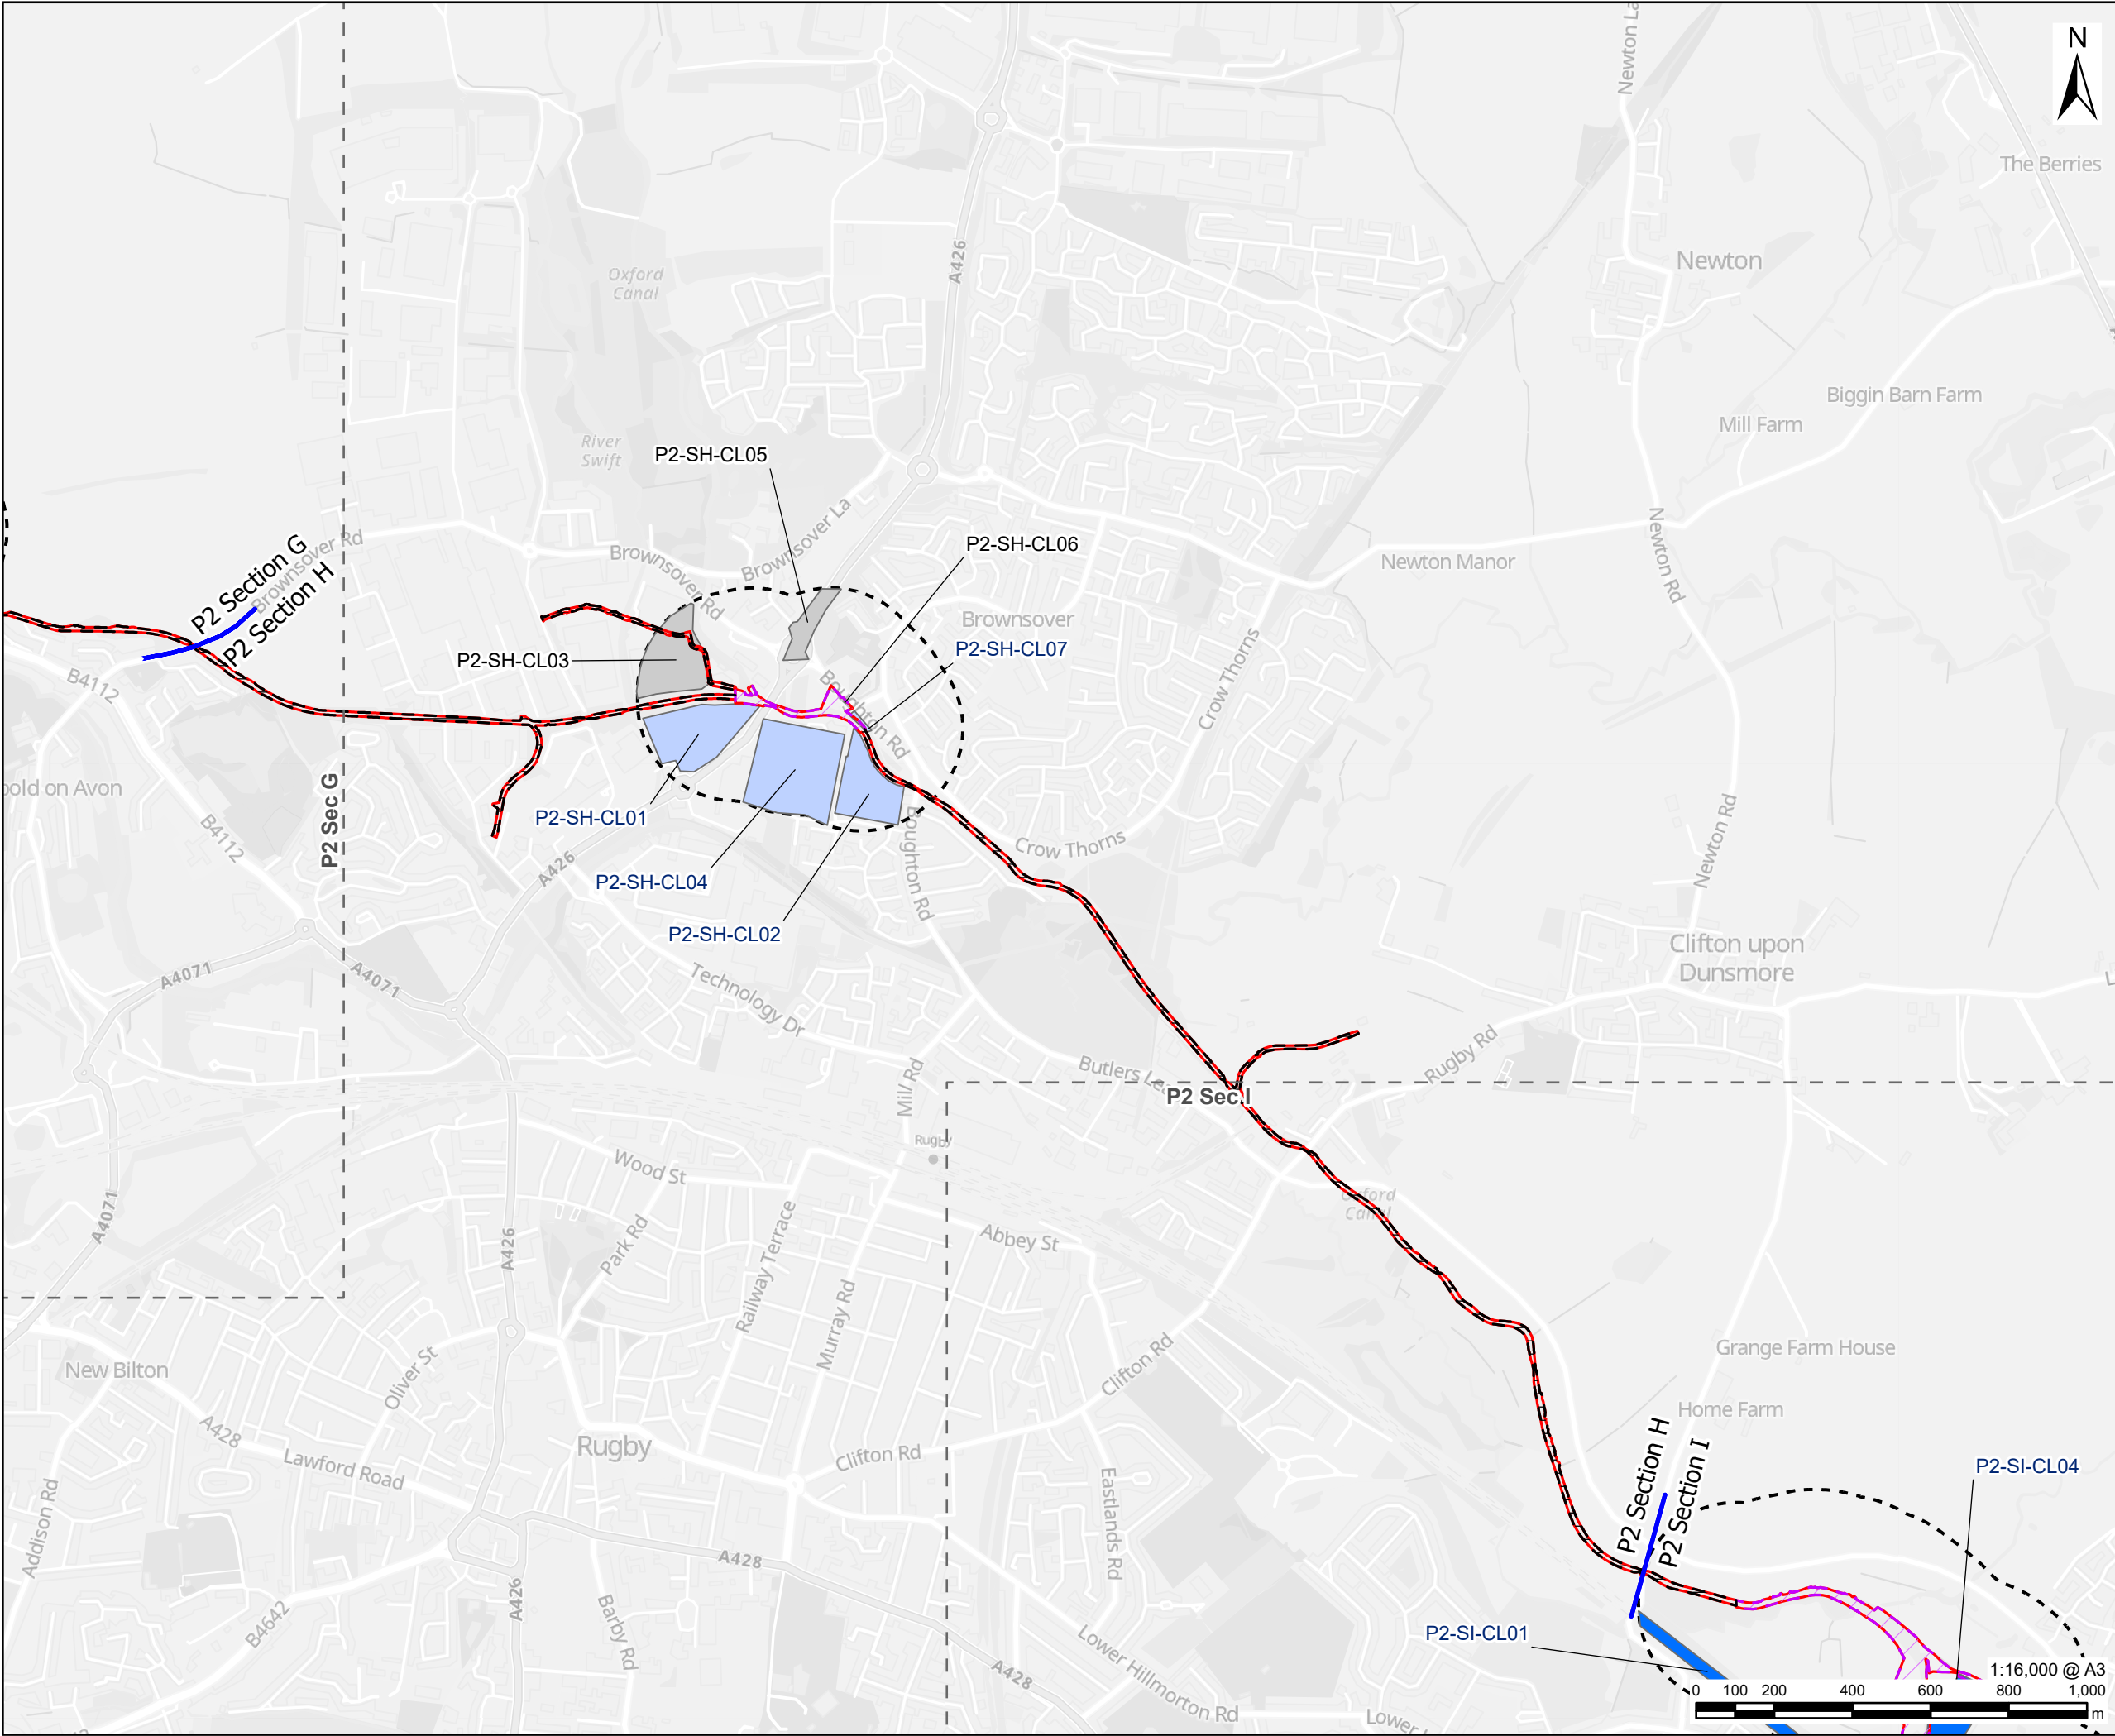

AECOM

PROJECT

Grand Union
Canal Transfer

CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

Part 2 - Indicative Work Area

Part 2 - Indicative Non-Work Area

250m Study Area for Geology, Land
Contamination and Hydrogeology

Preliminary Order Limits

Sheet Extent

Section Break

Contaminated Land Risk Rating

1 to 2 Potential Areas of
Contamination not
considered to pose an
unacceptable risk

3 Potential Areas of
Contamination considered to
pose an unacceptable risk
that will be taken through to
further assessment

4

5

NOTES

1. Reproduced from Ordnance Survey digital map data ©
Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right
2025
Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and
database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432


FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of
Contamination
Sheet P2 Sec H

FIGURE NUMBER

Figure 14-PD-6



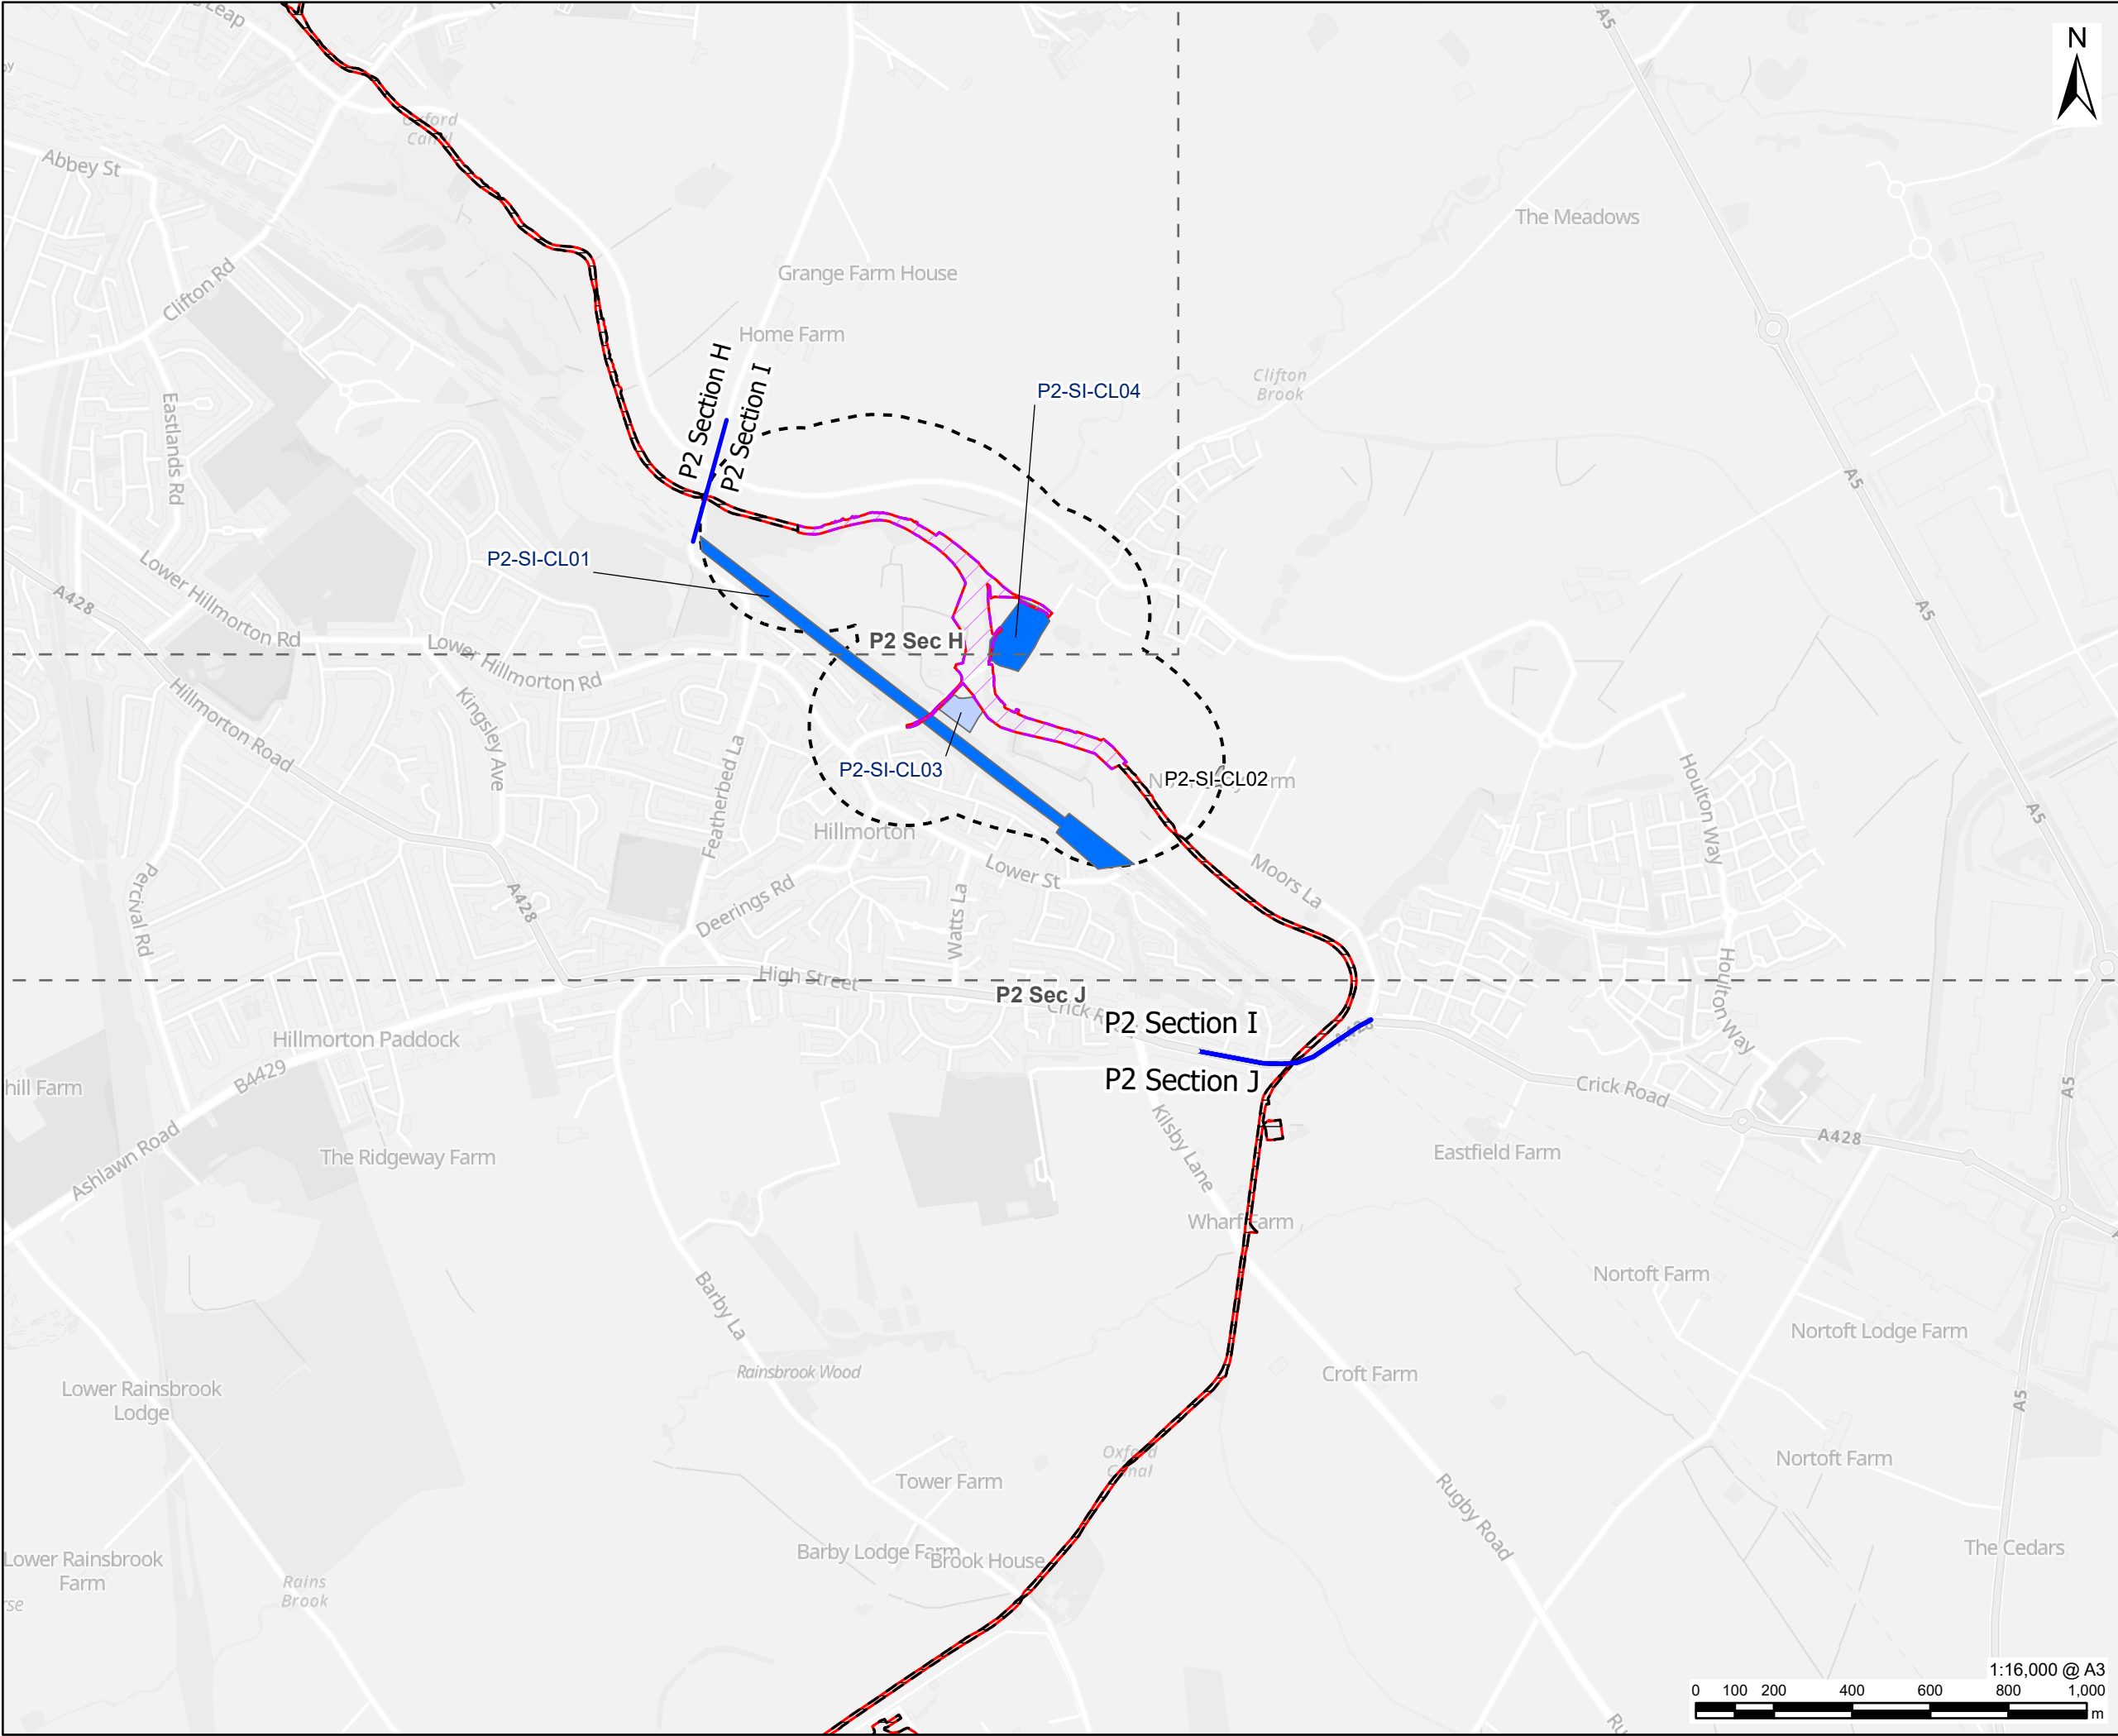

AECOM

PROJECT

 Grand Union Canal Transfer

CLIENT

Affinity Water, Severn Trent Water and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

- LEGEND
-  Part 2 - Indicative Work Area

 Part 2 - Indicative Non-Work Area

 250m Study Area for Geology, Land Contamination and Hydrogeology

 Preliminary Order Limits

 Sheet Extent

 Section Break

- Contaminated Land Risk Rating
-  1 to 2

Potential Areas of Contamination not considered to pose an unacceptable risk
-  3

 4

 5

Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER

60720432

FIGURE TITLE


Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec I

FIGURE NUMBER

Figure 14-PD-6



This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

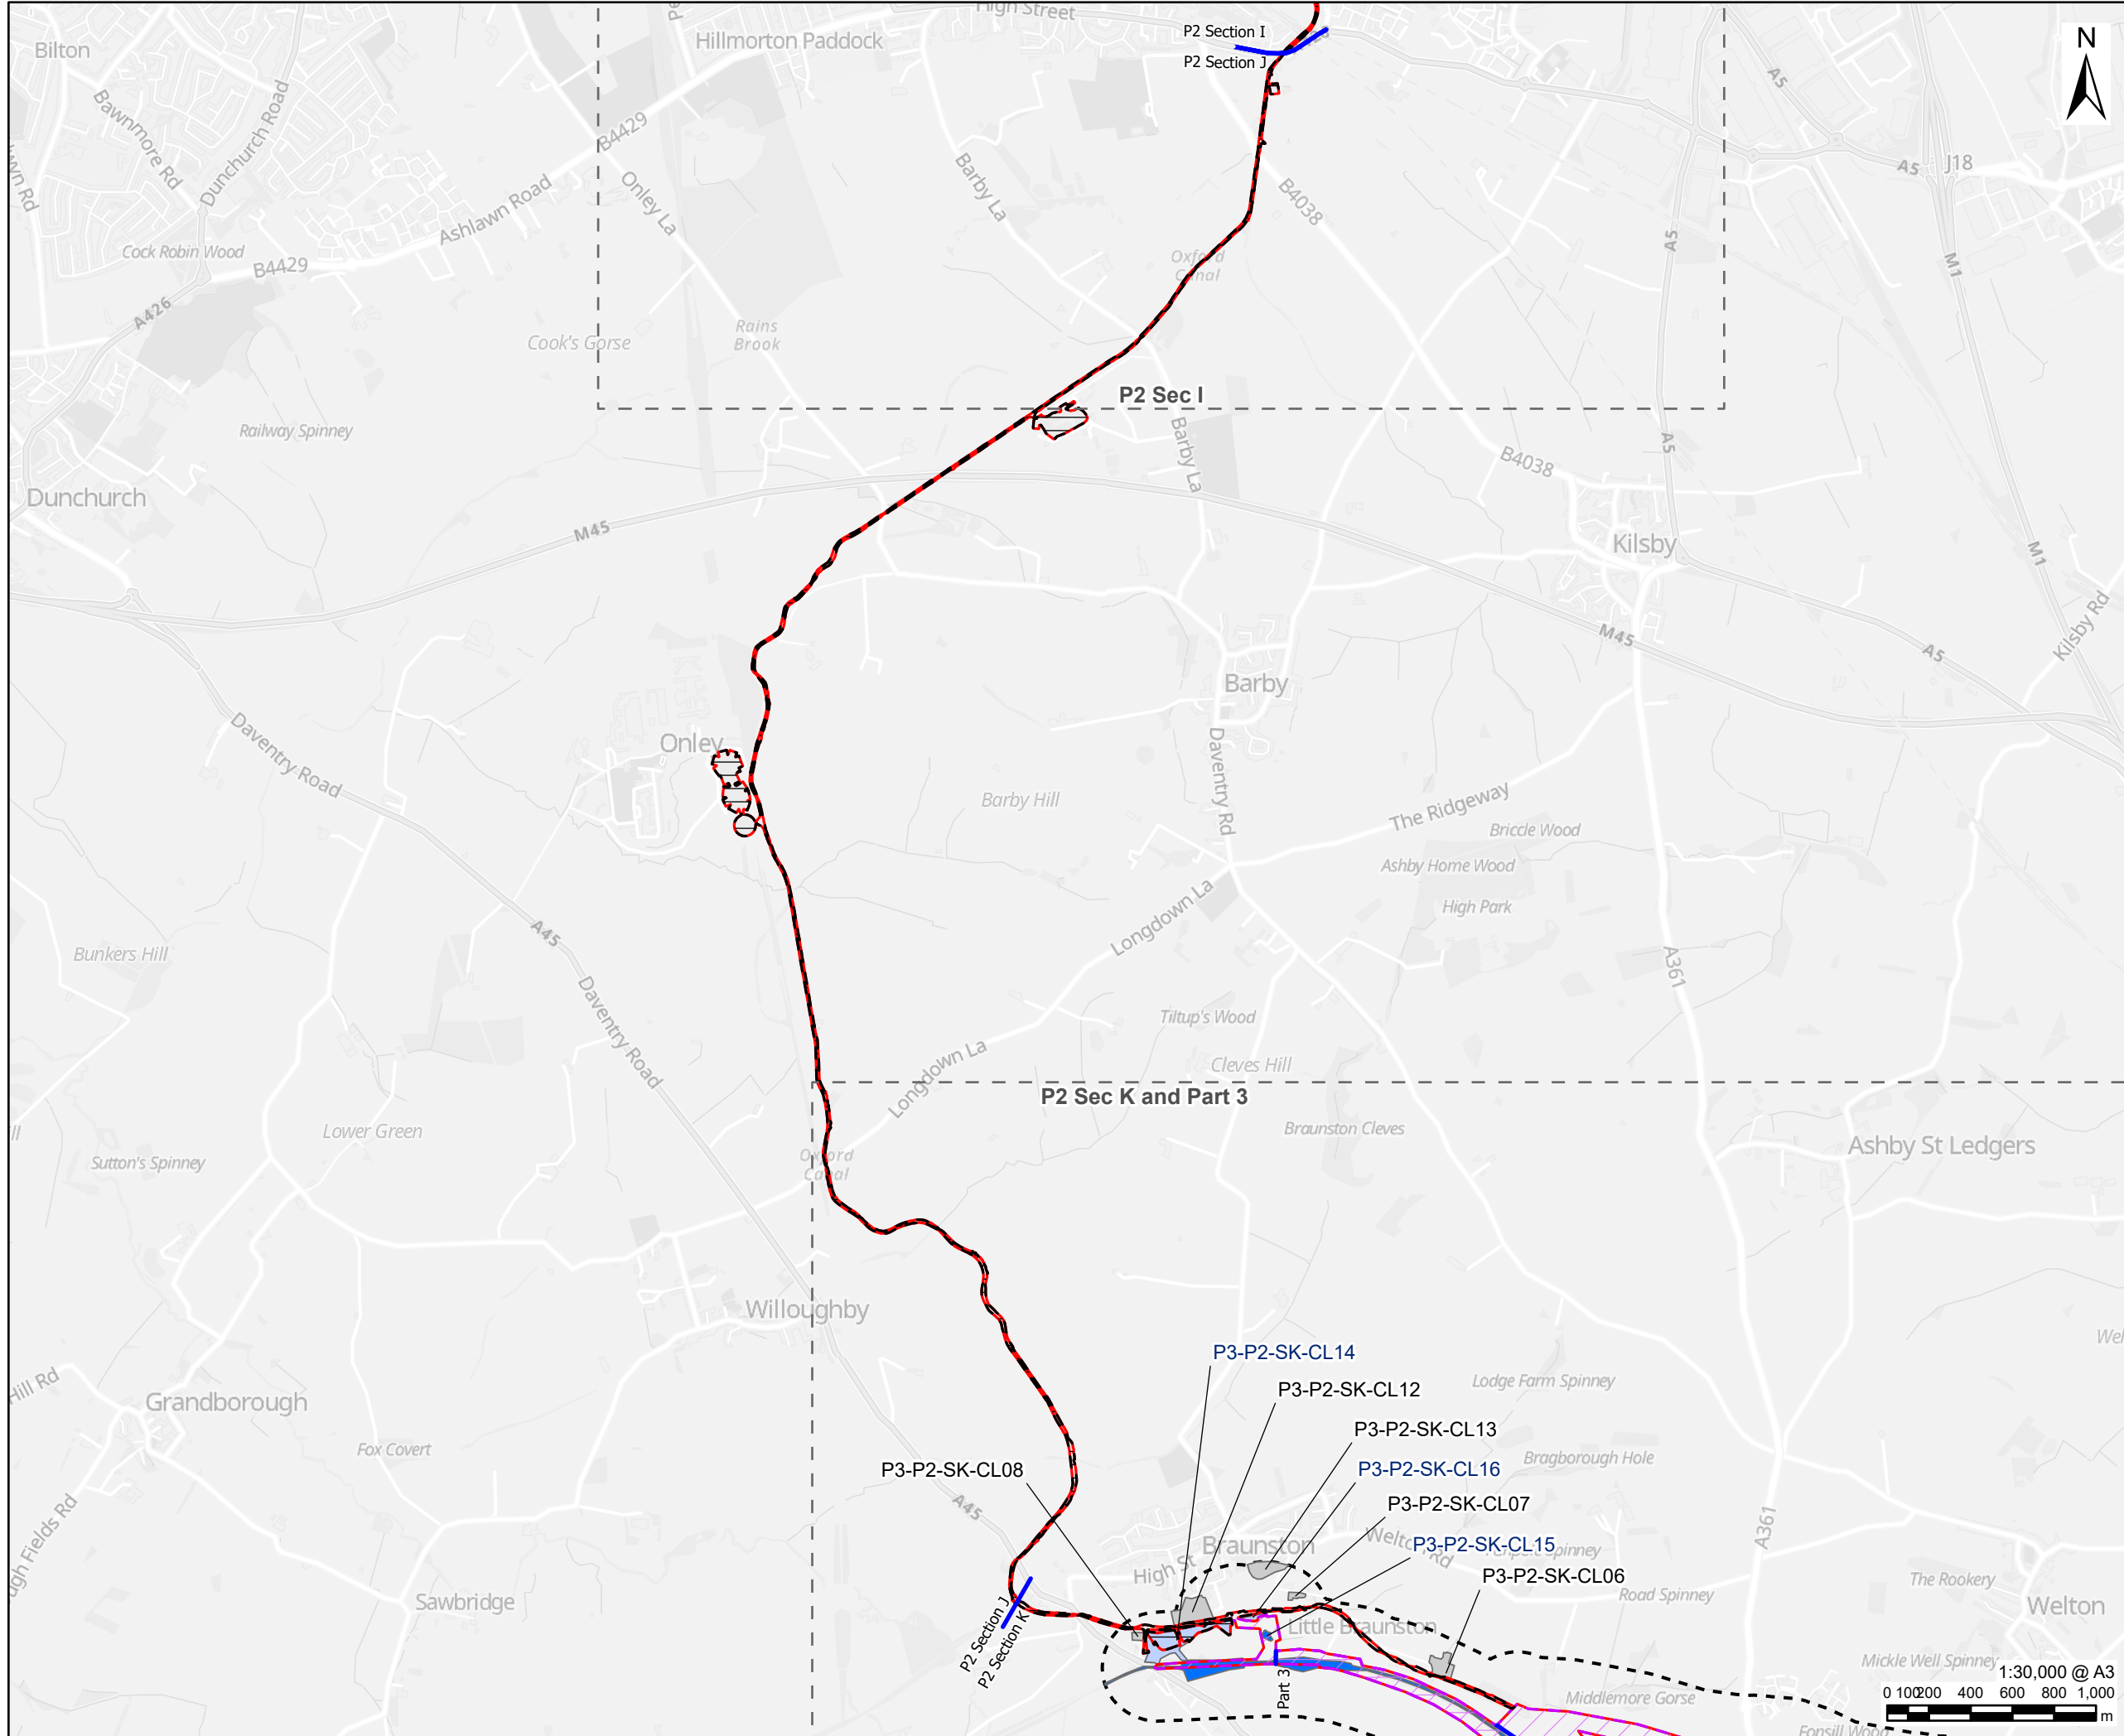

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM, or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

	Part 2 - Indicative Work Area
	Part 2 - Indicative Non-Work Area
	Part 3 - Indicative Work Area
	250m Study Area for Geology, Land Contamination and Hydrogeology
	Preliminary Order Limits
	Sheet Extent
	Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025

Contains data from OS Zoomstack

3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec J

FIGURE NUMBER

Figure 14-PD-6

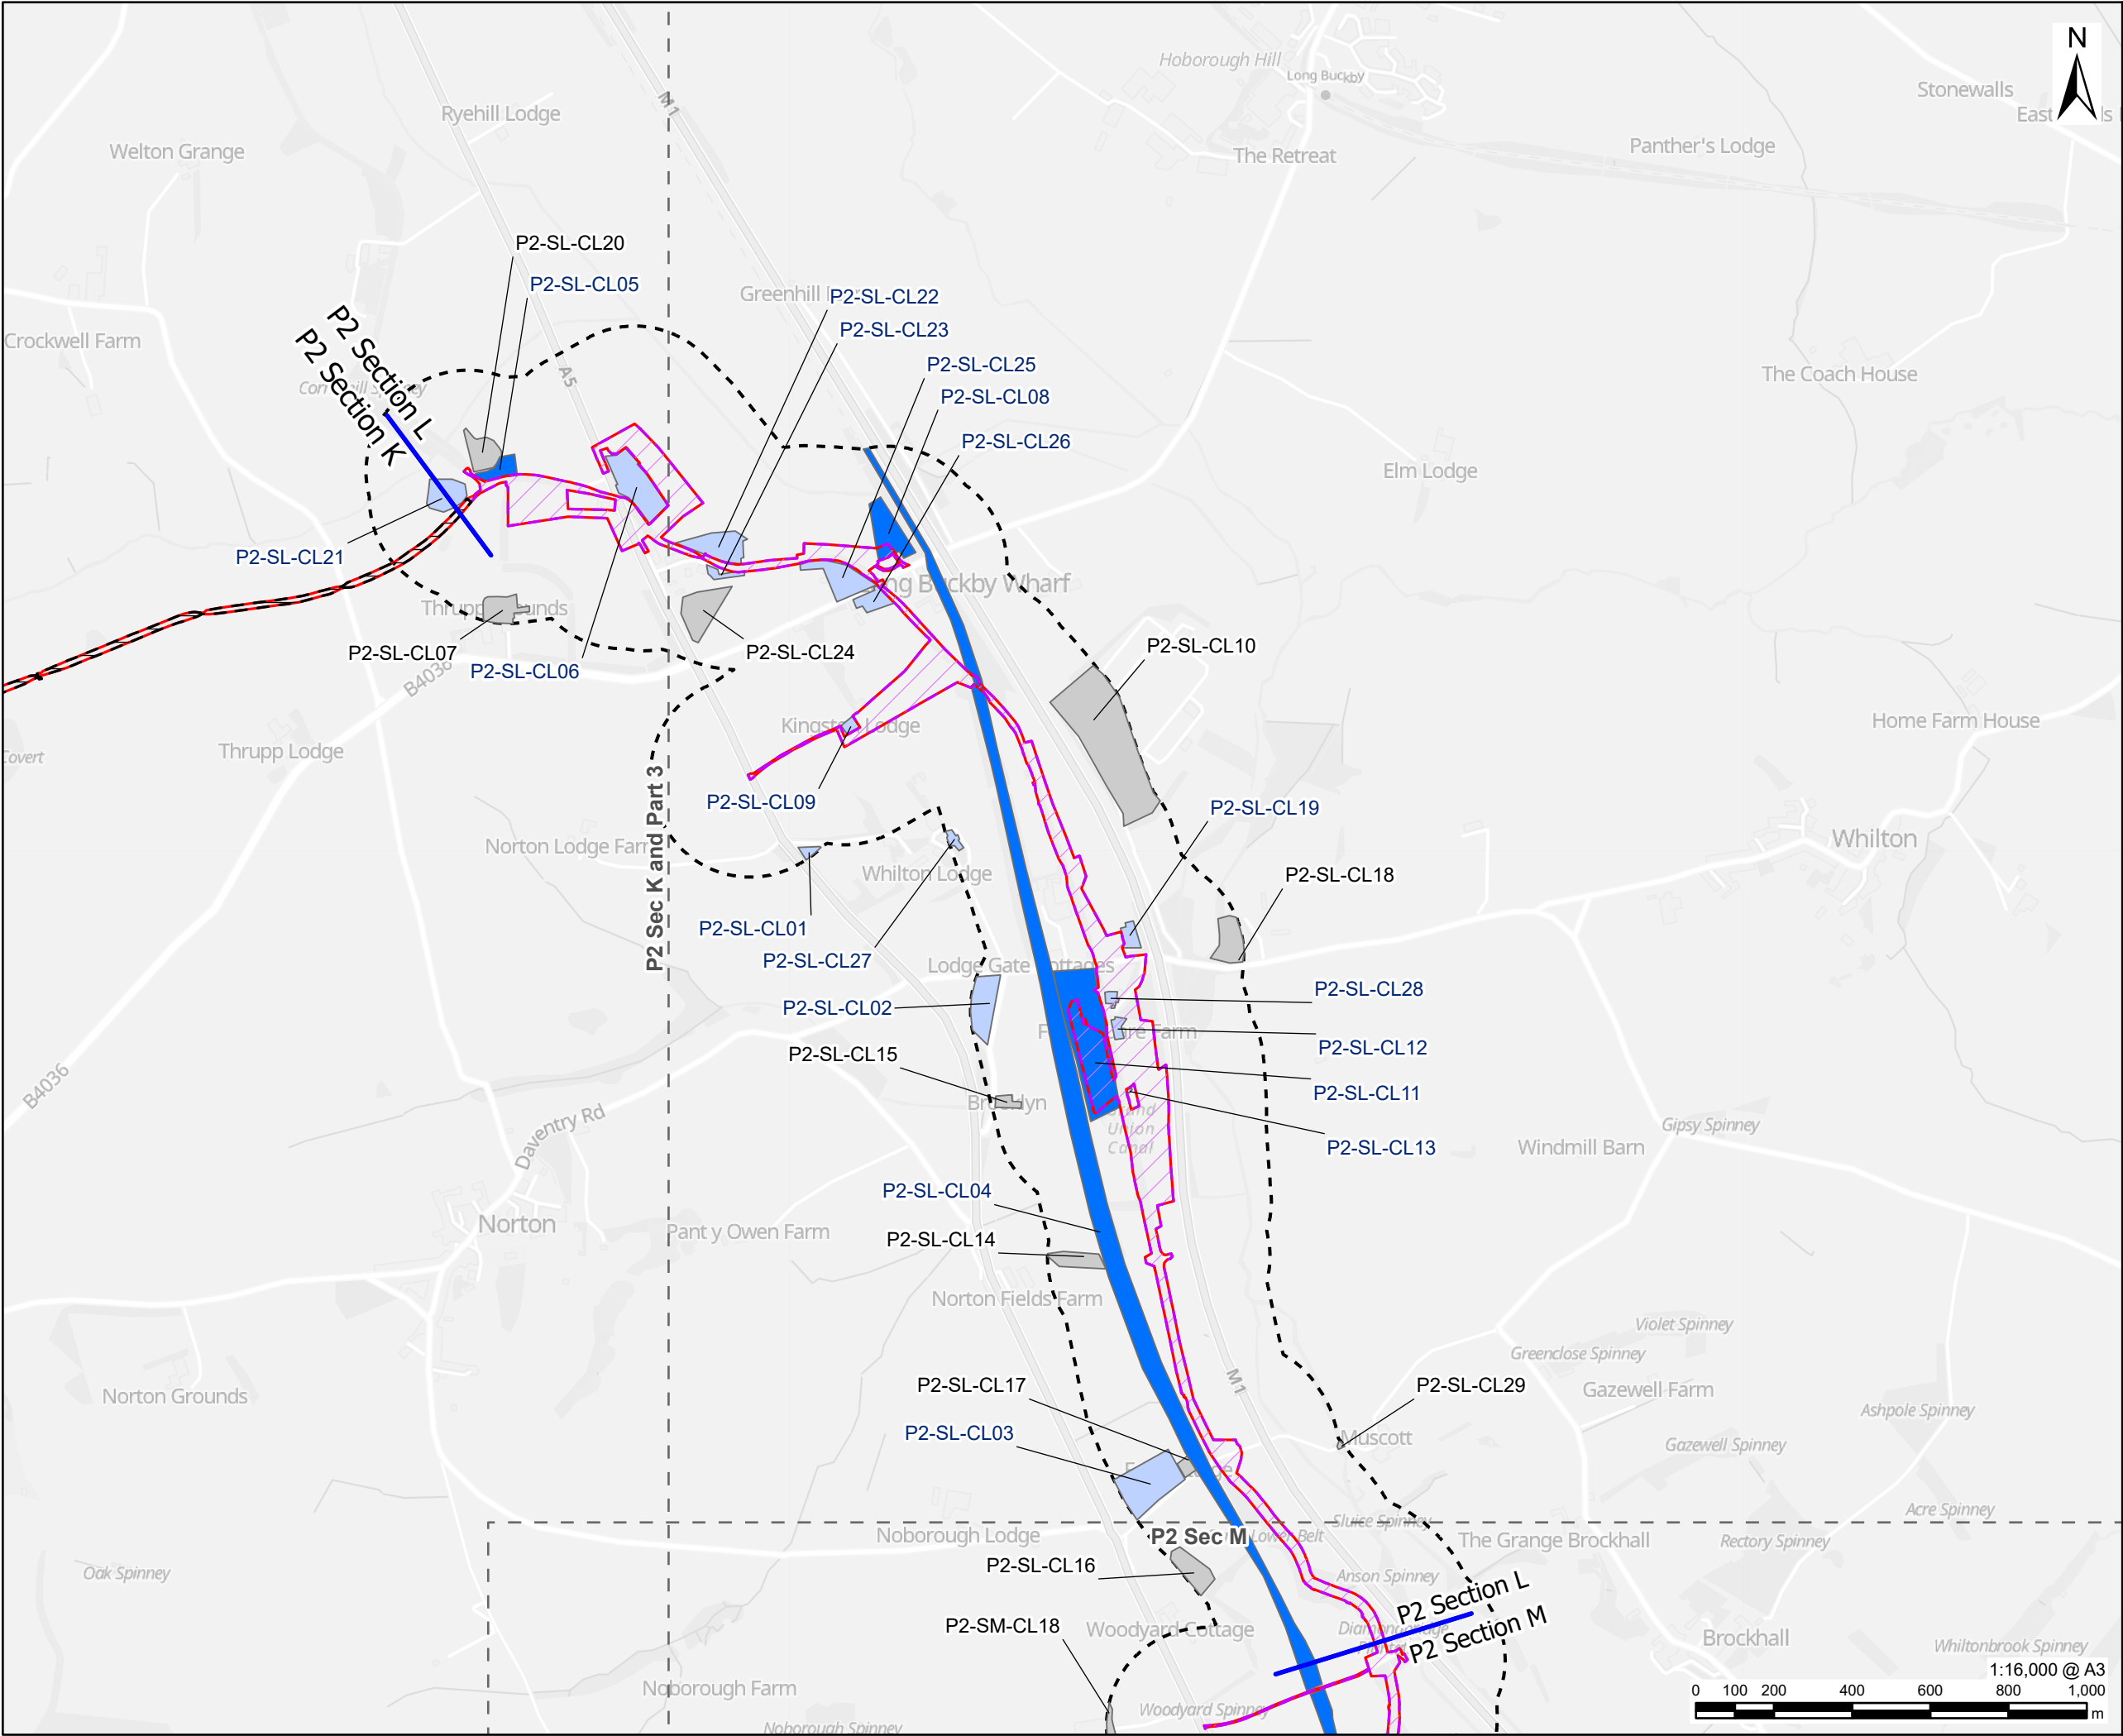

AECOM

PROJECT

Grand Union Canal Transfer

CLIENT

Affinity Water, Severn Trent Water and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Part 2 - Indicative Work Area
- Part 2 - Indicative Non-Work Area
- 250m Study Area for Geology, Land Contamination and Hydrogeology
- Preliminary Order Limits
- Sheet Extent
- Section Break

Contaminated Land Risk Rating

1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
4	
5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432


FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec L

FIGURE NUMBER

Figure 14-PD-6

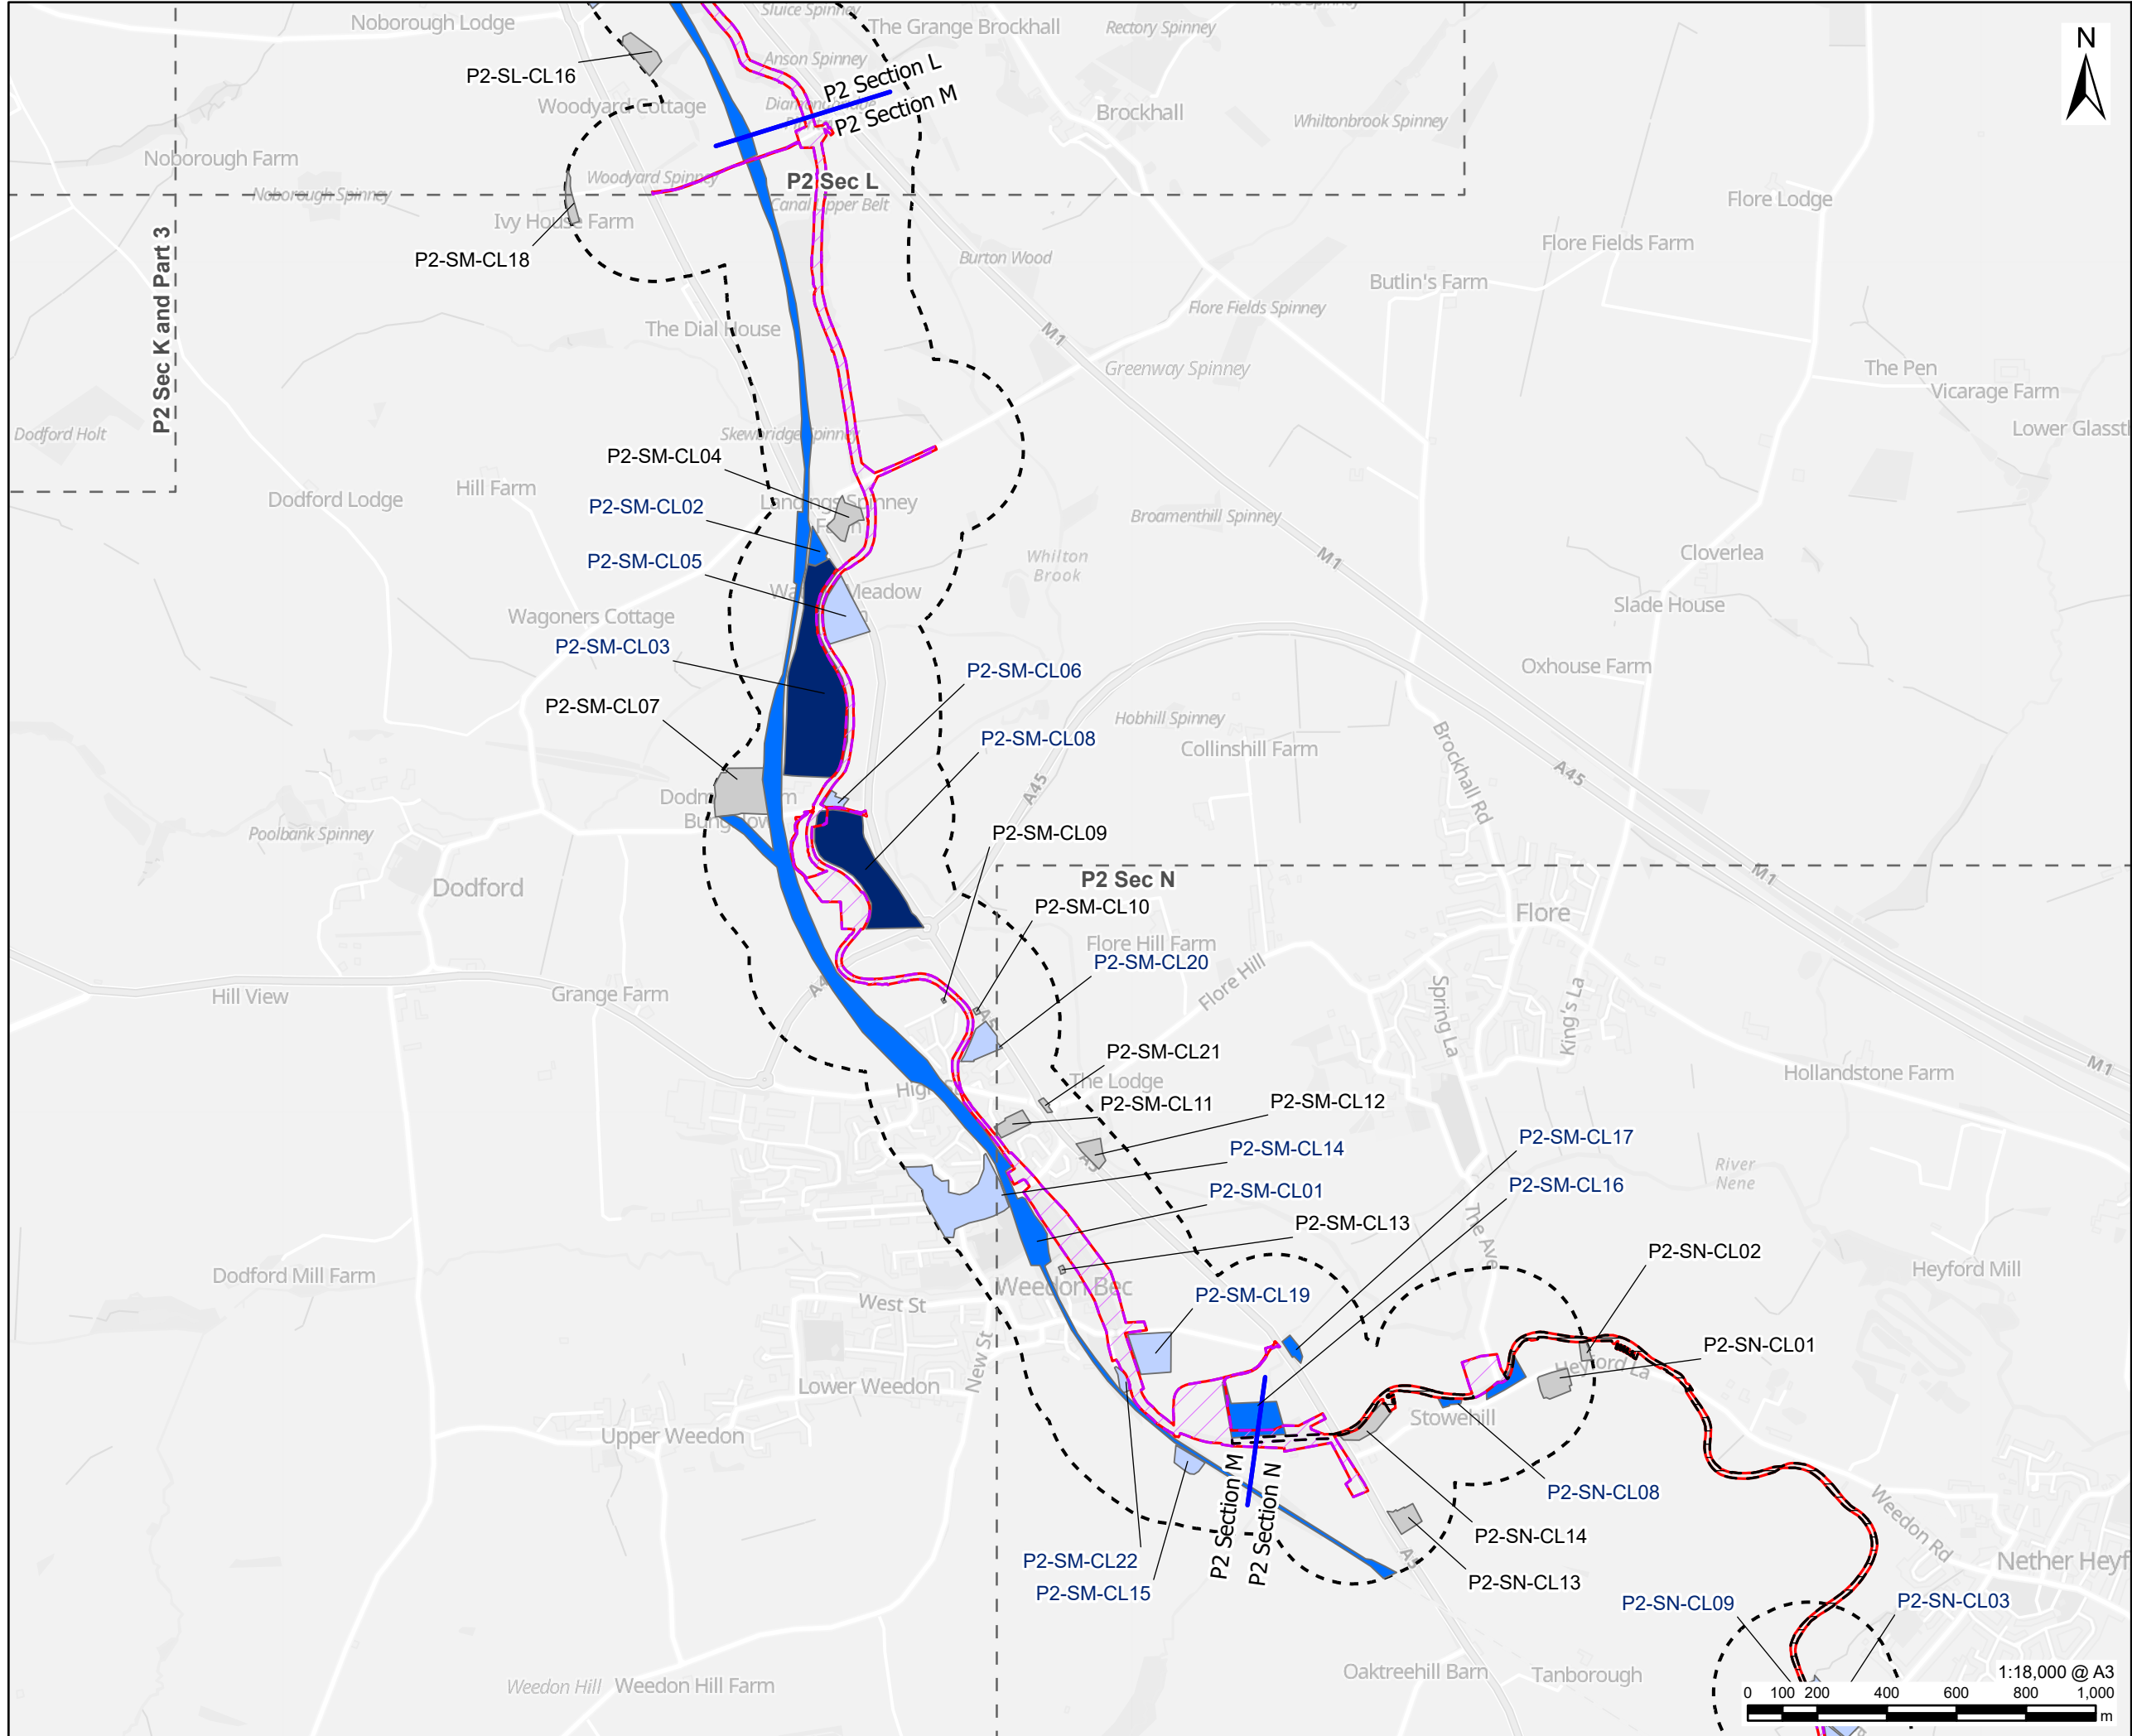

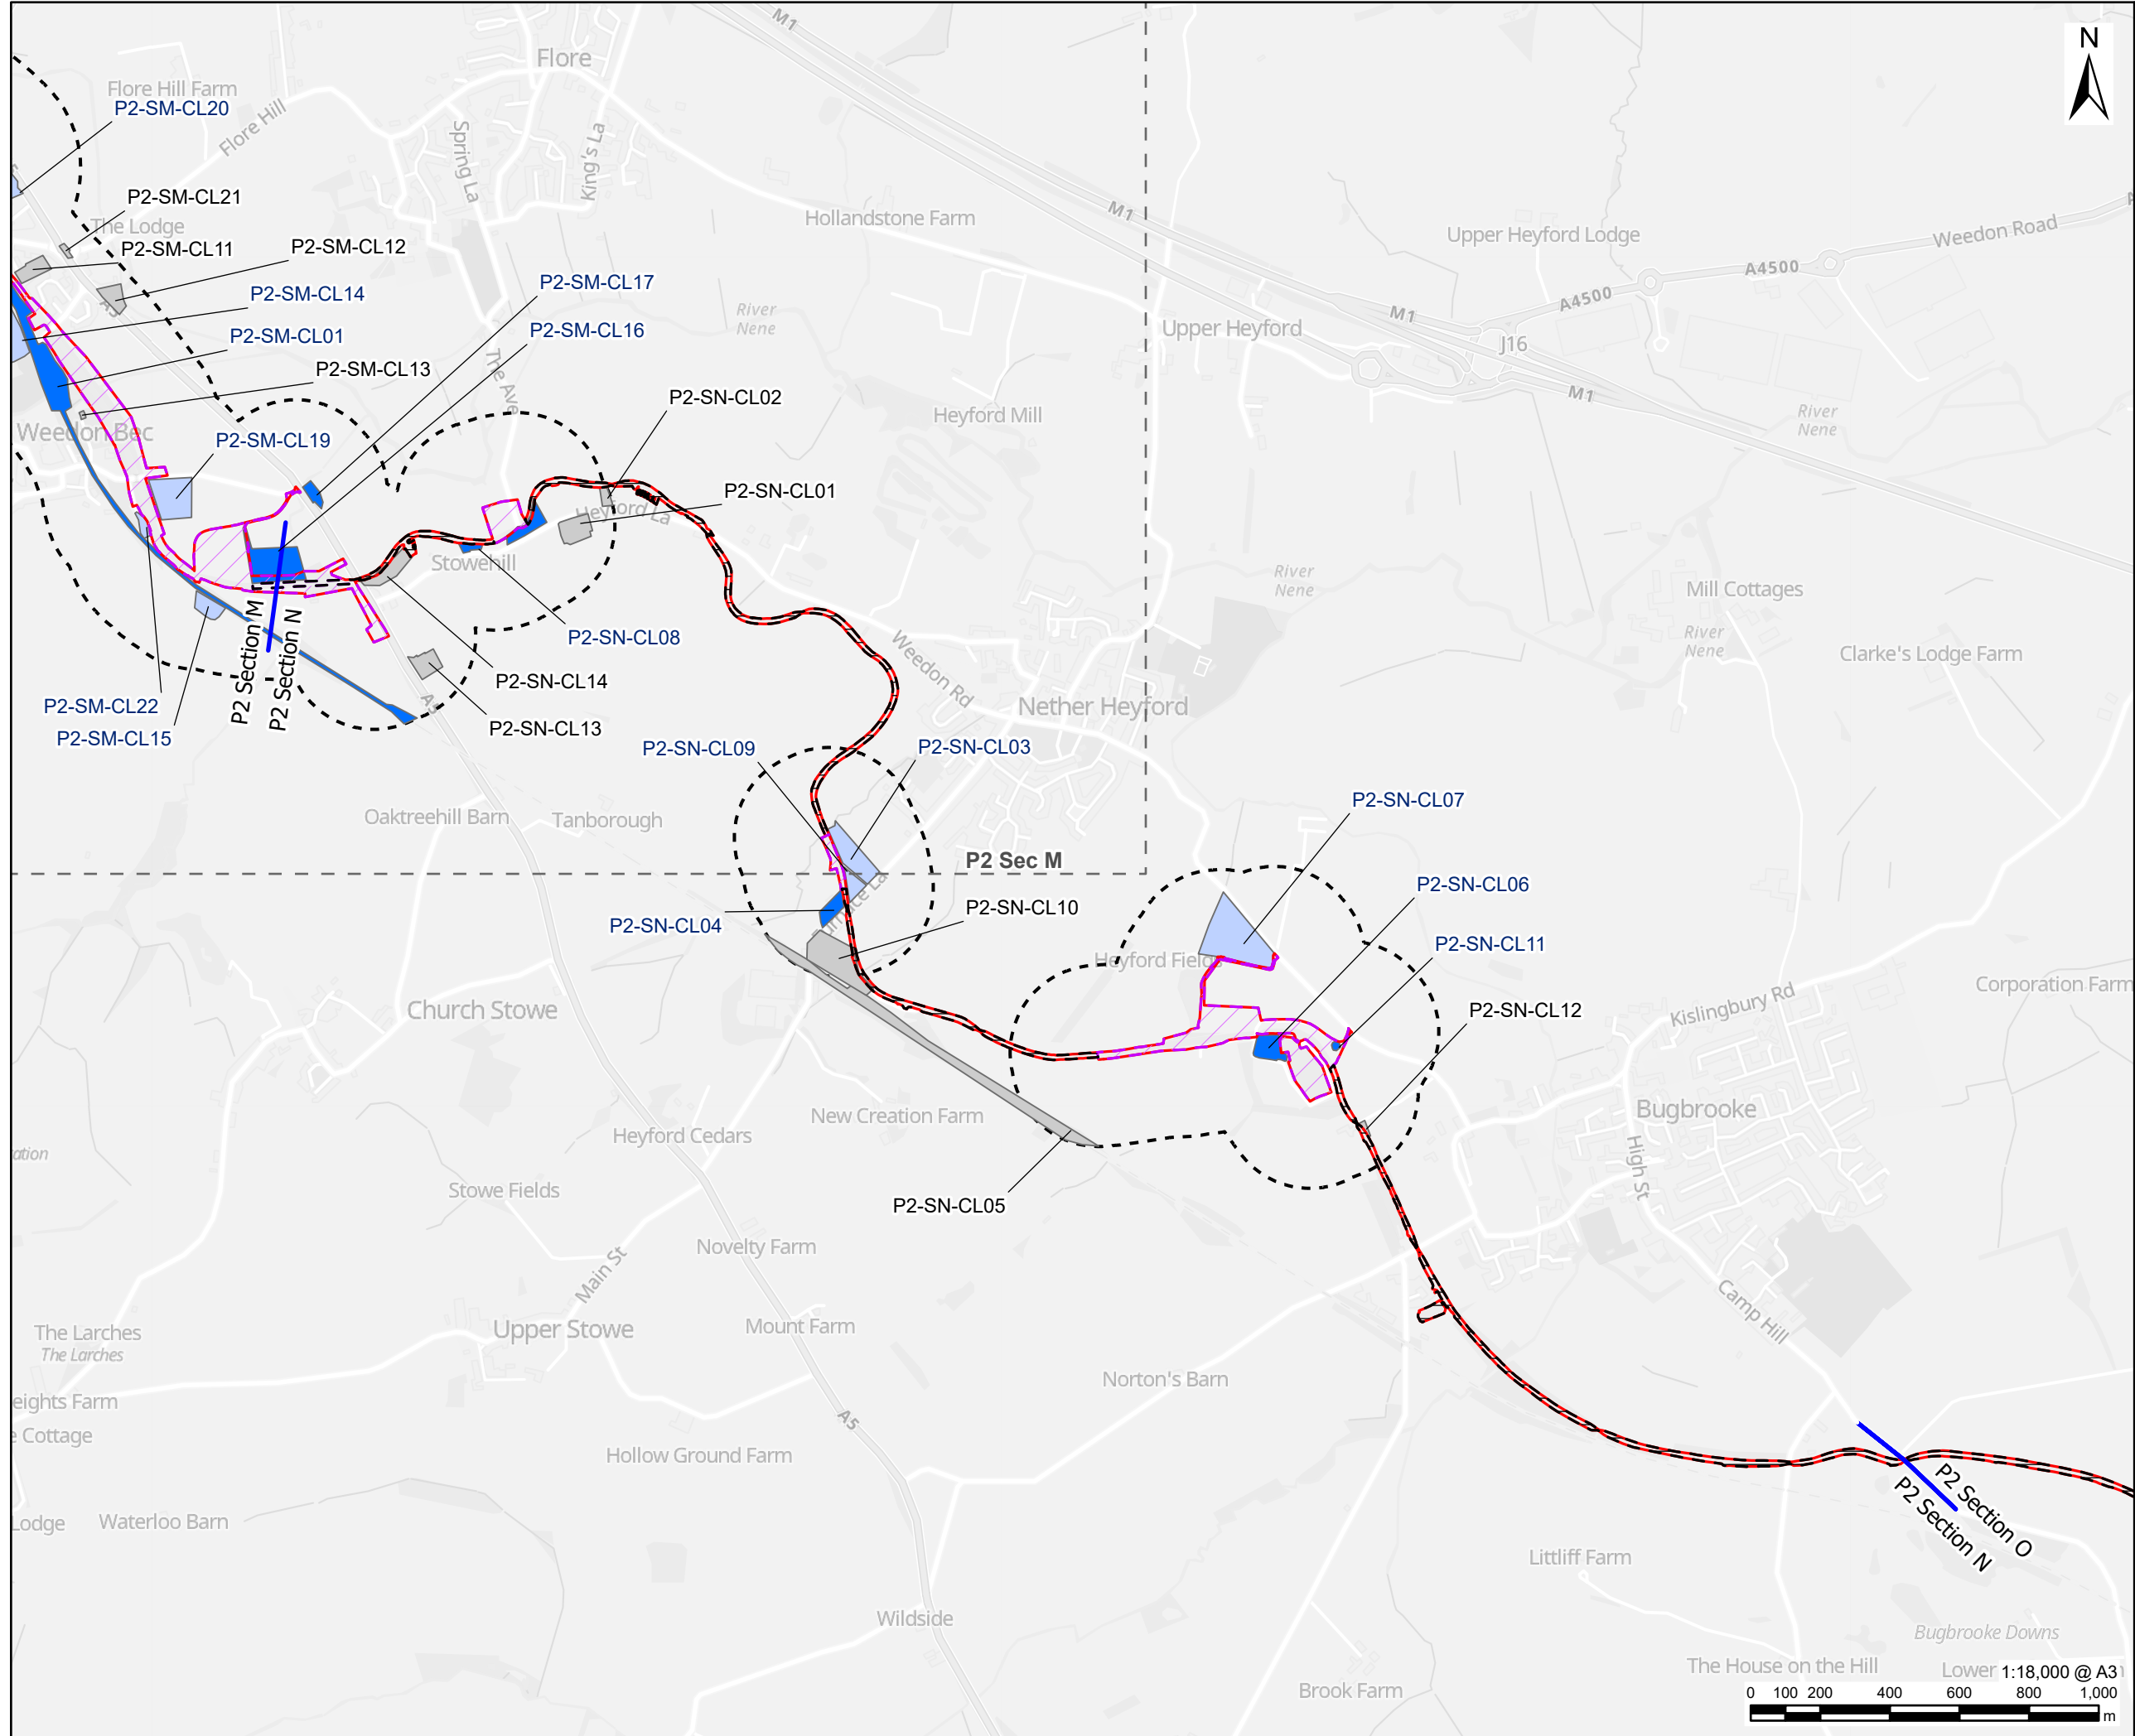

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

	Part 2 - Indicative Work Area
	Part 2 - Indicative Non-Work Area
	250m Study Area for Geology, Land Contamination and Hydrogeology
	Preliminary Order Limits
	Sheet Extent
	Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
- Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER


60720432

FIGURE TITLE


Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P2 Sec N

FIGURE NUMBER


Figure 14-PD-6

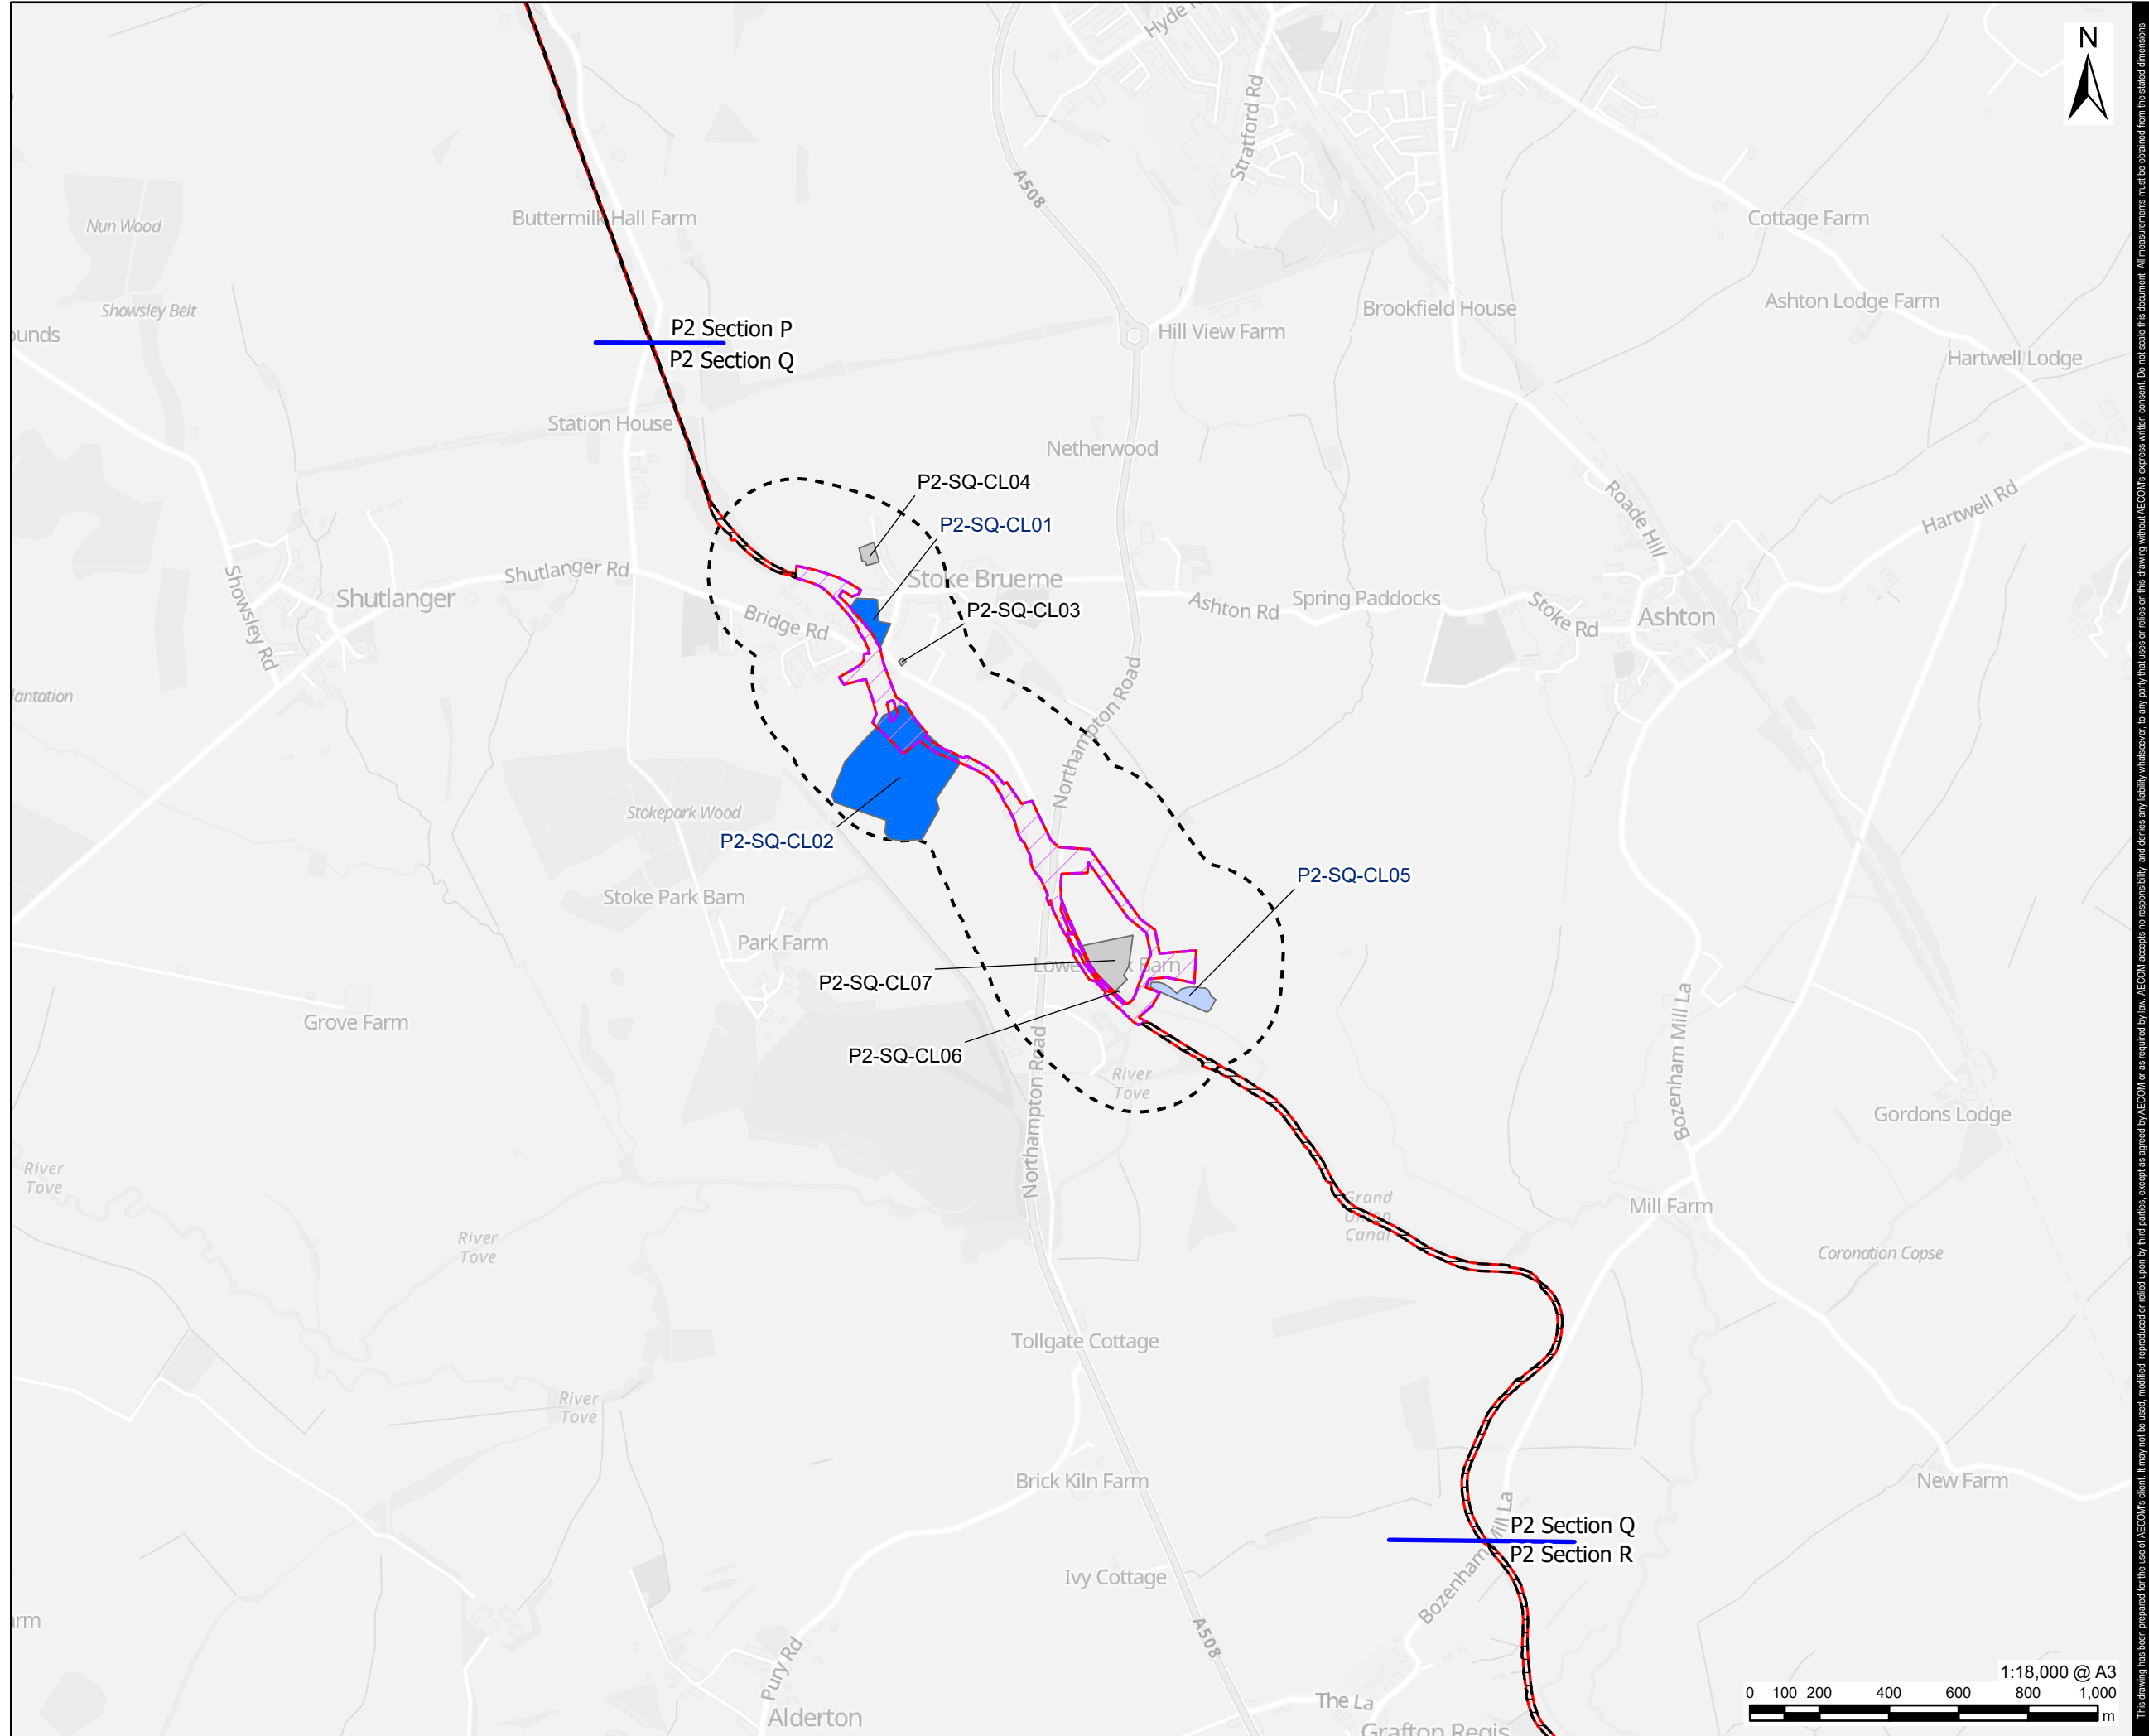


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

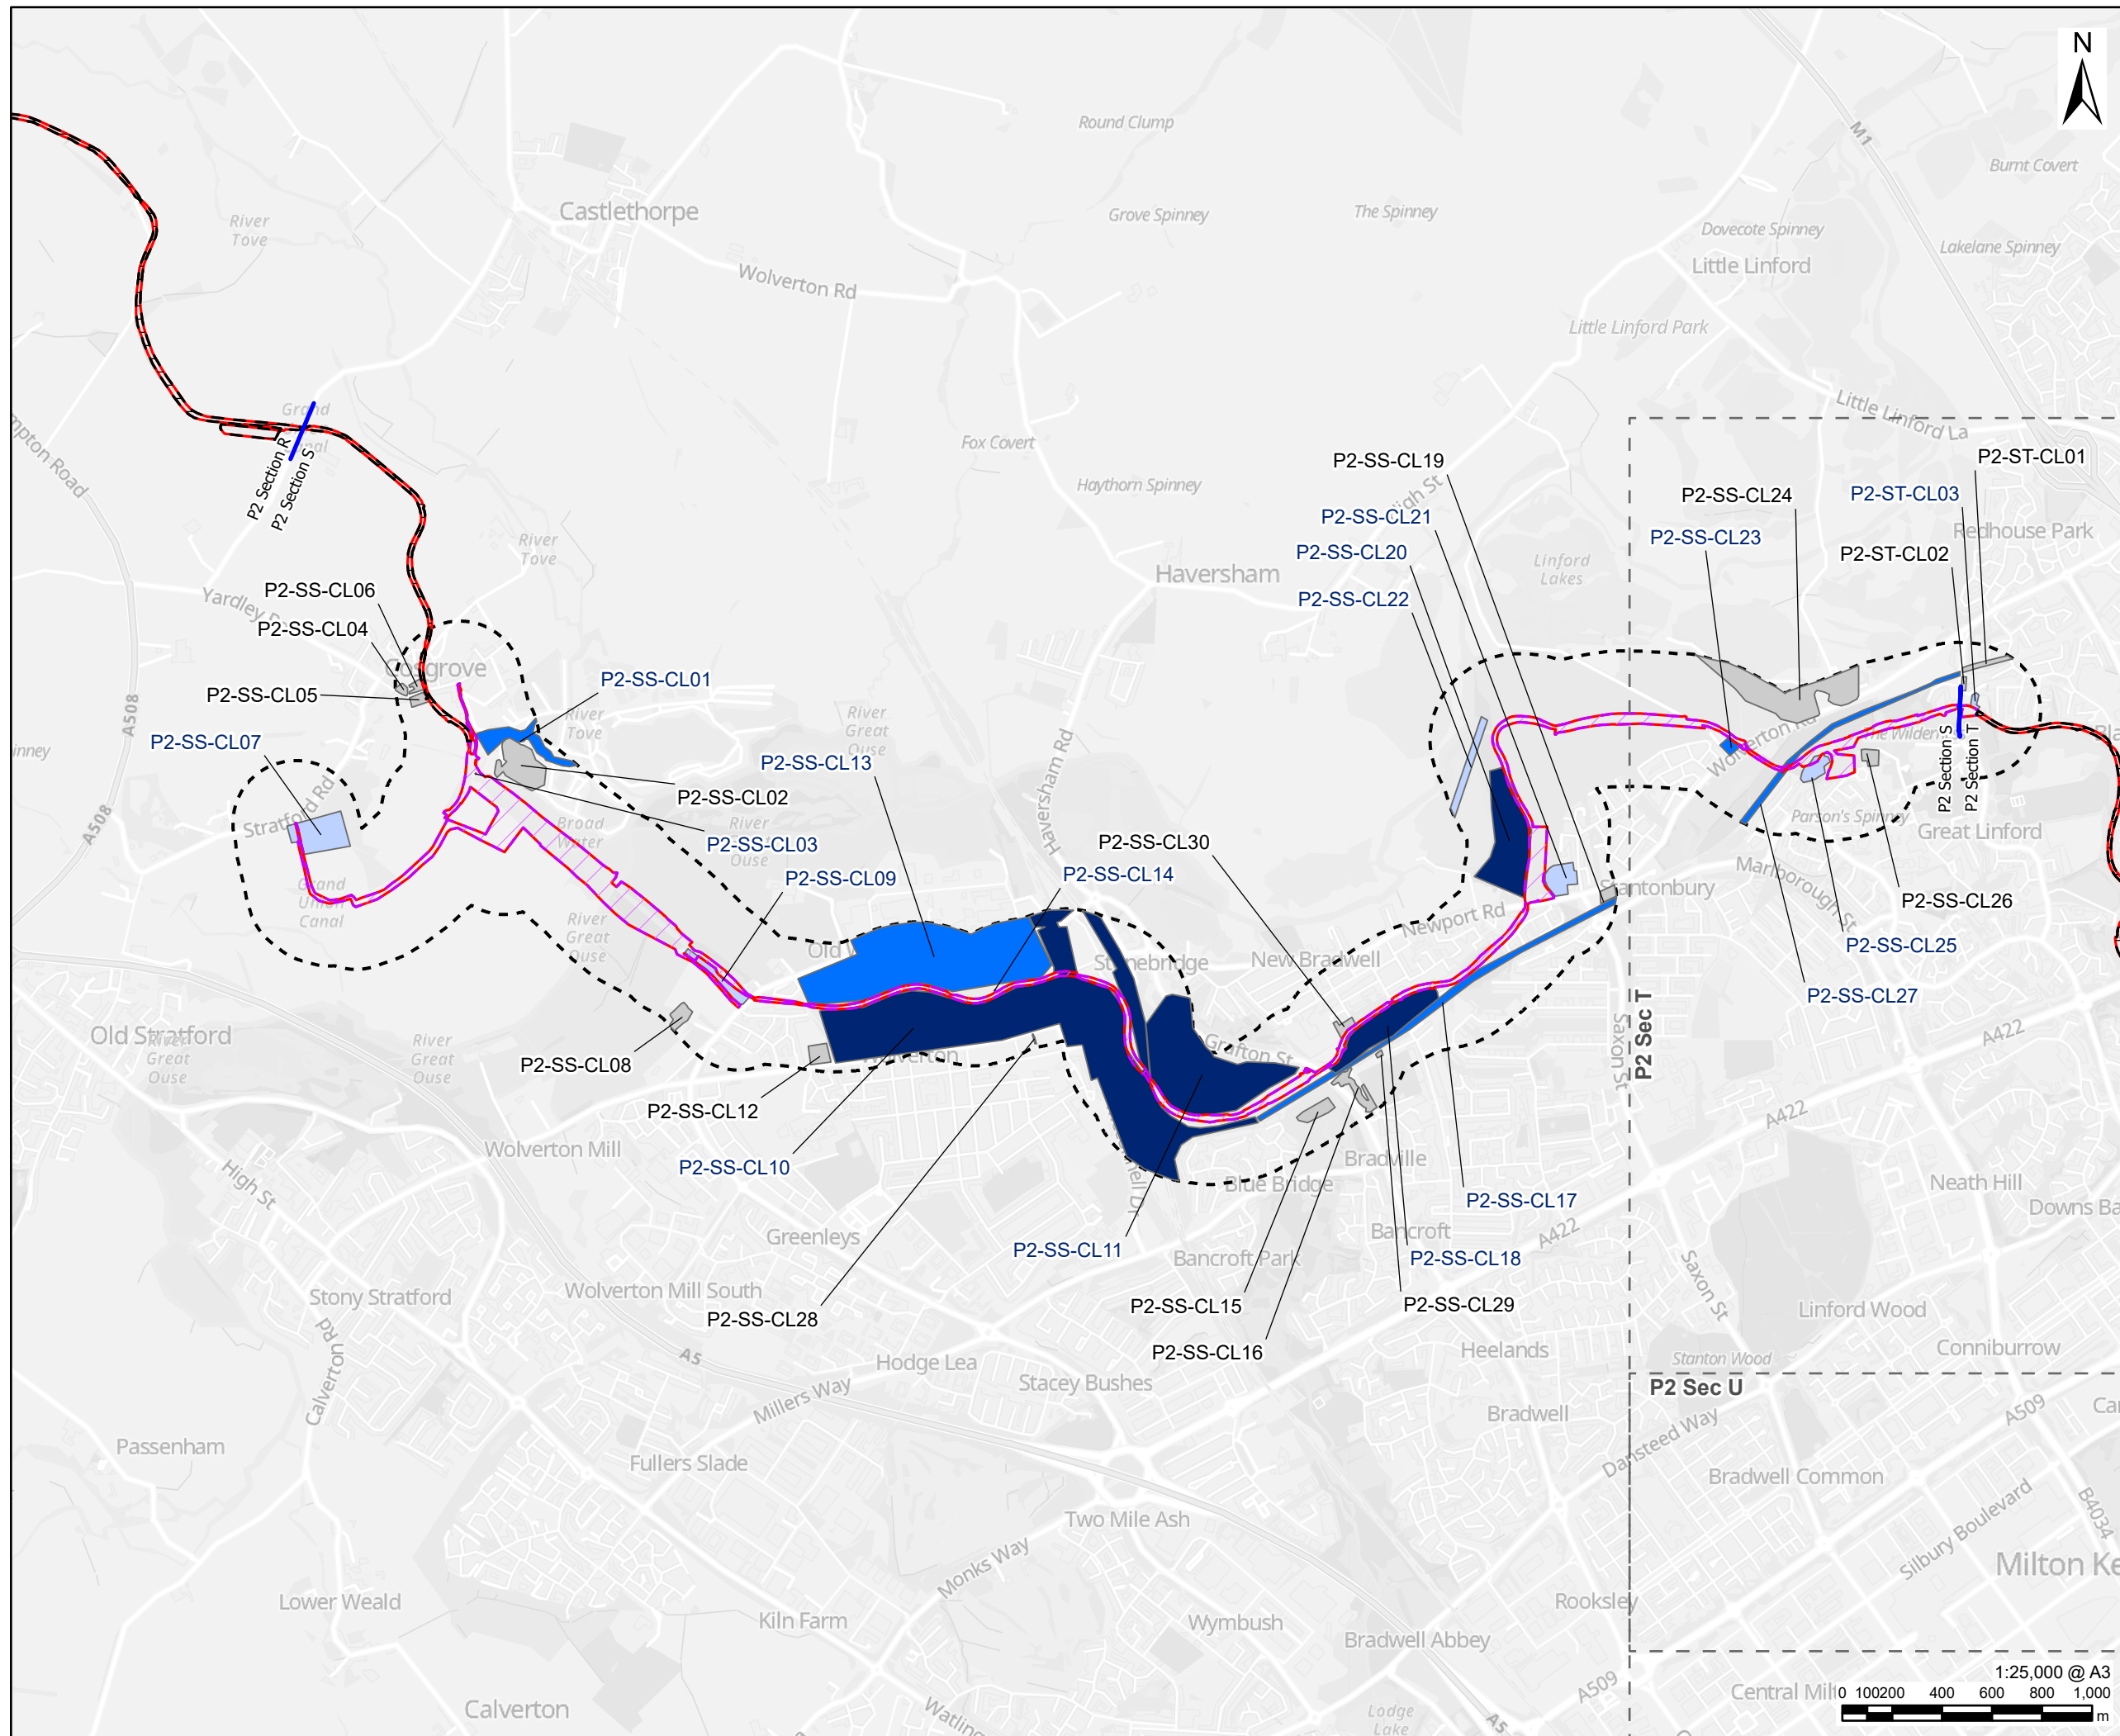


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this drawing. All measurements must be obtained from the stilled dimensions.

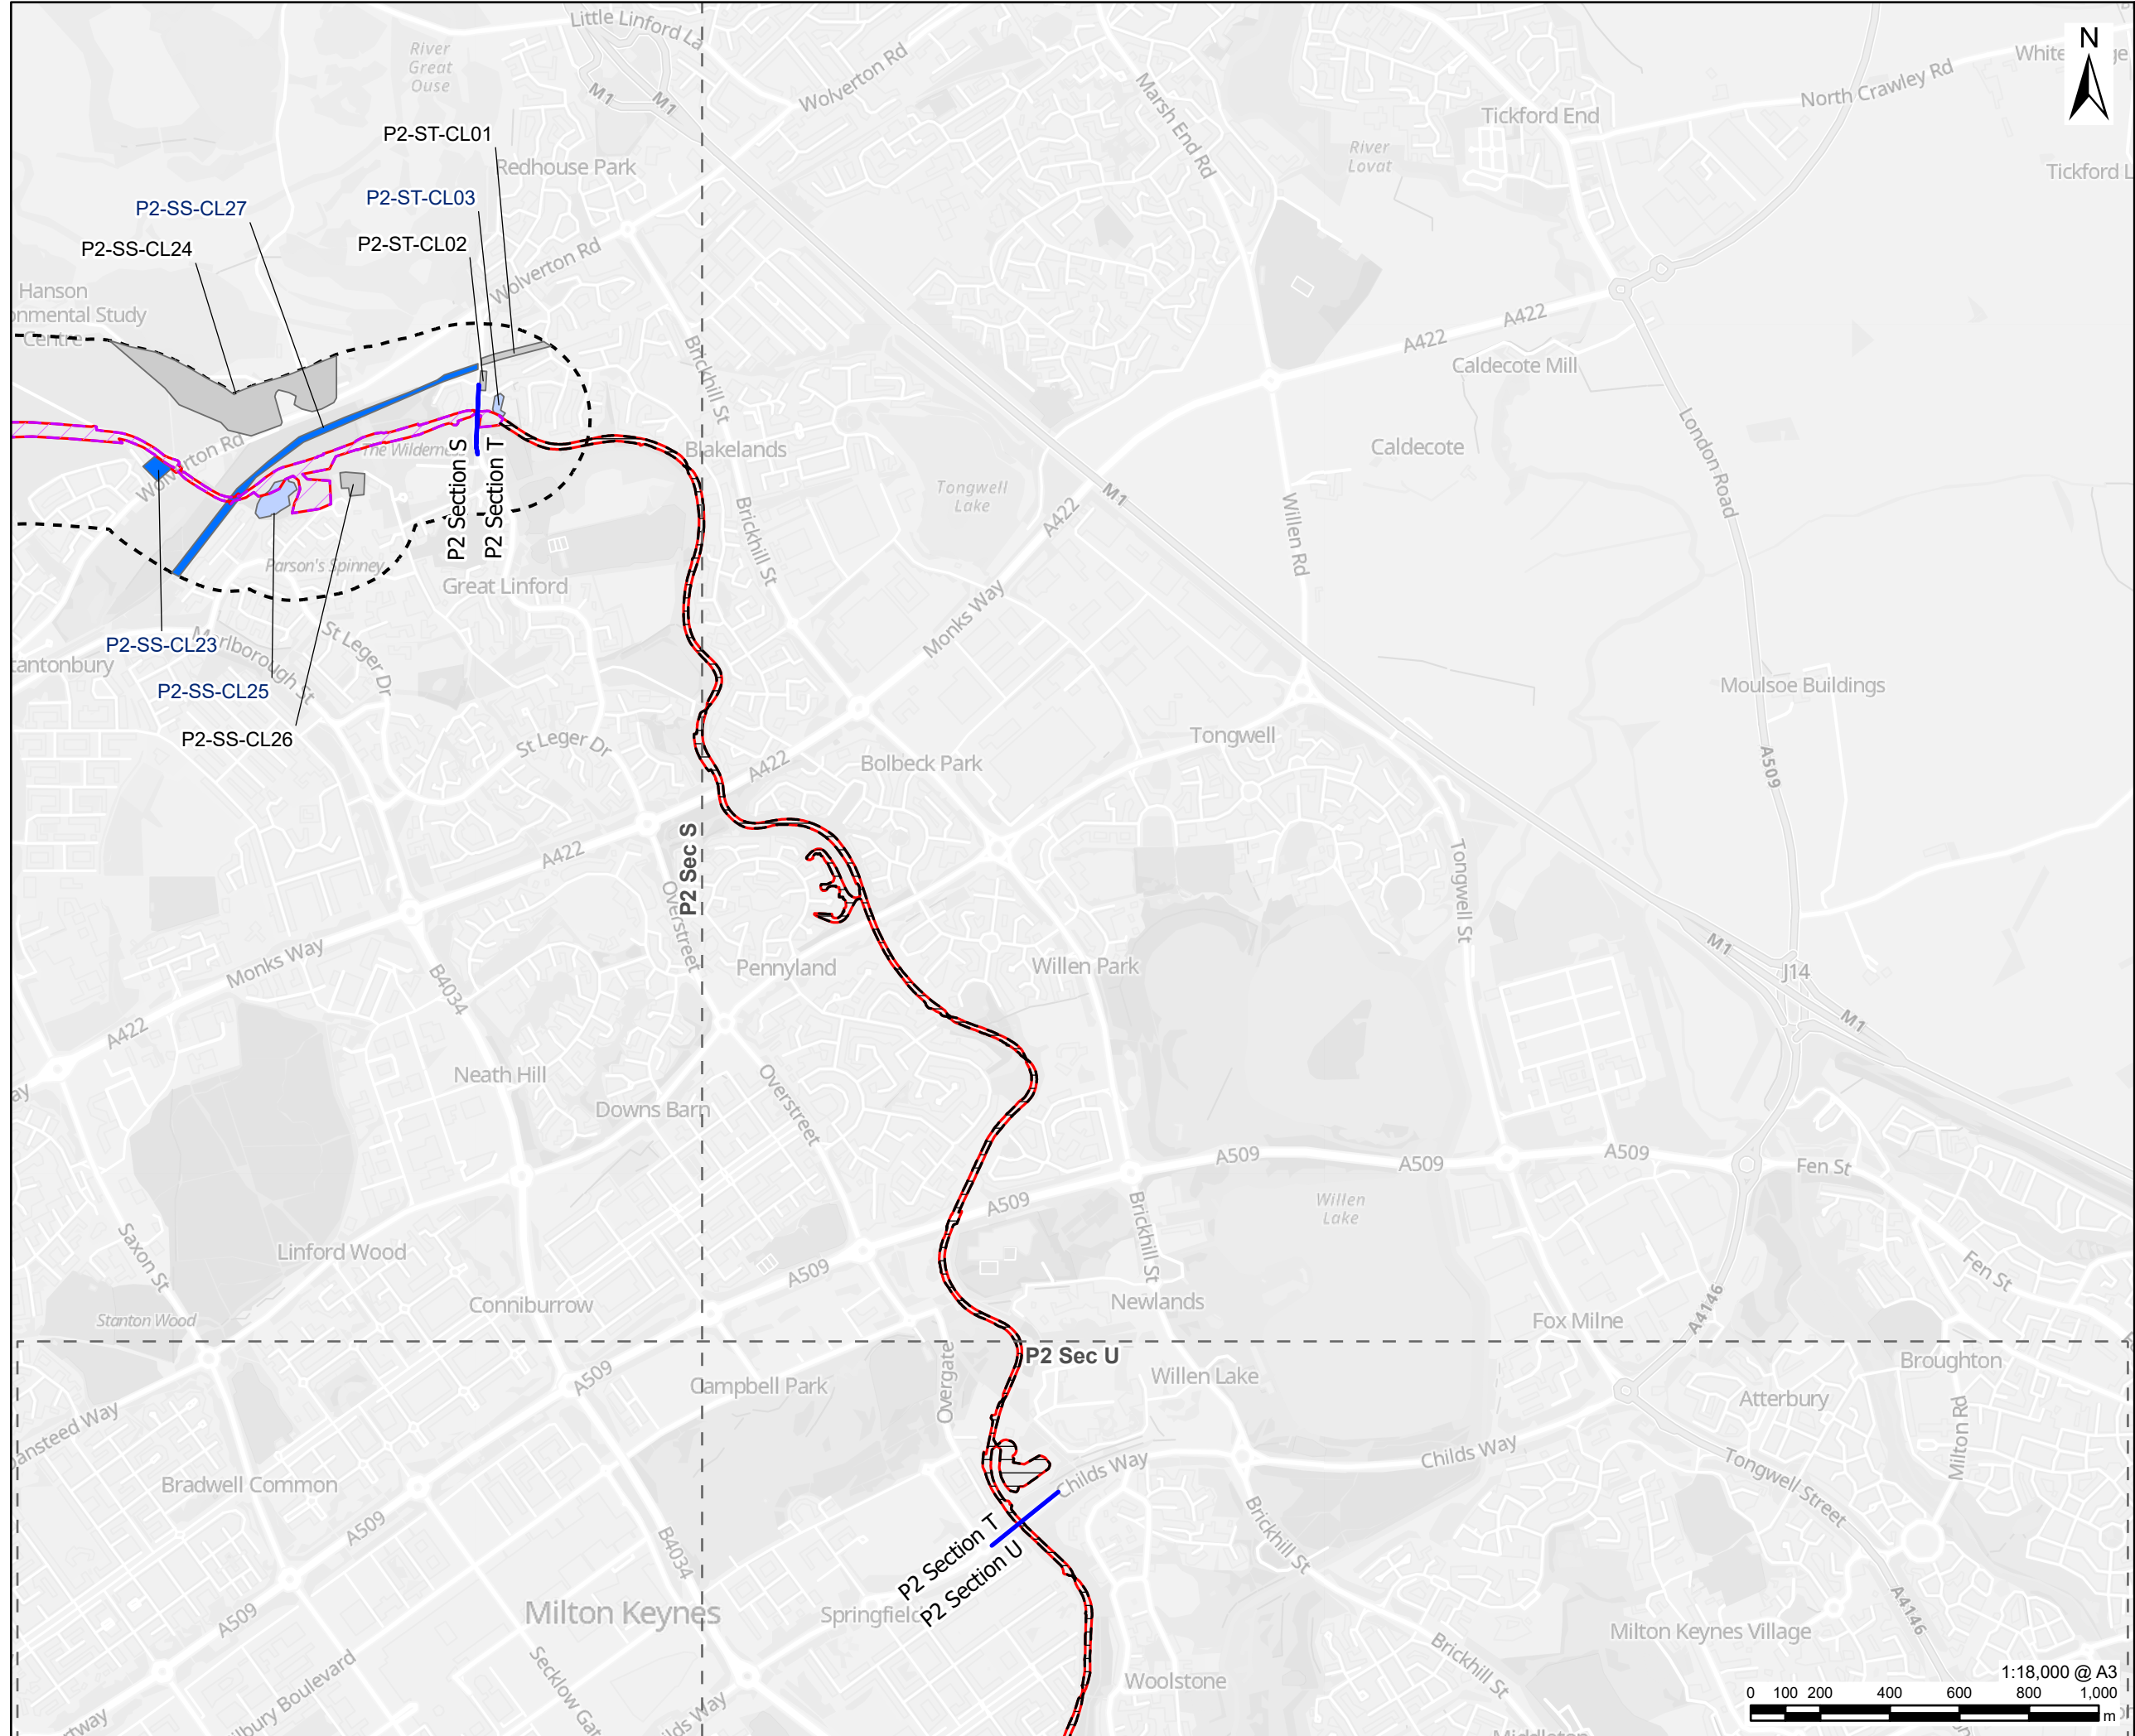

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing, without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

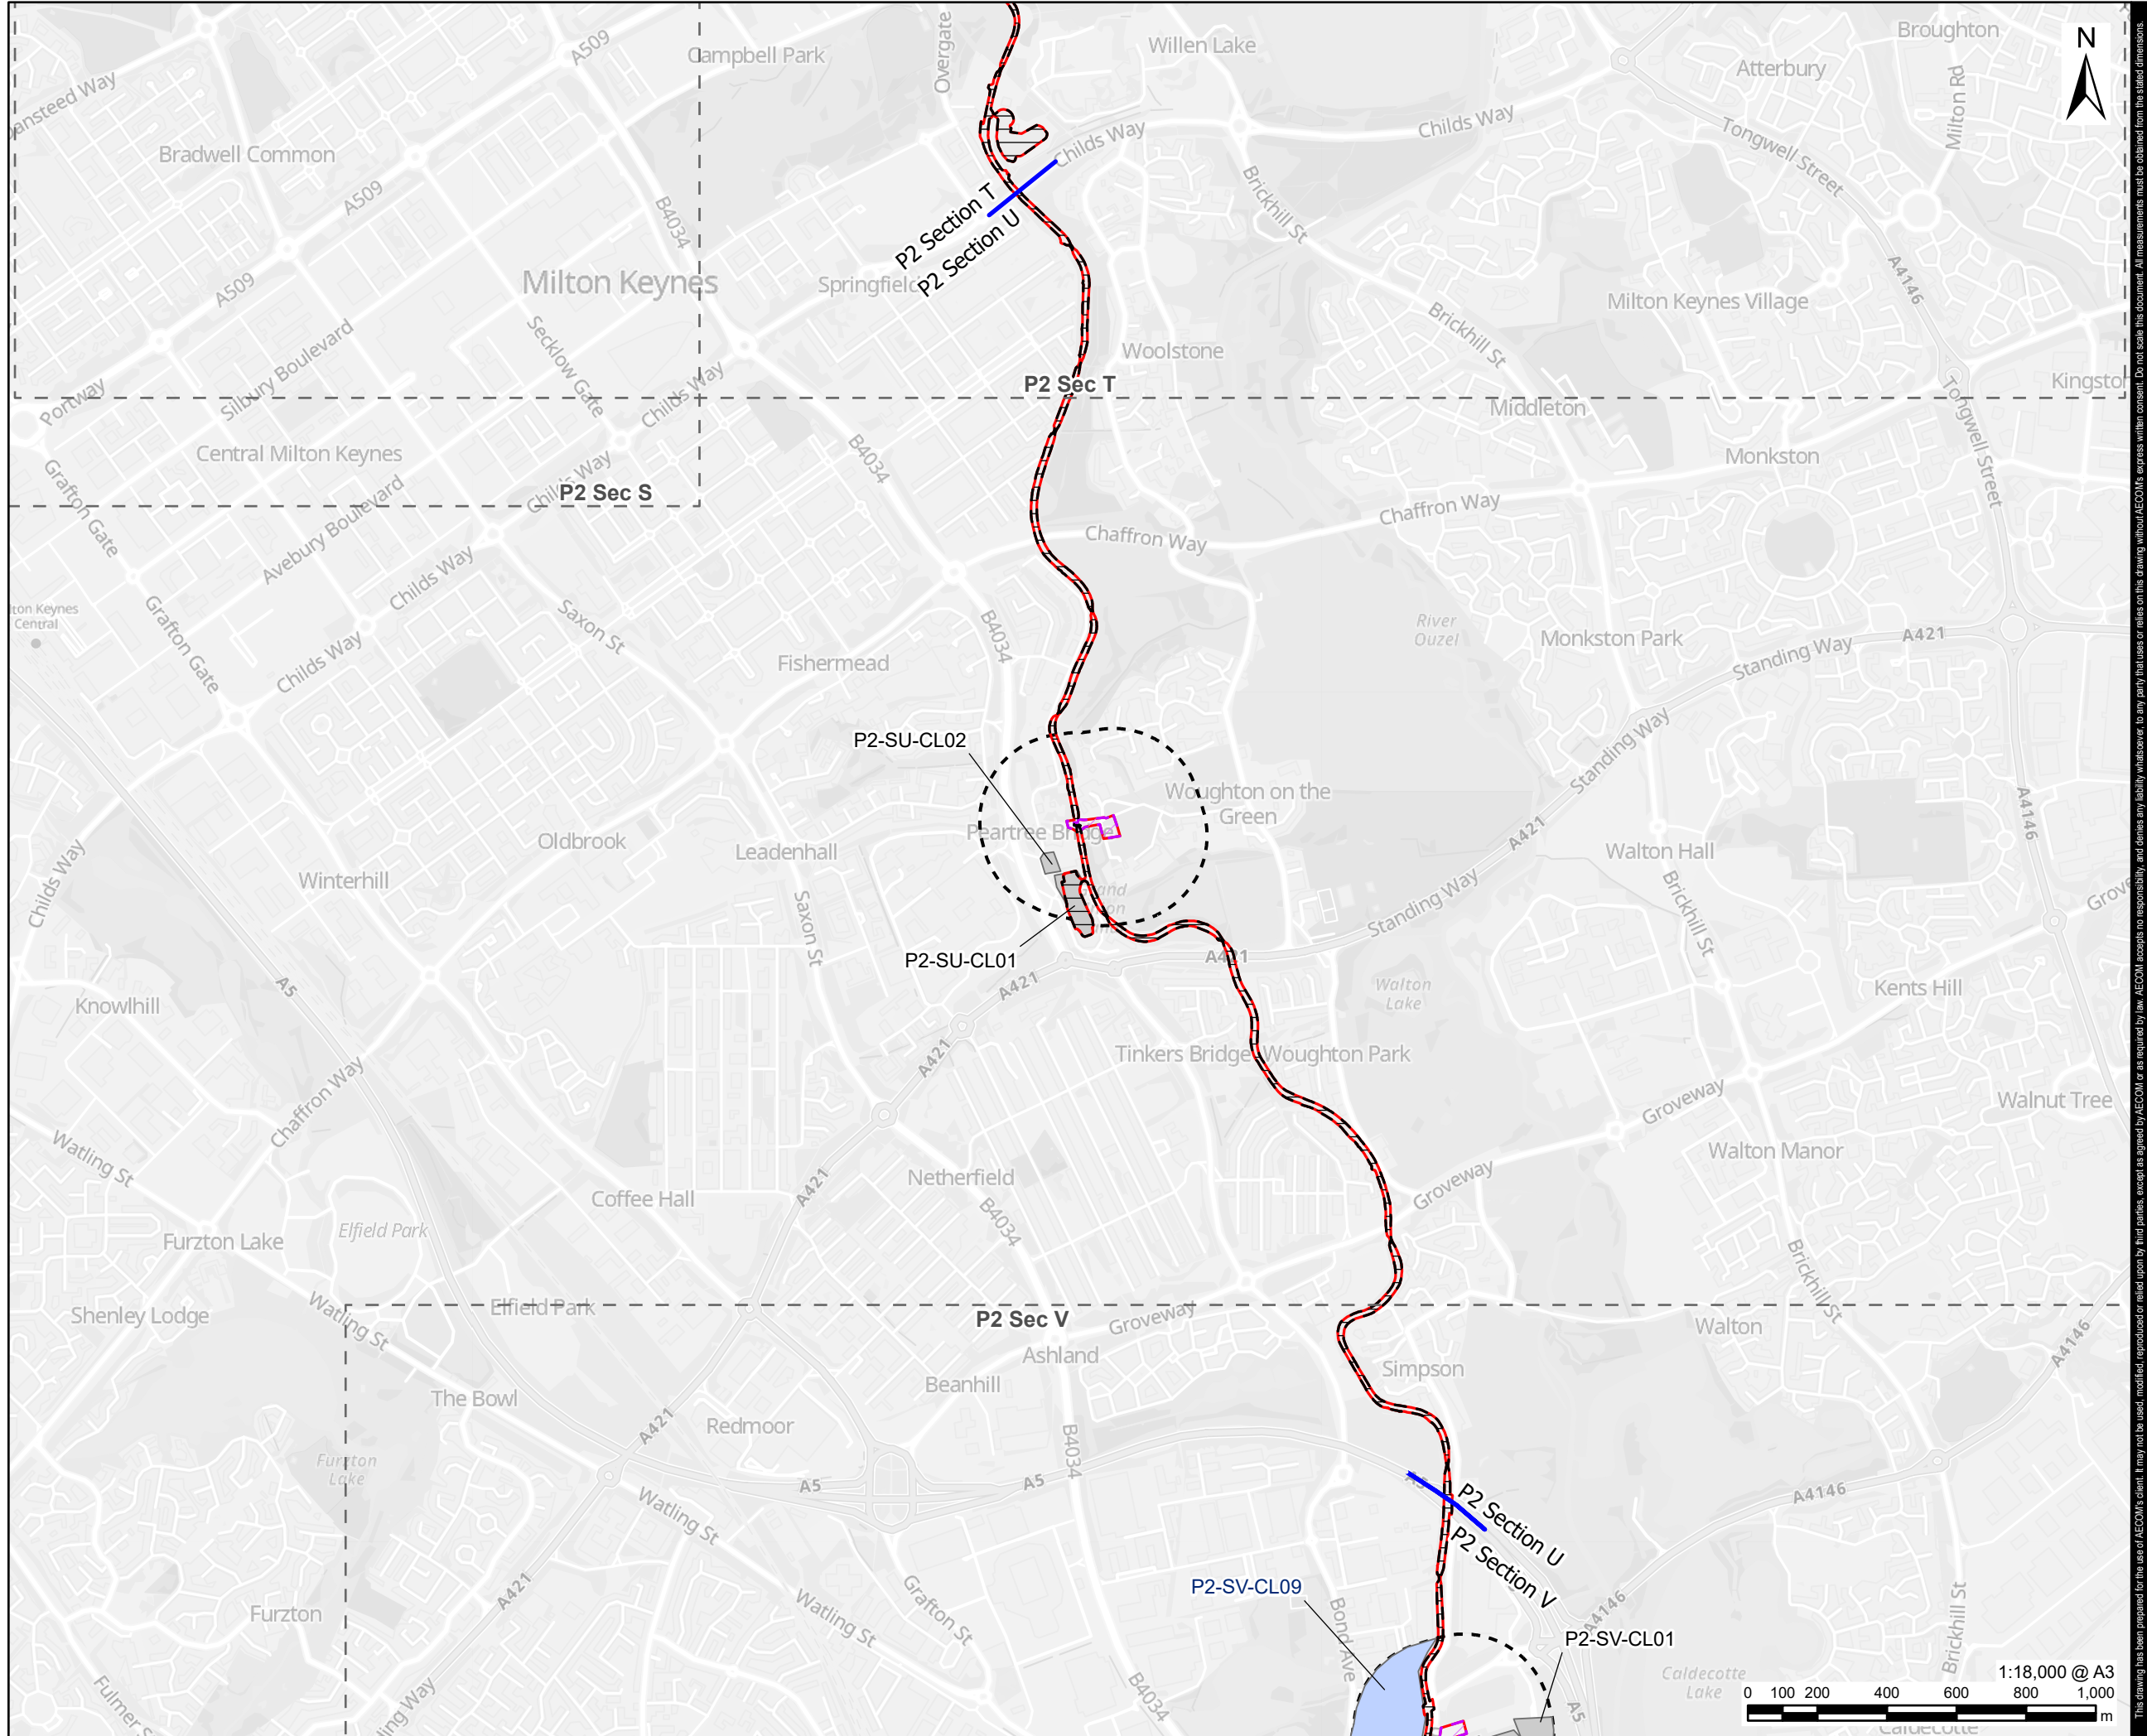

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

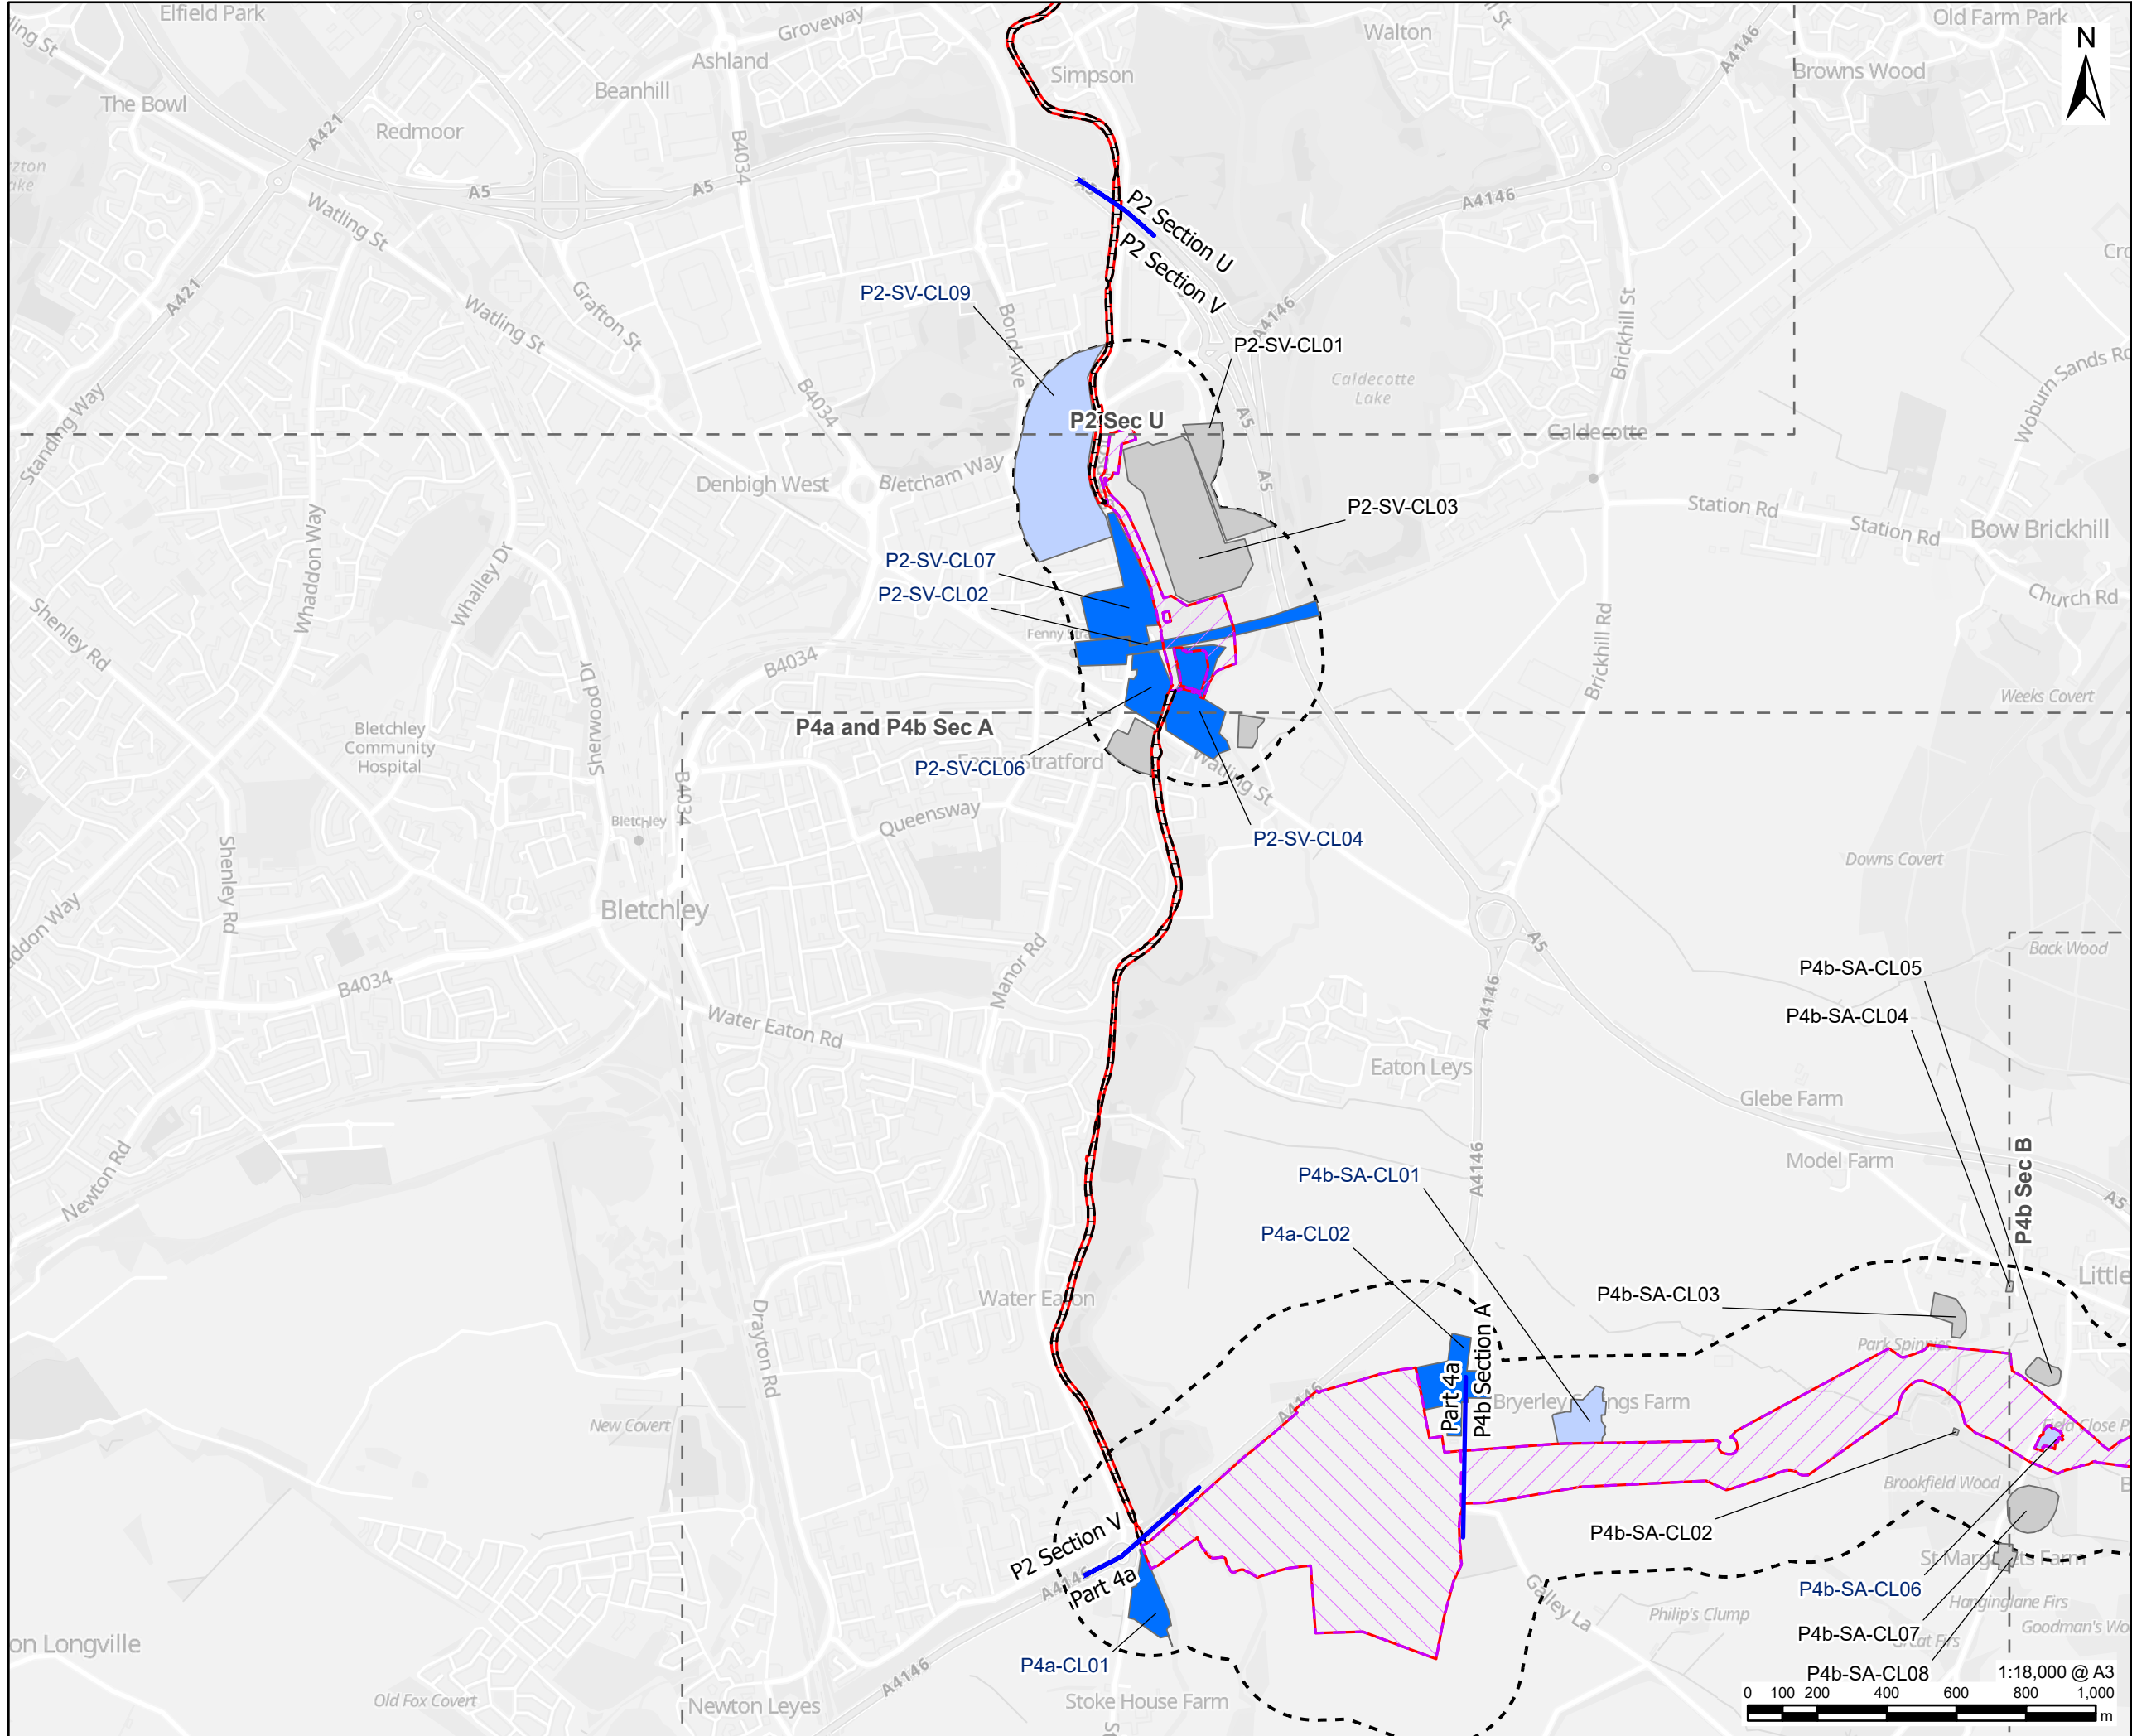

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

	Part 2 - Indicative Work Area
	Part 2 - Indicative Non-Work Area
	Part 4a
	Part 4b
	250m Study Area for Geology, Land Contamination and Hydrogeology
	Preliminary Order Limits
	Sheet Extent
	Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025


Contains data from OS Zoomstack

3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.


ISSUE PURPOSE
FINAL
PROJECT NUMBER
60720432
FIGURE TITLE
Parts 2, 3 & 4 Potential Areas of Contamination Sheet P2 Sec V

FIGURE NUMBER

Figure 14-PD-6

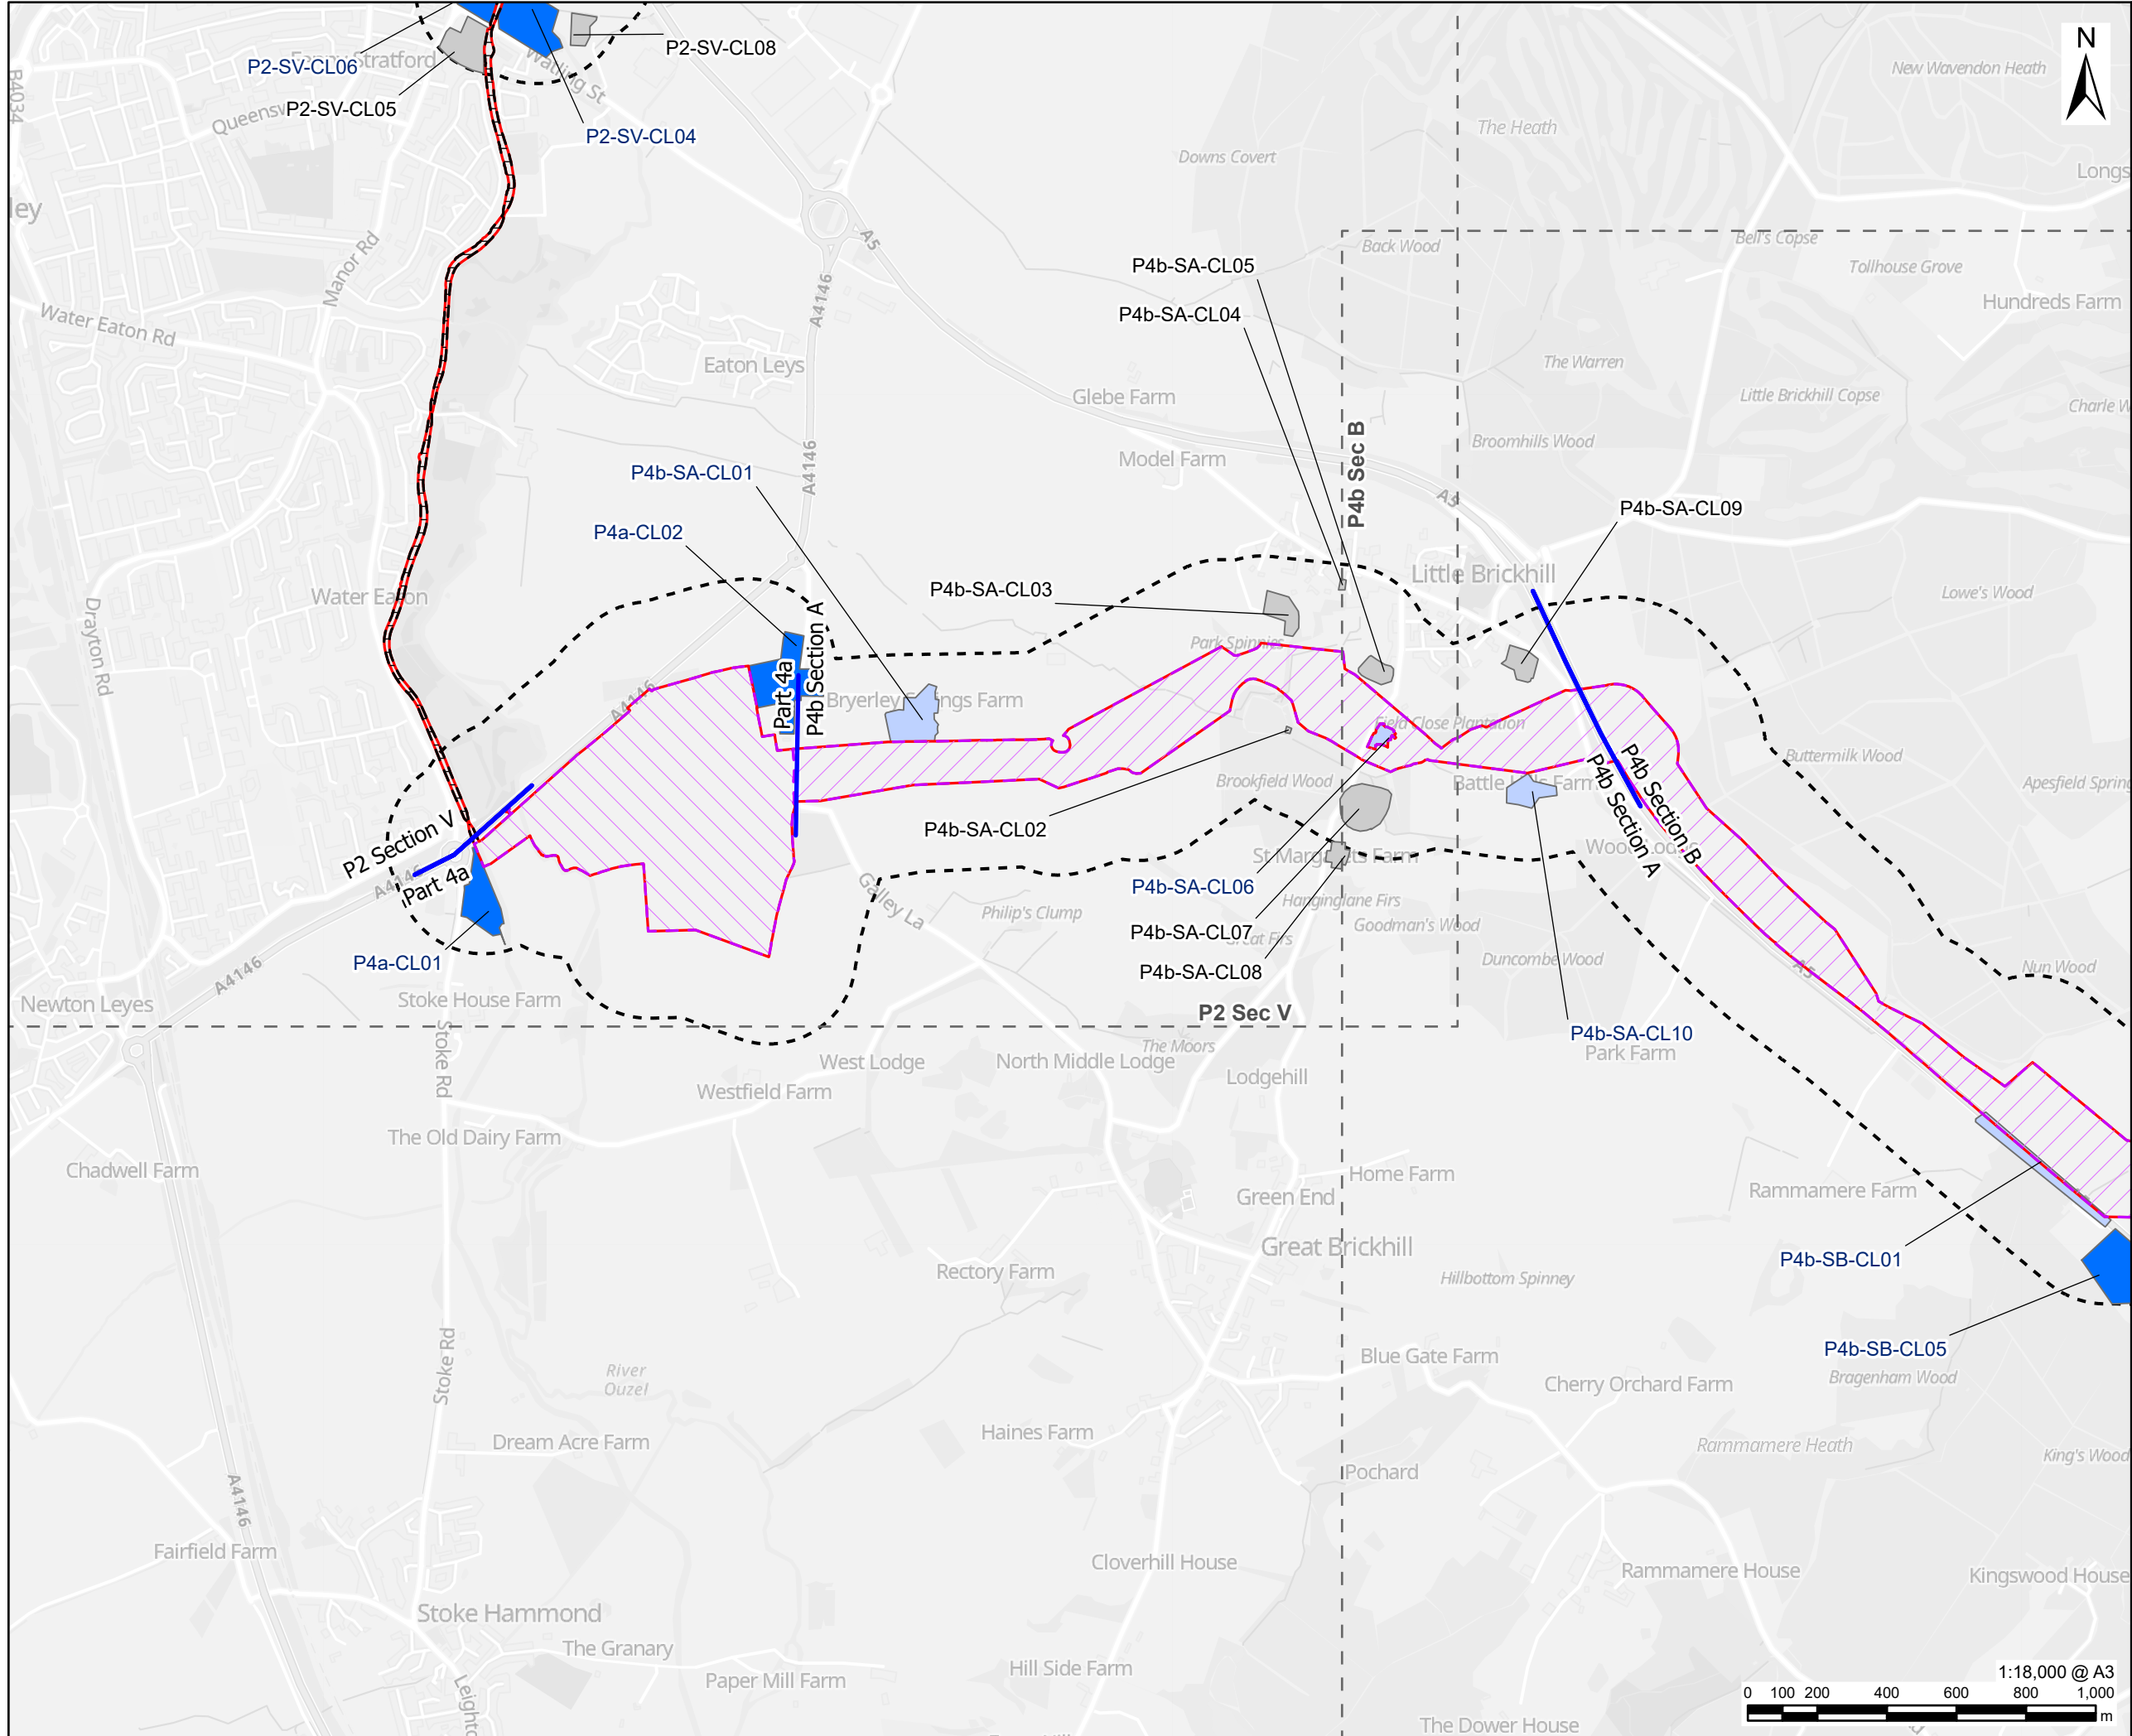


This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.

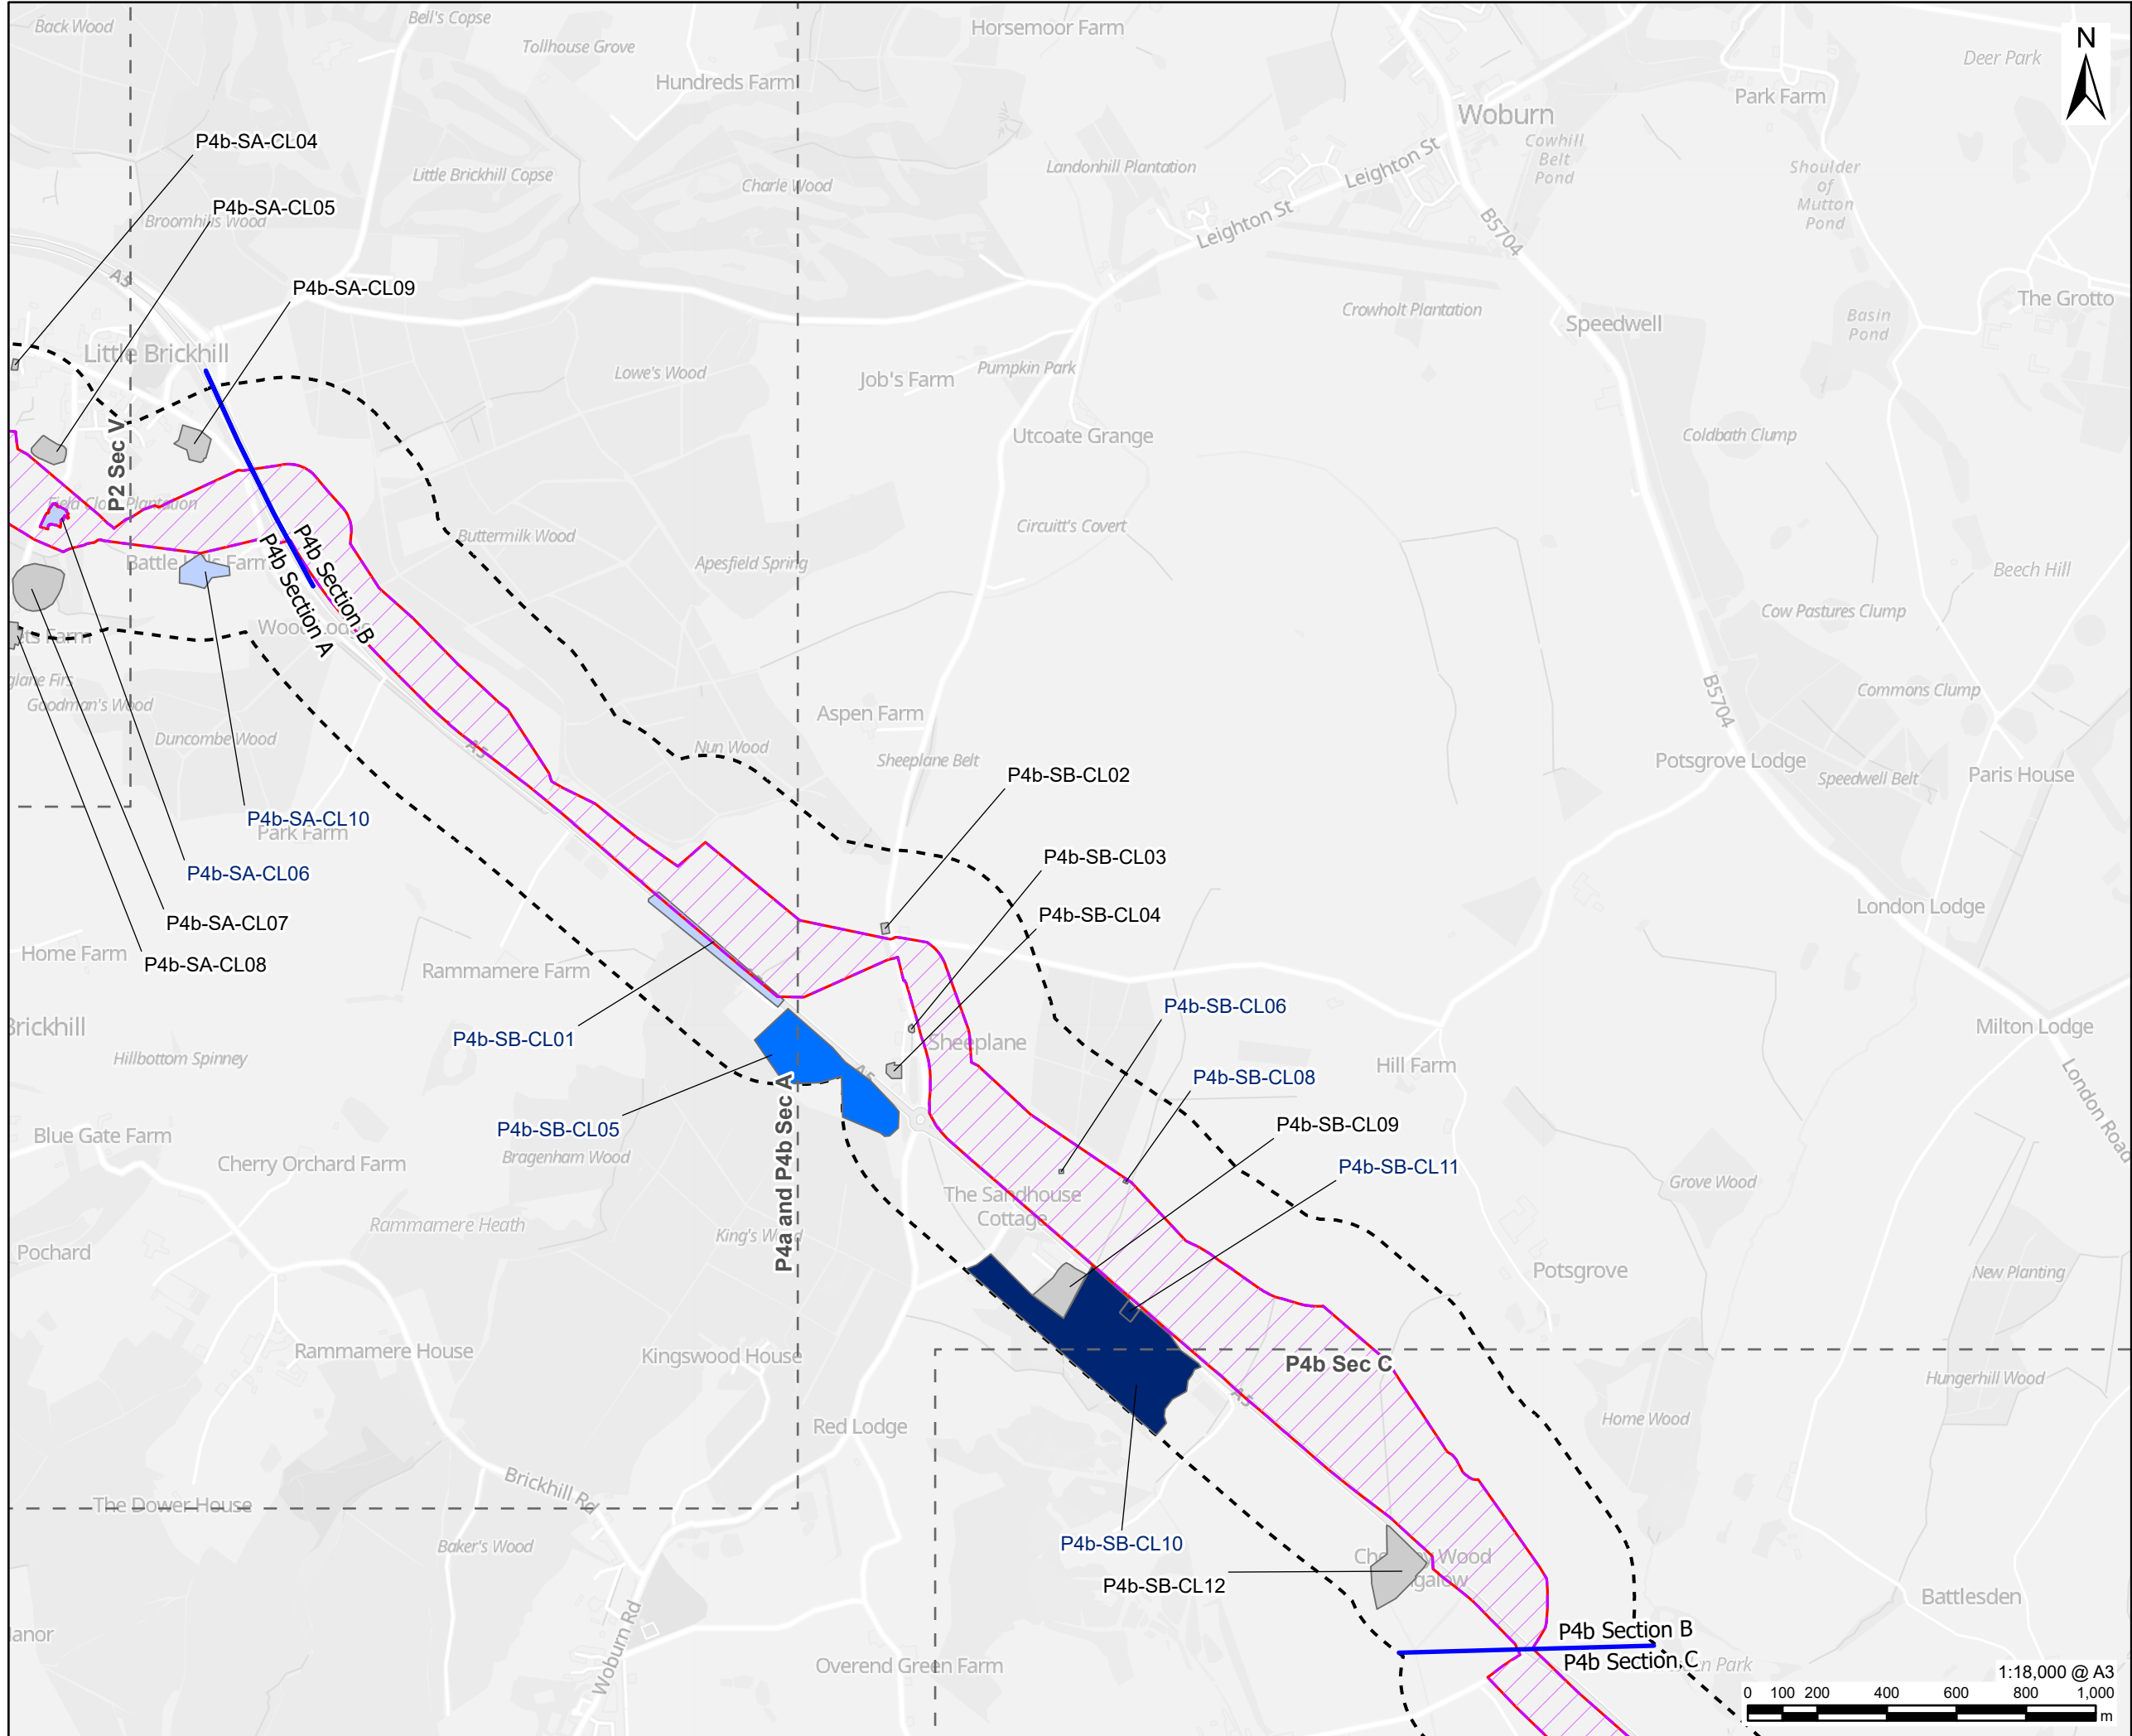

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale this document. All measurements must be obtained from the stated dimensions.

Revision: 0 Drawn: BSO Checked: JW Approved: LC Date: 2025-11-27
Filename: C:\Users\Ben.ONell\AECOM\Affinity Water GUC GIS team - Affinity Water EIA Project\02_Maps\FE1_Report\Chapter_14_Ground_Conditions\Fig_14_PD_6_Potential_Areas_of_Contamination.aprx

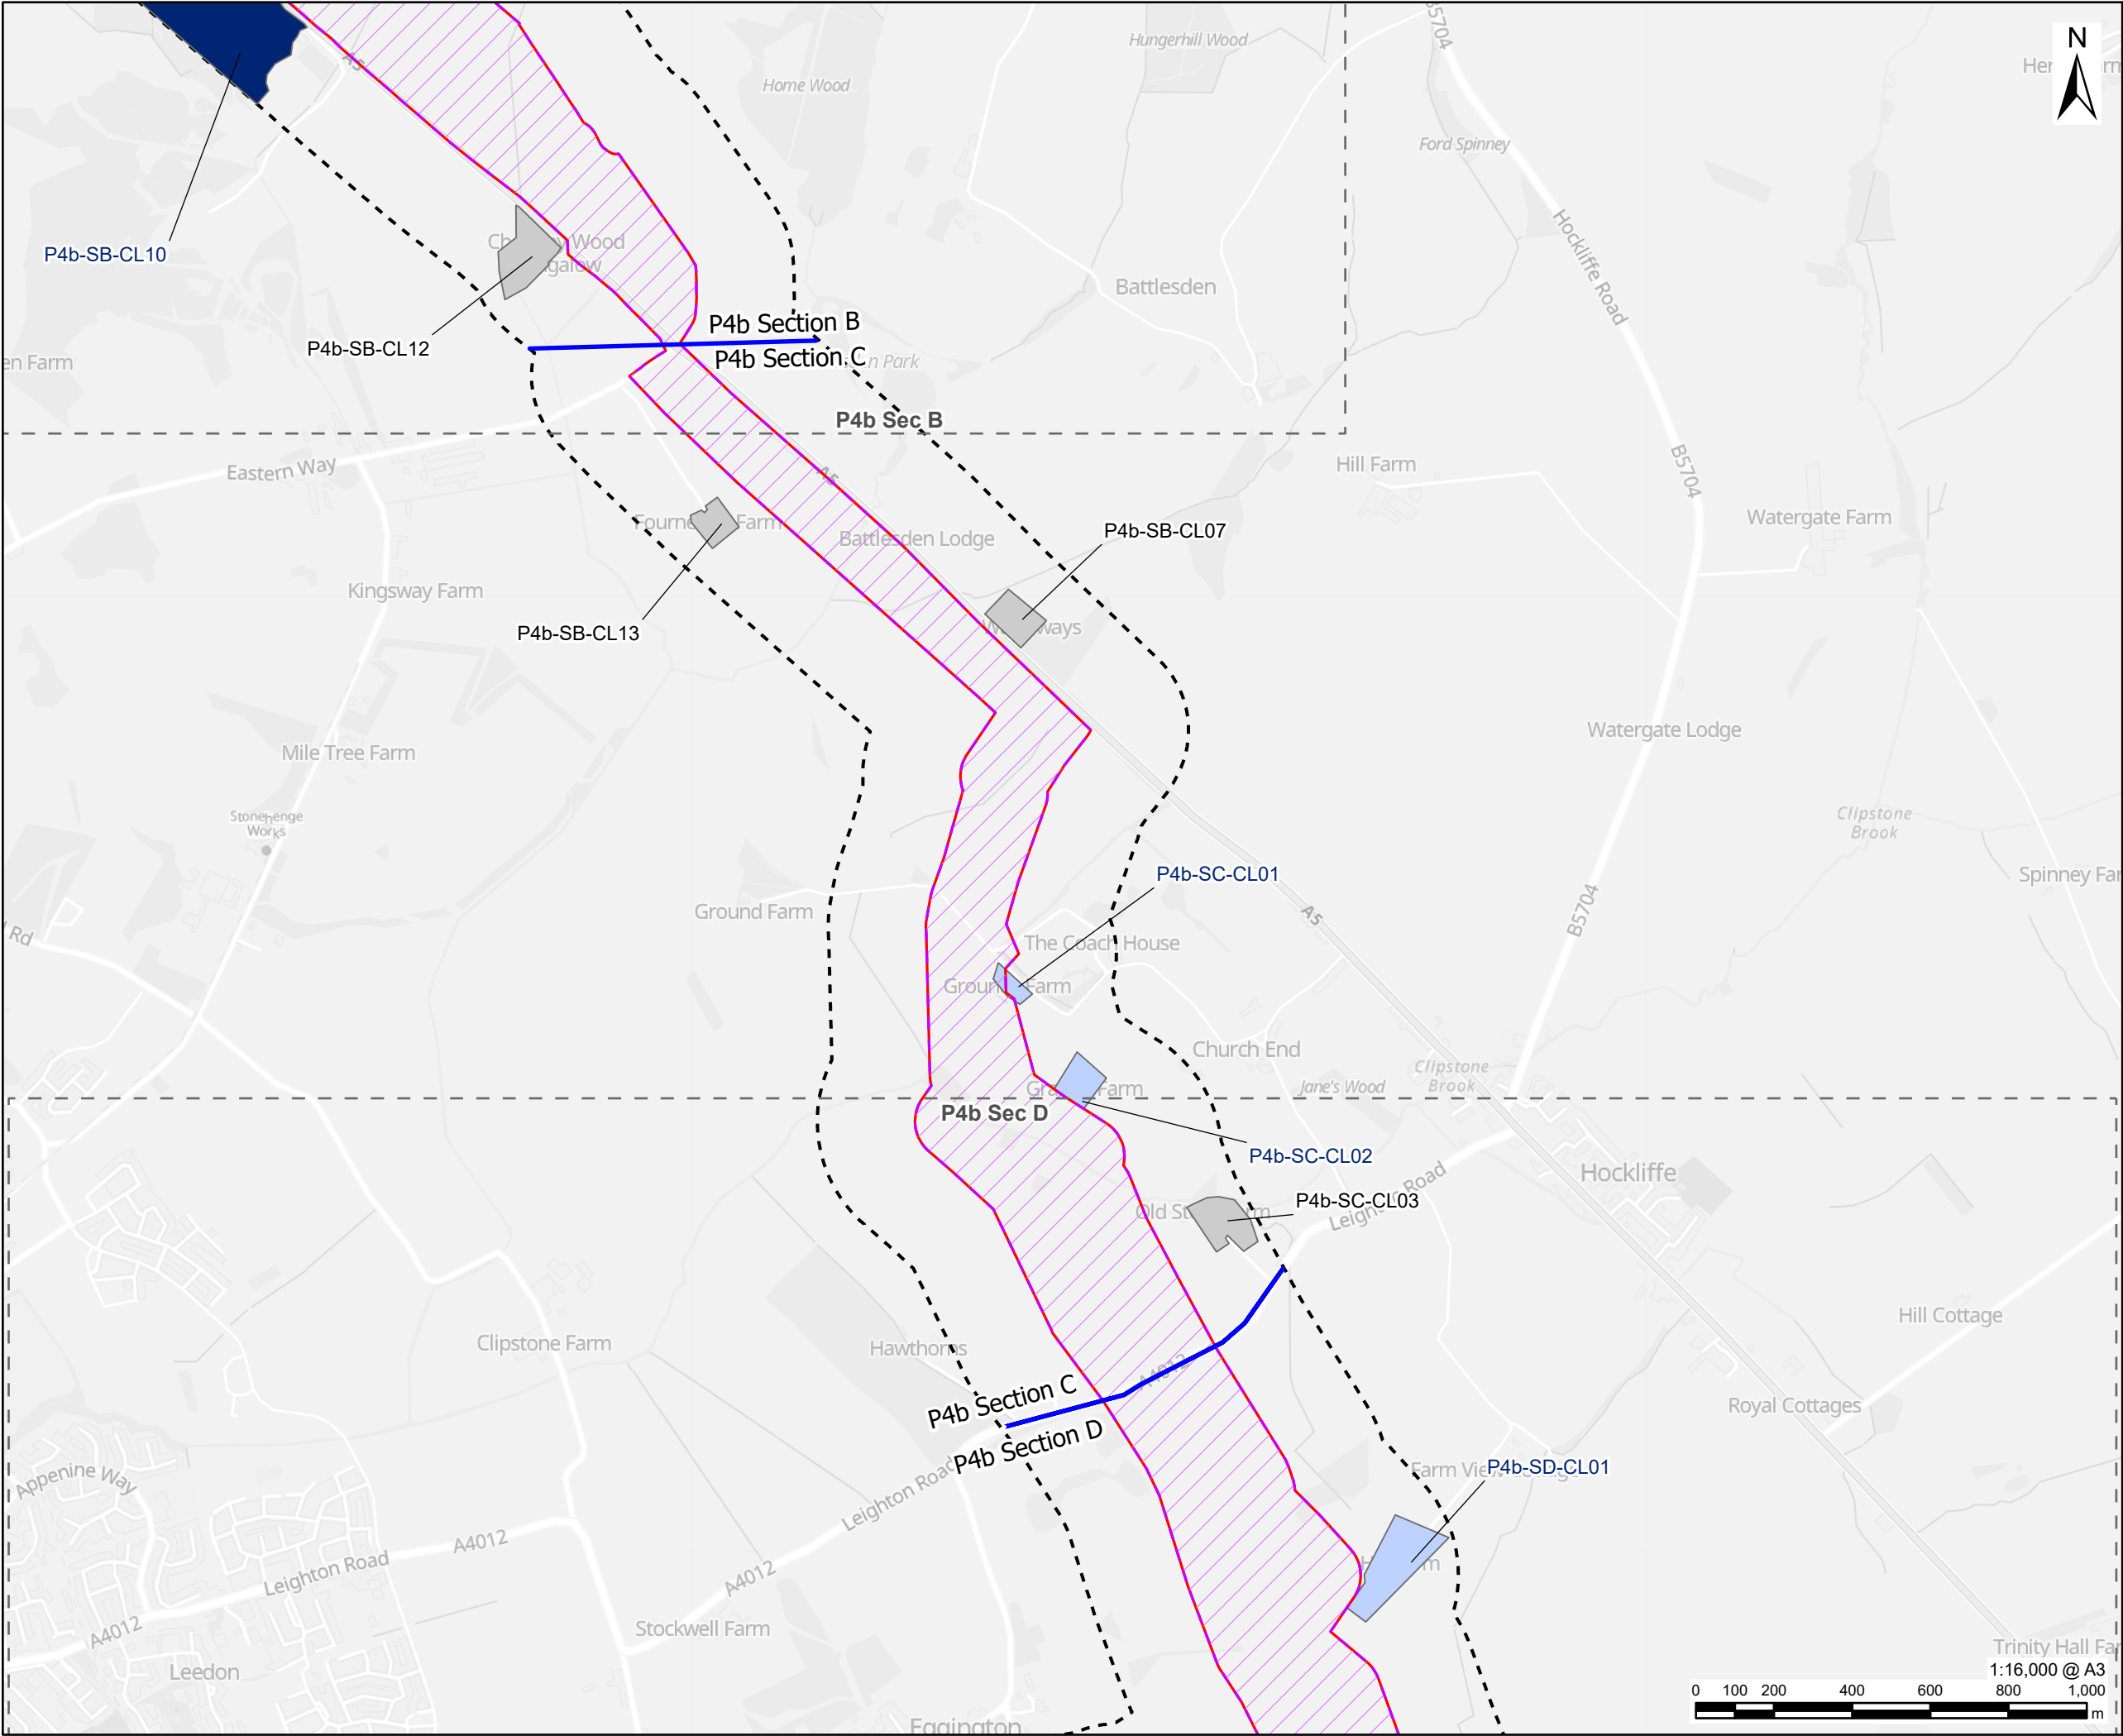

PROJECT

CLIENT
Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT
AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

- Part 4b
- 250m Study Area for Geology, Land Contamination and Hydrogeology
- Preliminary Order Limits
- Sheet Extent
- Section Break

Contaminated Land Risk Rating

	1 to 2	Potential Areas of Contamination not considered to pose an unacceptable risk
	3	Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment
	4	
	5	

NOTES


1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
3. Contains data from OS Zoomstack
- Contains Ordnance Survey Data © Crown Copyright and database right 2025.


ISSUE PURPOSE
FINAL

PROJECT NUMBER
60720432


FIGURE TITLE
Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P4b Sec C

FIGURE NUMBER
Figure 14-PD-6




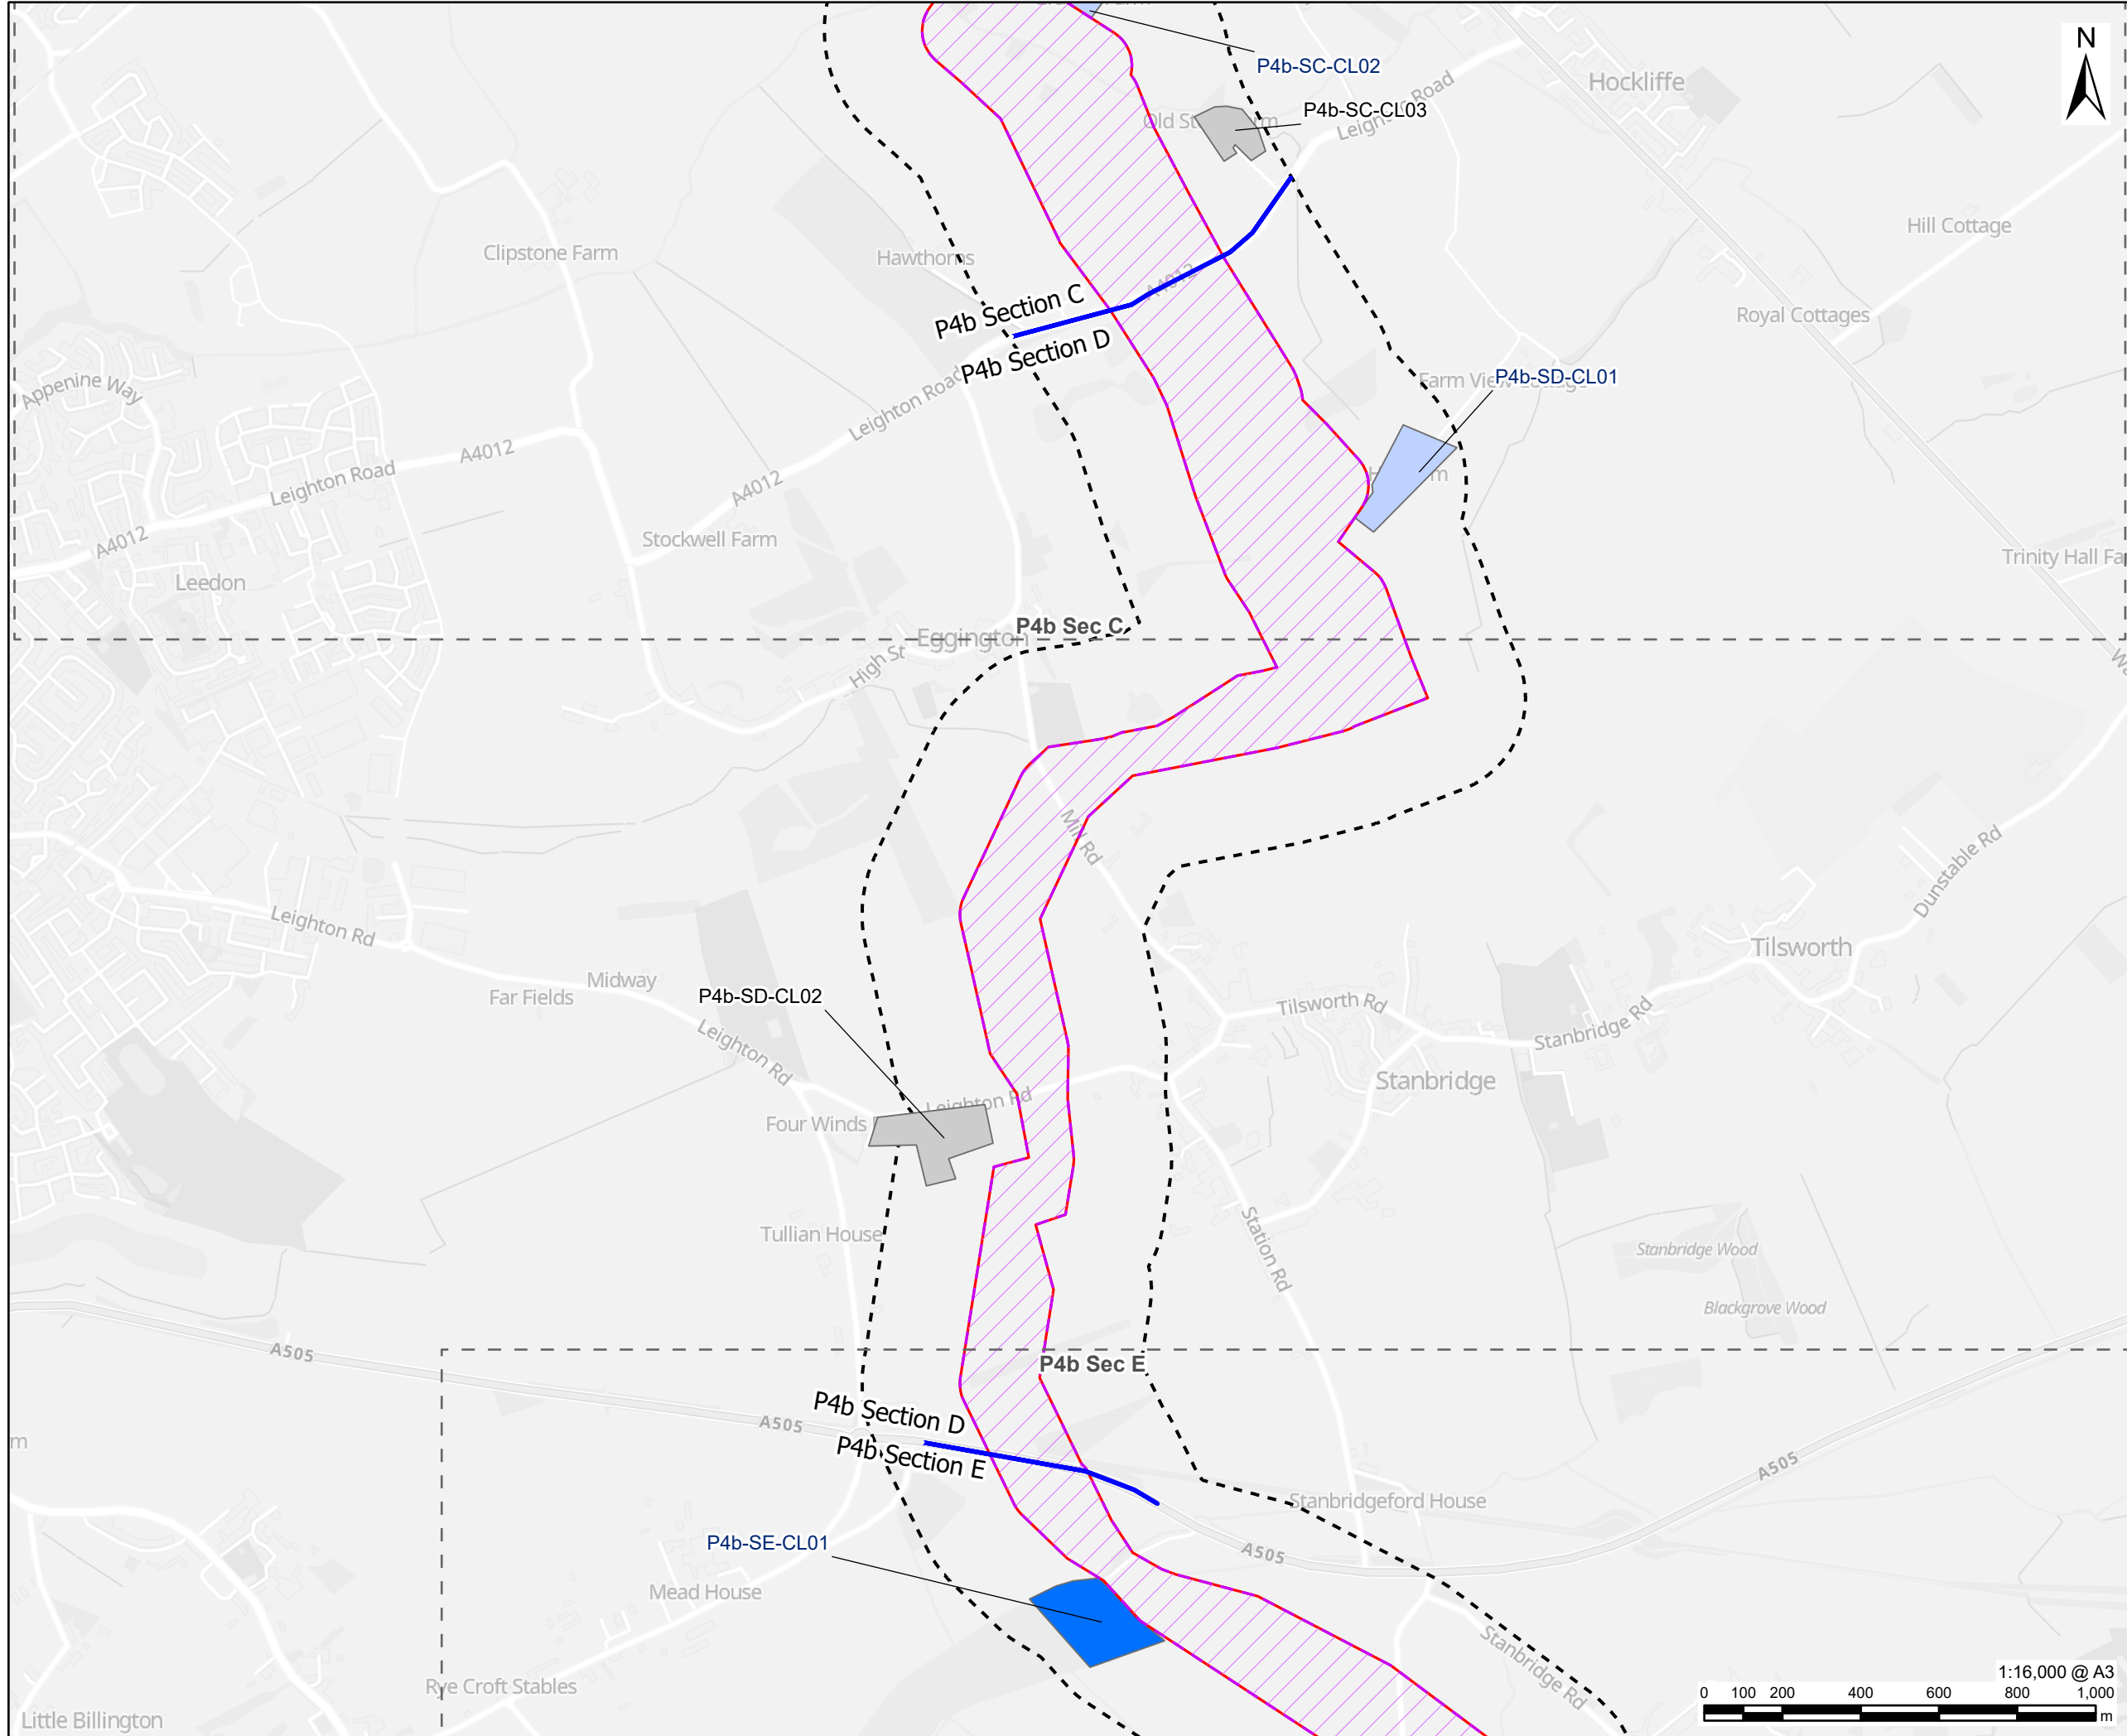

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. Do not scale. All measurements must be obtained from the stated dimensions.

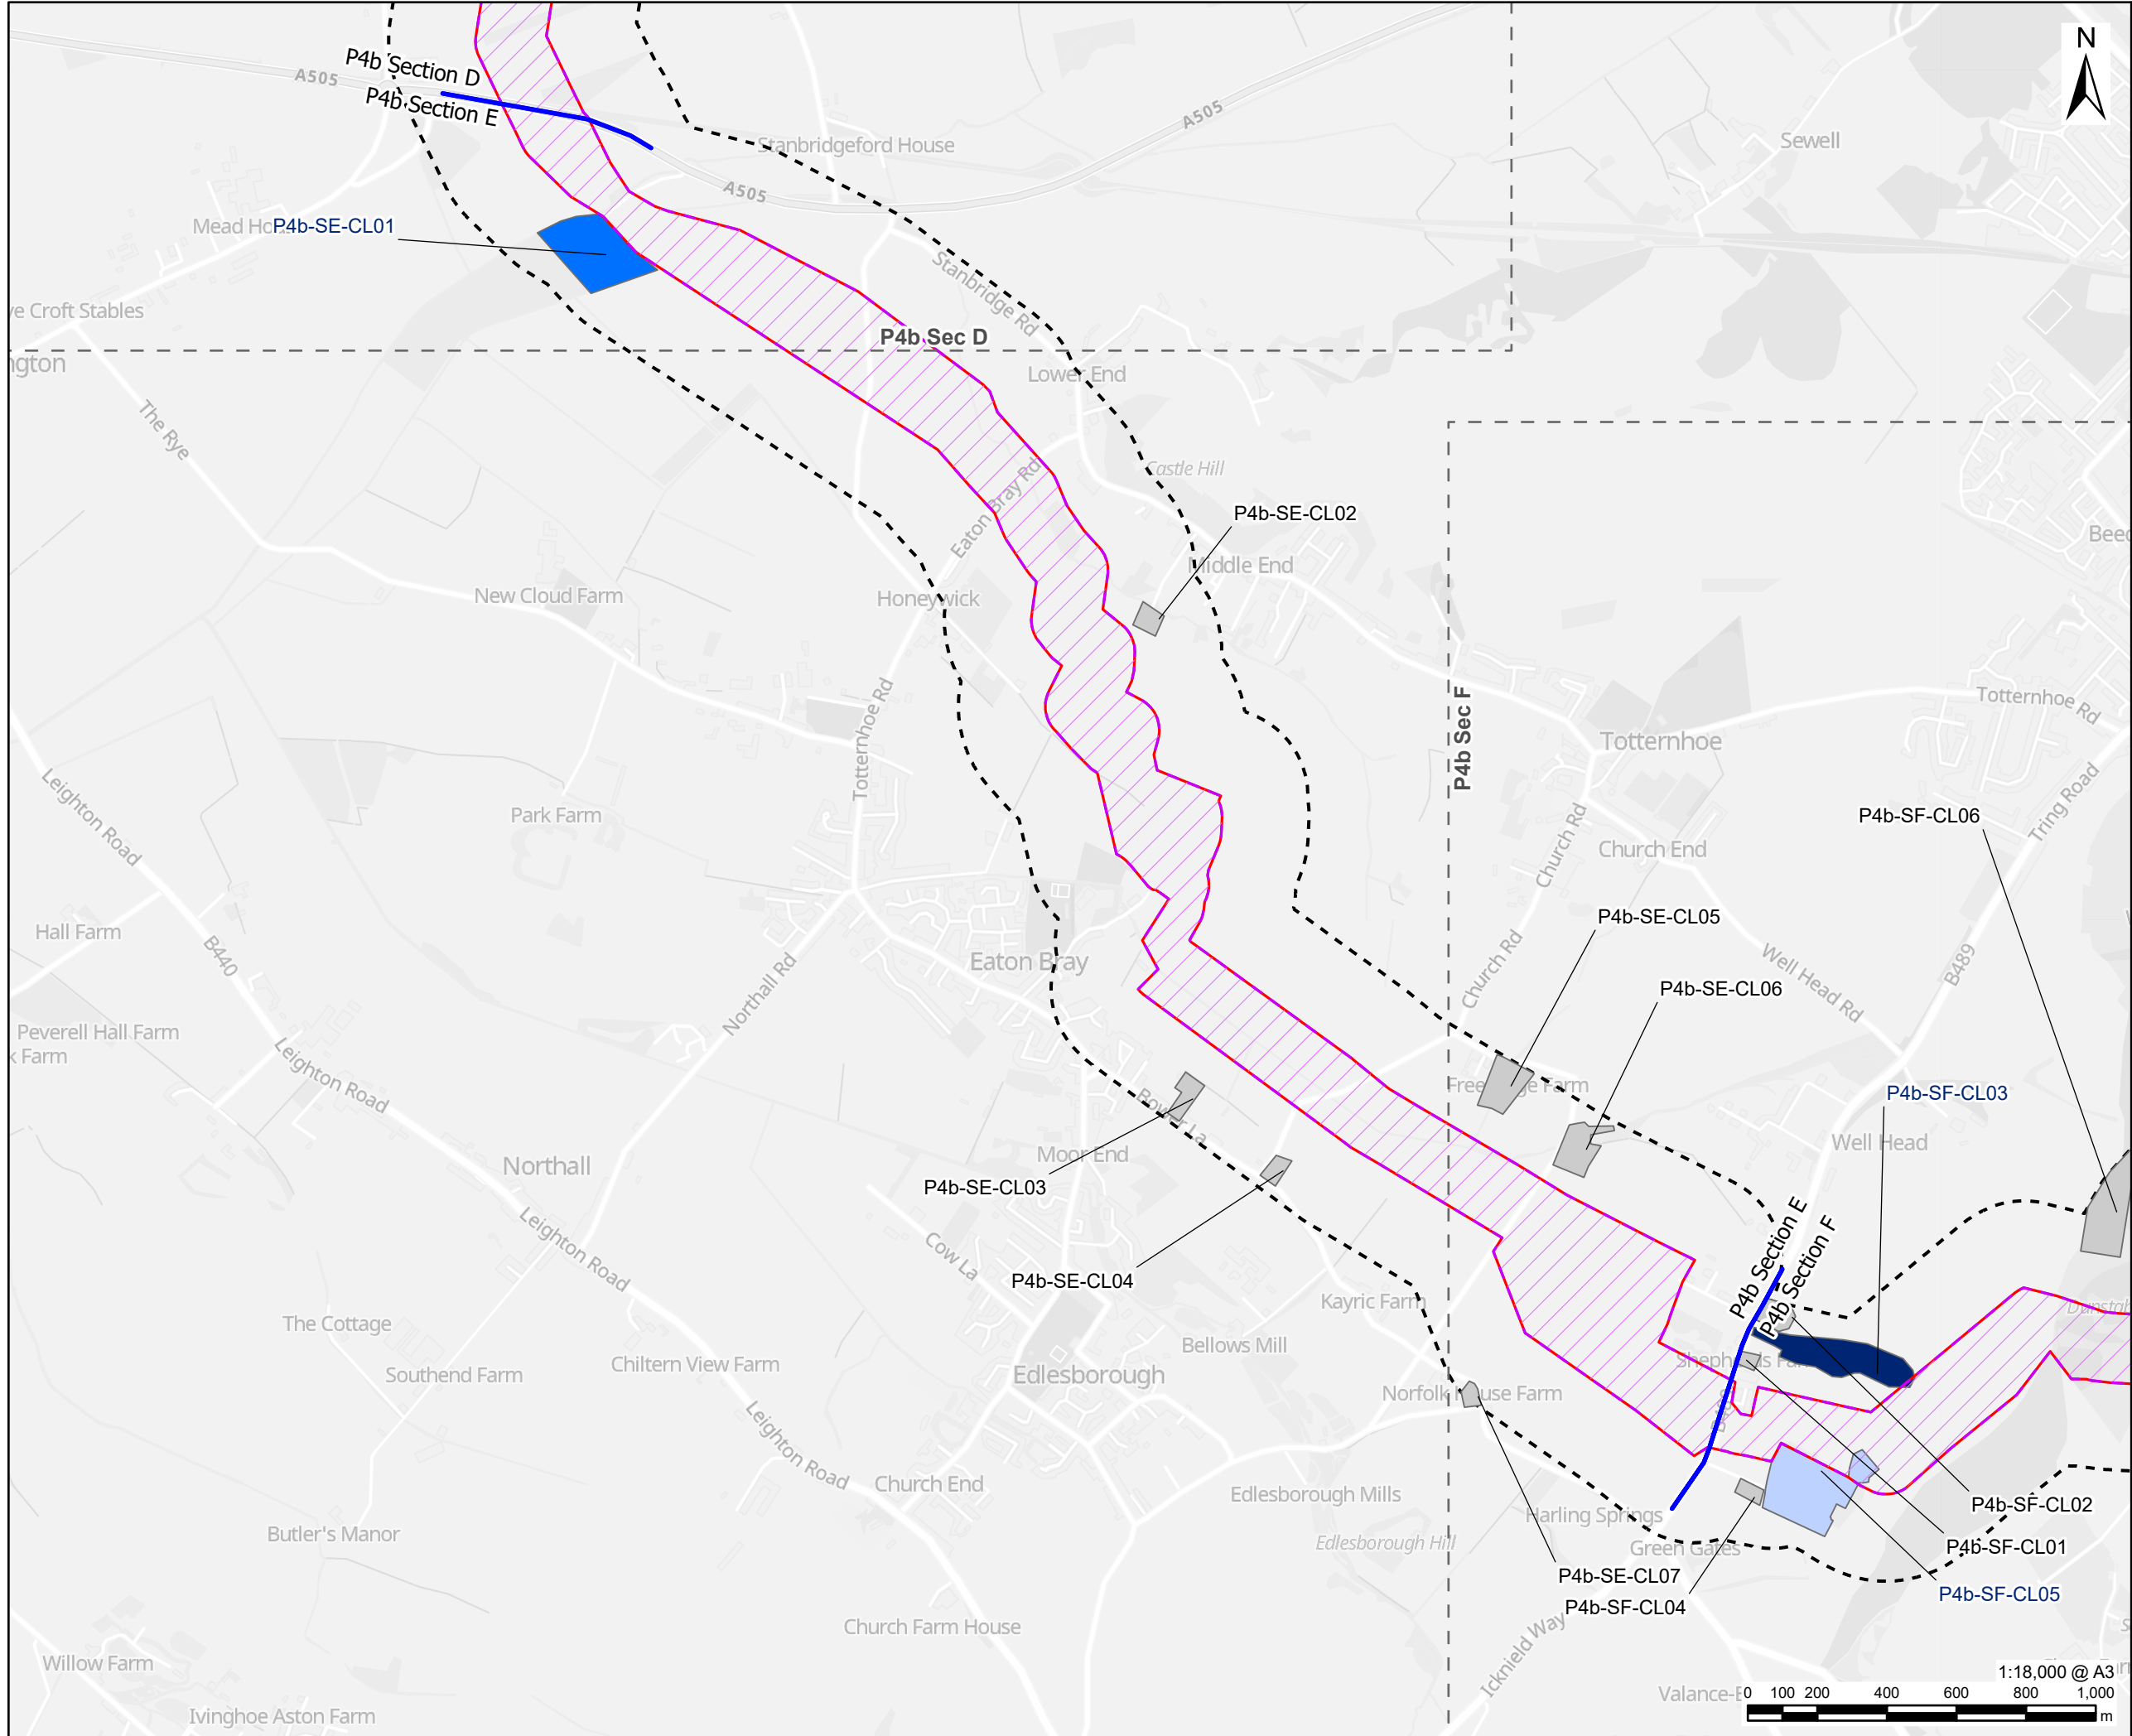

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions. This drawing, and the information it contains, is the property of AECOM and is not to be distributed, copied, reproduced, or otherwise used without the written permission of AECOM.

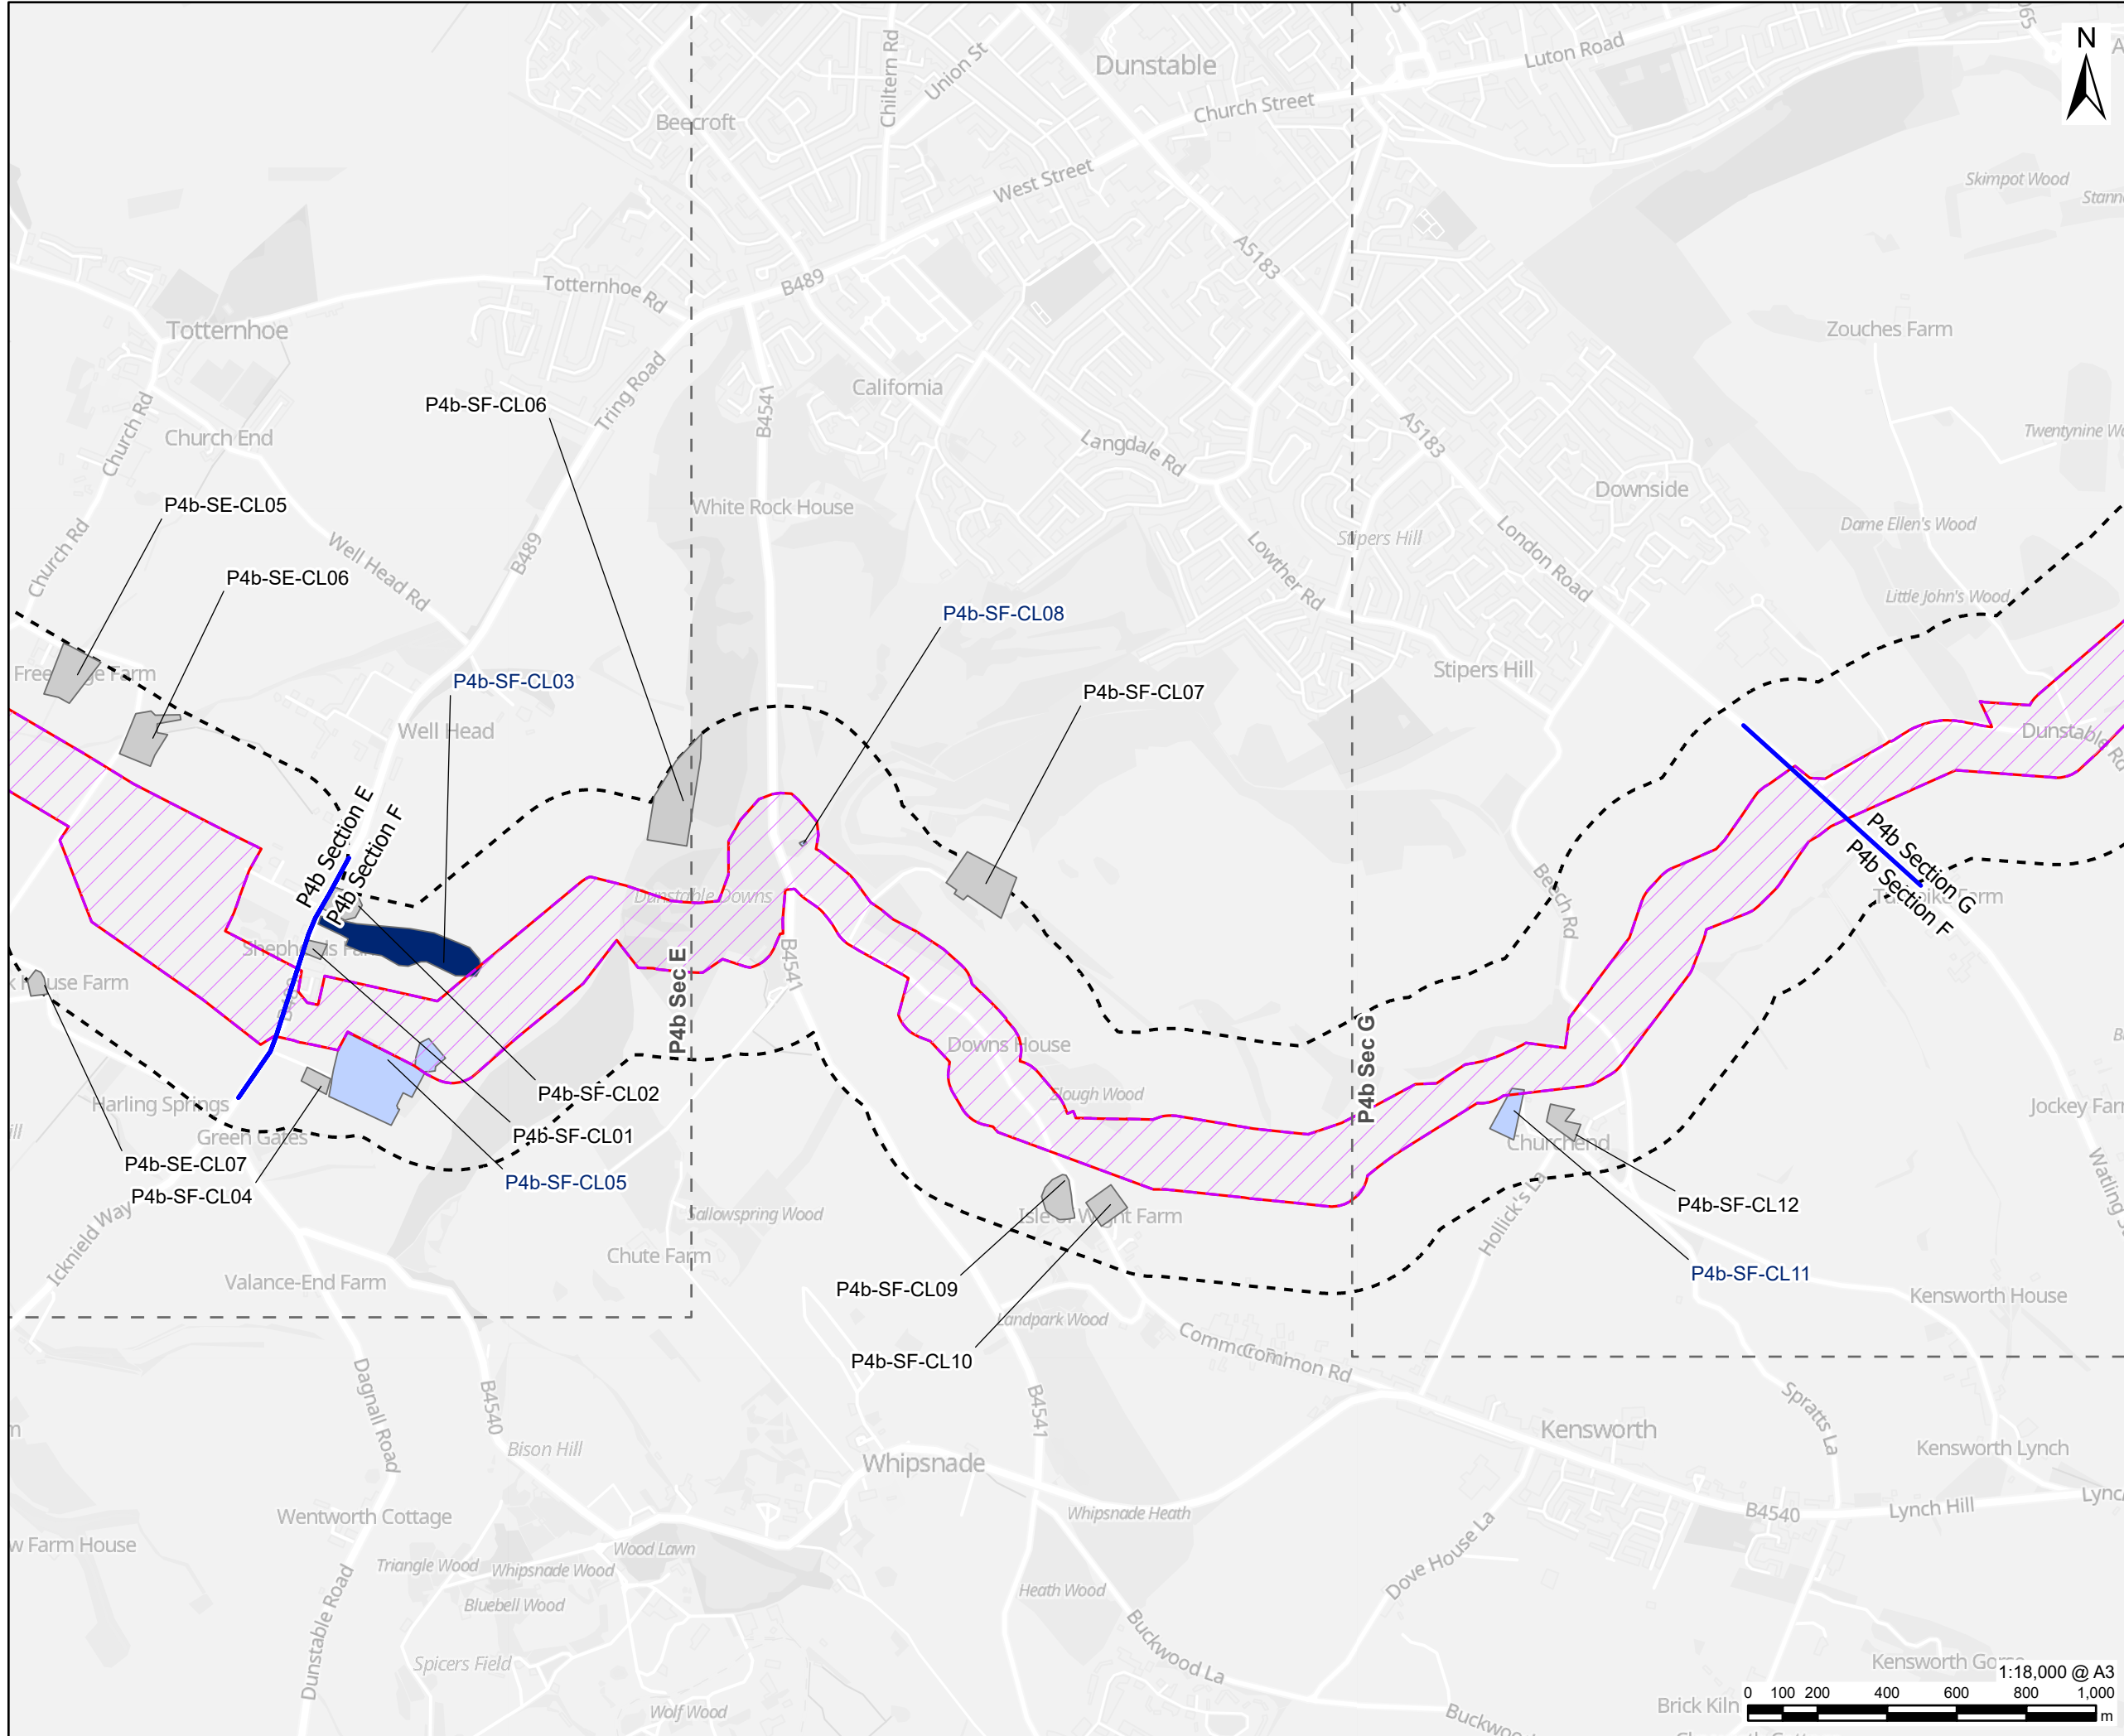

This drawing has been prepared for the use of AECOM's client. It may not be used, modified, reproduced or relied upon by third parties, except as agreed by AECOM or as required by law. AECOM accepts no responsibility, and denies any liability whatsoever, to any party that uses or relies on this drawing without AECOM's express written consent. All measurements must be obtained from the stated dimensions.



PROJECT

CLIENT

Affinity Water, Severn Trent Water
and Canal & River Trust

CONSULTANT

AECOM Limited
Midpoint,
Alencon Link
Basingstoke, RG21 7PP
www.aecom.com

LEGEND

-  Part 4b
 250m Study Area for Geology, Land Contamination and Hydrogeology
 Preliminary Order Limits
 Sheet Extent
 Section Break

Contaminated Land Risk Rating

- | | | |
|---|--------|---|
|  | 1 to 2 | Potential Areas of Contamination not considered to pose an unacceptable risk |
|  | 3 | Potential Areas of Contamination considered to pose an unacceptable risk that will be taken through to further assessment |
|  | 4 | |
|  | 5 | |

NOTES

1. Reproduced from Ordnance Survey digital map data © Crown copyright and database rights 2025 OS 100025261.
2. Contains OS data © Crown Copyright and database right 2025
Contains data from OS Zoomstack
3. Contains Ordnance Survey Data © Crown Copyright and database right 2025.

ISSUE PURPOSE

FINAL

PROJECT NUMBER

60720432

FIGURE TITLE

Parts 2, 3 & 4 Potential Areas of Contamination
Sheet P4b Sec G

FIGURE NUMBER

Figure 14-PD-6